GUESTROOM DOOR SCHEDULE

Mark	LOCATION	Door Type	DOOR WIDTH	DOOR HEIGHT	DOOR MATERIAL	DOOR FINISH	FRAME MATERIAL	DOOR ASSEMBLY FIRE RATING, SMOKE, DRAFT CONTROL	CLOSER	CARD READER	MAGNETIC HOLD OPEN	PANIC HARDWARE	FIRE EXIT HARDWARE	HARDWARE SET	NOTES
GR1	GUESTROOM ENTRY	C	3' - 0"	6' - 8"	WDF	PLAM	HM	20MIN + S/D	•	•				T1B	MIRROR ON INTERIOR FACE. SEE ELEVATION. COORD PEEPHOLES
GR2	GUEST BATHROOM	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T2C	
GR1A	GUESTROOM UNIT @ ACCESSIBLE	C	3' - 0"	7' - 0"	WDF	PLAM	HM	20MIN + S/D	•	•				T1C	MIRROR ON INTERIOR FACE. SEE ELEVATION. COORD PEEPHOLES
GR3	GUEST BATHROOM @ ACCESSIBLE	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T2E	
GR4	GUESTROOM CONNECTING	B	3' - 0"	7' - 0"	WDF	PLAM	ALUM	45 MIN.	•					T5	
	EXTERIOR DOORS														
E1	LOBBY-ENTRY VESTIBULE	J	6' - 0"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---		•		*		T15C	AUTOMATIC SLIDING DOOR. TILE TRANSITION THRESHOLD. *WITH EMERGENCY BREAKWAY PANEL
E2	LOBBY-ENTRY VESTIBULE	J	6' - 0"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•			*		T15C	AUTOMATIC SLIDING DOOR. TILE TRANSITION THRESHOLD. *WITH EMERGENCY BREAKWAY PANEL
E3	RESIDENTIAL CORRIDOR B - EXTERIOR	A.1	3' - 4"	7' - 3"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•		•		T12B	FINISH TO MATCH TYPICAL STOREFRONT+ SIDE LITE
E4	STAIR 'B' - EXTERIOR	B	3' - 0"	7' - 0"	HMF	PTD	HM	---	•			•		T11A	
E5	BREAKFAST - EXTERIOR	A	3' - 4"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•				T12B	FINISH TO MATCH TYPICAL STOREFRONT
E6	BREAKFAST - EXTERIOR	A	3' - 4"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•				T12B	FINISH TO MATCH TYPICAL STOREFRONT
E7	POOL DECK - EXTERIOR	A	3' - 4"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•				T12B	FINISH TO MATCH TYPICAL STOREFRONT
E8	ELECTRICAL - EXTERIOR	D	3' - 0"	7' - 0"	HMF	PTD	HM	---	•			•			
E9	RESIDENTIAL CORRIDOR A - EXTERIOR	A.1	3' - 4"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•		•		T12B	FINISH TO MATCH TYPICAL STOREFRONT+ SIDE LITE
E10	STAIR 'A' - EXTERIOR	B	3' - 0"	7' - 0"	HMF	PTD	HM	---	•			•		T11A	
	FIRST FLOOR DOOR SCHEDULE														
100A	RESIDENTIAL CORRIDOR 'A' - LOBBY	F	4' - 6"	6' - 8"	WDF	PLAM	HM	45 MIN +S/D	•		•		•	T33	UNEVEN PAIR: 3'-0" & 1'-6" WITH HOLD OPENS TIED TO FIRE ALARM.
100B	RESIDENTIAL CORRIDOR 'B' - LOBBY	F	4' - 6"	6' - 8"	WDF	PLAM	HM	45 MIN +S/D	•		•		•	T33	UNEVEN PAIR: 3'-0" & 1'-6" WITH HOLD OPENS TIED TO FIRE ALARM.
101	STAIR 'A' - CORRIDOR	G	3' - 0"	6' - 8"	HM	PTD	HM	90 MIN +S/D	•					T10A	
102	WATER HEATERS - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T16B	
107	EMPLOYEE BREAKROOM - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---	•					T28A	
108A	MECHANICAL - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•				•	T16B	
108B	POOL CHEM - POOL	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•				•	T16B	
108C	ELECTRICAL - POOL	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T16B	
109	LAUNDRY - CORRIDOR 'A'	F	4' - 6"	6' - 8"	WDF	PLAM	HM	45 MIN +S/D	•					T27B	UNEVEN PAIR: 3'-0" & 1'-6" WITH HOLD OPENS TIED TO FIRE ALARM.
109A	LAUNDRY - EMPLOYEE BREAKROOM	E	3' - 0"	6' - 8"	WDF	PTD	HM	45 MIN.	•					T28A	
109B	DRYER - EMPLOYEE BREAKROOM	B	2' - 4"	6' - 8"	WDF	PLAM	HM	45 MIN.						T35A	
111	STORAGE	B	3' - 0"	7' - 0"	WDF	PLAM	HM	20MIN.	•					T	
112	WOMEN	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T23A	
112A	POOL VESTIBULE	A.1	3' - 0"	7' - 0"	ALUM	PREFINISHED	ALUM	---						T24A	
113A	LINEN CHUTE - LAUNDRY	B	3' - 0"	6' - 8"	WDF	PTD	HM	90 MIN +S/D	•						
114	MEN	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T23A	
115A	WORK AREA - LAUNDRY	B	3' - 0"	6' - 8"	WDF	PTD	HM	45 MIN.	•					T26C	
115B	WORK AREA - OFFICE	B	3' - 0"	6' - 8"	WDF	PTD	HM	---						T30A	
115C	STORAGE	B	2' - 4"	6' - 8"	WDF	PLAM	HM	---						T16B	
115D	WORK AREA - REGISTRATION	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T26B	
116	FITNESS - ELEV. LOBBY	A	3' - 4"	7' - 6"	ALUM+GLASS	PREFINISHED	ALUM	---	•	•				T24A	FINISH TO MATCH TYPICAL STOREFRONT
117B	REGISTRATION - STORAGE	B	2' - 4"	6' - 8"	WDF	PLAM	HM	---						T16B	
122	BREAKFAST - FOOD PREP	G	3' - 0"	6' - 8"	WDF	VINYL ACRYLIC	HM	---	•					T31A	DOUBLE ACTING DOOR
124	FOOD PREP - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	---						T31A	
131	MATV ROOM - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T16B	
132	STAIR 'B' - CORRIDOR	G	3' - 0"	6' - 8"	HM	PTD	HM	90 MIN +S/D	•		•			T10A	
	UPPER FLOOR DOOR SCHEDULE														
X01	STAIR 'A' - CORRIDOR	G	3' - 0"	6' - 8"	HM	PTD	HM	90 MIN +S/D	•		•		•	T10A	HOLD OPENS TO BE TIED TO FIRE ALARM SYSTEM
202	GUEST LAUNDRY - CORRIDOR	E	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•	•			•	T17A	
202A	STORAGE - GUEST LAUNDRY	E	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T16B	
213A	LINEN CHUTE ACCESS - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T17A	
X18	ELECTRICAL - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	20MIN.	•					T16B	
220A	MECHANICAL - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T16B	
X31	LINEN STORAGE - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T17A	
X32	STAIR 'B' - CORRIDOR	G	3' - 0"	6' - 8"	HM	PTD	HM	90 MIN +S/D	•		•		•	T10A	HOLD OPENS TO BE TIED INTO FIRE ALARM SYSTEM
302	ENGINEERS OFFICE - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PTD	HM	45 MIN.	•					T17A	
X22A	STORAGE - CORRIDOR	B	2' - 4"	6' - 8"	WDF	PLAM	HM	45 MIN.	•					T7A	
402	COMPUTER ROOM - CORRIDOR	B	3' - 0"	6' - 8"	WDF	PTD	HM	20MIN.	•					T7A	

DOOR ELEVATION - TYPICAL HARDWARE LOCATIONS:

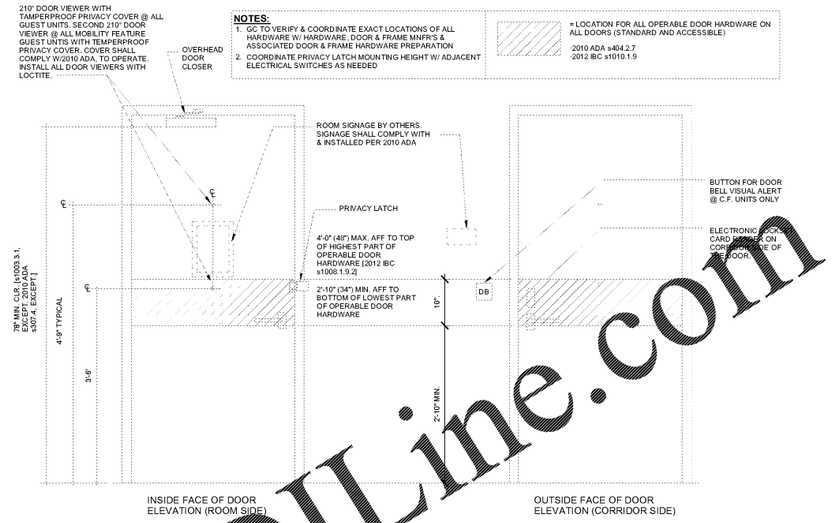

INSIDE FACE OF DOOR ELEVATION (ROOM SIDE)

OUTSIDE FACE OF DOOR ELEVATION (CORRIDOR SIDE)

3 / A-8.1 DOOR ELEVATION-TYPICAL HARDWARE LOCATIONS 1" = 1'-0"

GENERAL DOOR NOTES

1. DOOR THICKNESS OF ALL DOORS IS 1 3/4" UNLESS NOTED OTHERWISE.
2. REFER TO FLOOR PLANS FOR DOOR ORIENTATION & HANDING.
3. ALL HOLLOW METAL DOORS AND FRAMES TO BE PAINTED.
4. EXTERIOR PAINT COLOR TO MATCH ADJACENT EXTERIOR MATERIALS.
5. TOPS AND BOTTOMS OF ALL DOORS SHALL PRE- FINISHED OR PAINTED TO MATCH DOOR COLOR.
6. ALL PUBLIC SPACE DOORS TO HAVE PLASTIC LAMINATE FINISH, UNO.
7. ALLOW FOR PLASTIC LAMINATE DOORS AT DOOR SCHEDULE ADJUST HINGES AS REQUIRED.
8. PROVIDE SAFETY GLAZING WHERE REQUIRED PER CODE CRITERIA.
9. DOOR HARDWARE TO BE CENTERED ON RAIL OF PANEL DOORS.
10. HINGE MOUNTED DOOR STOPS ARE NOT ALLOWED.
11. ALL GUARDS & HANDRAILS AT UNIT ENTRY DOORS REQUIRE A SPACER TO CLEAR THE DOOR TRIM.
12. REFER TO DOOR PLANS & WINDOW SCHEDULE FOR SIDE LITE LOCATIONS.
13. REFER TO SHEET A-7.1 FOR WALL TYPES - CROSS REFERENCE FOR DOOR FRAME THROAT THICKNESS.
14. ALL DOORS SHALL BE PRE-FINISHED (SHOP OR FACTORY)
15. ALL EXTERIOR HOLLOW METAL DOORS SHALL BE GALVANIZED & INSULATED.
16. ALL EXTERIOR DOORS SHALL HAVE CLOSED TOPS CONSTRUCTED IN SUCH A WAY TO SHED & THEREFORE PREVENT WATER FROM COLLECTING/SITTING ON THE TOP OF THE DOOR SLAB. JOINTS SHALL BE MINIMIZED @ THE TOP OF DOOR SLAB, ANY CONSTRUCTION JOINTS SHALL BE FULLY WEATHER TIGHT.
17. DOOR FRAMES, EXCLUDING STOREFRONT ENTRIES, PRE-FINISHED FRAMES & WHERE NOTED OTHERWISE, SHALL BE HOLLOW METAL PAINTED JAMB ANCHORS: MIN 3 PER JAMB, ALL WELDED CONSTRUCTION.
18. REFER TO BRAND STANDARDS MANUAL FOR ADDITIONAL INFO REGARDING DOOR & DOOR HARDWARE REQ'S.
19. **ALL** DOORS PROVIDING USER PASSAGE MUST HAVE A 32" MIN. CLEAR WIDTH OPENING WHEN DOOR OPEN'S AT 90 DEGREE.
20. ALL EXTERIOR DOORS NEED TO BE TIGHT AND SELF- CLOSING TO EFFECTIVELY PROTECT AGAINST ENTRANCE OF INSECTS AND RODENTS.
13. NO THUMB LATCHES OR KEYED CYLINDER DEAD BOLTS ARE ALLOWED ON ANY DOORS UNLESS OPERATED BY A SINGLE ACTION WITH A LEVER FROM THE INSIDE OF THE AREA SERVED. 2012 IBC SECTION 1010.1.9.5.

DOOR ACCESSIBILITY NOTES

1. OPERABLE PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, TIGHT PINCHING, OR TWISTING OF THE WRIST TO OPERATE. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS (22.2 N) MAX.DOOR HARDWARE MUST BE OPERABLE WITH A CLOSED FIST AND LOOSE GRIP. DOOR HANDLE TRIM SHALL BE LEVER TYPE. TYP. U.N.O. HARDWARE THAT REQUIRES SIMULTANEOUS HAND AND FINGER MOVEMENTS IS NOT PERMITTED. REF. 2010 ADA 404.2.7 & 309.4 .
2. THRESHOLDS @ ACCESSIBLE DOORS TO MEET ALL APPROPRIATE ACCESSIBILITY REGS. ACCESSIBLE DOORS INCLUDE ALL PUBLIC SPACES, ALL PUBLIC EXTERIOR DOORS, ALL EGRESS DOORS, & EMPLOYEE DOORS THAT ARE INDICATED W/ A CLEAR FLOOR AREA ALL GUEST UNIT DOORS (ENTRY & INTERIOR UNIT DOORS).
3. HANDLES, PULLS, LATCHES, LOCKS, CARD READERS AND OTHER OPERABLE PARTS ON DOORS AND GATES SHALL COMPLY WITH 2010 ADA s309.4. HARDWARE SHALL BE 34" MIN. & 44" MAX. AFF TO HIGHEST OPERABLE PART. WHERE SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES.
4. ACCESS GATES IN BARRIERS PROTECTING POOLS SHALL BE PERMITTED TO HAVE OPERABLE PARTS OF THE RELEASE OF LATCH ON SELF-LATCHING DEVICES AT 54" MAX. AFF PROVIDED THE SELF-LATCHING DEVICES ARE NOT ALSO SELF-LOCKING AND OPERATED BY MEANS OF A KEY, ELECTRONIC OPENER OR INTEGRAL COMBINATION LOCK. [2010 ADA s4.2.7, EXCEPT: 2]
5. SWINGING DOOR SURFACES WITHIN 10" FROM FINISH FLOOR MEASURED VERTICALLY TO HAVE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR. PARTS CREATING HORIZONTAL OR VERTICAL JOINTS IN THESE SURFACES TO BE WITHIN 1/16" OF THE SAME PLANE AS THE OTHER. CAVITIES CREATED BY ADDED KICK PLATES SHALL BE CAPPED. EXCEPTIONS: 1) SLIDING DOORS ARE NOT BE REQUIRED TO COMPLY WITH 404.2.10. 2) TEMPERED GLASS DOORS WITHOUT STILES AND HAVING A BOTTOM RAIL OR SHOE WITH THE TOP LEADING EDGE TAPERED AT 60 DEGREES MIN. FROM THE HORIZONTAL SHALL NOT BE REQUIRED TO MEET THE 10" BOTTOM SMOOTH SURFACE HEIGHT REQUIREMENT. (404.2.10 ADA).
6. FIRE DOORS SHALL HAVE A MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY. THE FORCE FOR PUSHING OR PULLING OPEN A DOOR OR GATE OTHER THAN FIRE DOORS ARE AS FOLLOWS: A) INTERIOR HINGED DOORS AND GATES: 5 LBS. MAX. B) SLIDING OR FOLDING DOORS: 5 LBS. MAX. THESE FORCES DO NOT APPLY TO THE FORCE REQUIRED TO RETRACT LATCH BOLTS OR DISENGAGE OTHER DEVICES THAT HOLD THE DOOR IN A CLOSED POSITION. (404.2.9 ADA).
7. DOOR CLOSERS TO BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 90 DEGREES THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 12 DEGREES FROM THE LATCH IS 5 SECONDS MIN. (404.2.8 ADA)

HARDWARE NOTES

1. REFERENCE SPECIFICATION SECTION 08-71-00 FOR DOOR HARDWARE SETS.
2. REFERENCE DOOR ELEVATION DETAILS, THIS SHEET, FOR TYPICAL HARDWARE LOCATIONS INCLUDING VISION PORTS.
3. ALL DOOR HARDWARE SHALL BE SATIN STAINLESS STEEL OR SATIN CHROME FINISH, U.N.O. ALL FINISH ON ALL HARDWARE MUST BE THE SAME, INCLUDING HINGES.
4. ALL DOORS TO BE MASTER KEYED. COORDINATE KEYING W/ OWNER.
5. ALL LOCKSETS & CYLINDERS ARE SUPPLIED W/ FINAL CORES. PERMANENT KEYING BY DOOR SUBCONTRACTOR.
6. ALL RATED DOORS SHALL BE PROVIDED W/ MIN. REQ'D DOOR HARDWARE REGARDLESS IF NOT SHOWN ON SCHEDULE. CONTACT ARCHITECT WITH ANY DISCREPANCIES.
7. 1 1/2" PAIR BUTT HINGES PER DOOR LEAF UP TO 7'-0". SOLID CORE WOOD OR HM DOORS FROM 7'-0" TO 10'-0" PROVIDE 2 PAIR BUTT HINGES PER DOOR LEAF. DOORS 10'-1" TO 14'-0" IN HEIGHT, PROVIDE 2 1/2 PAIR HINGES PER DOOR LEAF.
8. PROVIDE (3) SILENCERS IN SINGLE LEAF DOORS, (2) SILENCERS IN DOUBLE LEAF DOORS UNLESS PAIR OF DOORS HAS MIDDLE MULLION THEN PROVIDE A TOTAL (6) SILENCERS
9. LOCKSET SHALL OPERATE WHERE TURNING KEY UNLATCHES DOOR WHEN PUSHBUTTON IS ENGAGED & TURNED. KEY OPERATION WILL BE REQ'D @ ALL TIMES. RELEASING PUSHBUTTON UNLOCKS DOOR.
10. ALL EXTERIOR DOORS SHALL BE PROVIDED W/ AN ALUMN. DRIP EDGE ANCHORED TO UNDERSIDE OF W/ALL CONSTRUCTION (DOORS AS PART OF AN ALUMN. STOREFRONT SYSTEM W/ A TRANSOM LITE DO NOT REQUIRE DRIP EDGE - NOR DO DOORS THAT ARE PROTECTED UNDER CANOPIES.
11. EXTERIOR DOORS MUST HAVE WEATHER-STRIPPING W/ THE APPROPRIATE TYPE OF THRESHOLD.
12. CARD READER AT STOREFRONT DOORS TO BE LOCATED ON WIDE STILE U.N.O.
13. ALL DOOR CLOSURES TO BE COMMERCIAL WITH BALL BEARING HINGES.
14. CARD READERS TO BE LOCATED ON EXTERIOR SIDE OF DOOR/ OUTSIDE OF ROOM, UNO.

DOOR EGRESS NOTES:

MAGNETIC HOLD OPEN DEVICES:

MAGNETIC HOLD OPEN DEVICES SHALL BE TIED TO FIRE ALARM SYSTEM. MAGNET SHALL RELEASE DOORS WHEN ALARM IS ACTIVATED OR POWER IS LOST.

NOTES FOR DOORS CONTROLLED BY AN AUTOMATIC CARD READER

IN ACCORDANCE WITH IBC 2012 SECTION 1010.1.9.8, ... THE ENTRANCE DOOR IN A MEANS OF EGRESS ARE PERMITTED TO BE EQUIPPED WITH AN APPROVED ENTRANCE AND EGRESS ACCESS CONTROL SYSTEM, LISTED IN ACCORDANCE WITH UL 294, WHICH SHALL BE INSTALLED IN ACCORDANCE WITH ALL OF THE FOLLOWING CRITERIA:

1. A SENSOR SHALL BE PROVIDED ON THE EGRESS SIDE ARRANGED TO DETECT AN OCCUPANT APPROACHING THE DOOR. THE DOORS SHALL BE ARRANGED TO UNLOCK BY A SIGNAL FROM OR LOSS OF POWER TO THE SENSOR.
2. LOSS OF POWER TO THAT PART OF THE ACCESS CONTROL SYSTEM WHICH LOCKS THE DOORS SHALL AUTOMATICALLY UNLOCK THE DOORS.
3. THE DOORS SHALL BE ARRANGED TO UNLOCK FROM A MANUAL UNLOCKING DEVICE LOCATED NOT LESS THAN 48 INCHES (1016 MM TO 1219 mm) VERTICALLY ABOVE THE FLOOR AND WITHIN 5 FEET (1524 MM) OF THE SECURED DOORS. READY ACCESS SHALL BE PROVIDED TO SUCH MANUAL UNLOCKING DEVICE AND THE DEVICE SHALL BE CLEARLY IDENTIFIED BY A SIGN THAT READS: PUSH TO EXIT. WHEN OPERATED, THE MANUAL UNLOCKING DEVICE SHALL RESULT IN DIRECT INTERRUPTION OF POWER TO THE LOCK INDEPENDENT OF THE ACCESS CONTROL SYSTEM ELECTRONICS AND THE DOORS SHALL REMAIN UNLOCKED FOR A MINIMUM OF 30 SECONDS.
4. ACTIVATION OF THE BUILDING FIRE ALARM SYSTEM, IF PROVIDED, SHALL AUTOMATICALLY UNLOCK THE DOORS, AND THE DOORS SHALL REMAIN UNLOCKED UNTIL THE FIRE ALARM SYSTEM HAS BEEN RESET.
5. ACTIVATION OF THE BUILDING AUTOMATIC SPRINKLER OR FIRE DETECTION SYSTEM, IF PROVIDED, SHALL AUTOMATICALLY UNLOCK THE DOORS. THE DOORS SHALL REMAIN UNLOCKED UNTIL THE FIRE ALARM SYSTEM HAS BEEN RESET.
6. ENTRANCE DOORS IN BUILDINGS WITH AN OCCUPANT LOAD OF 300 OR MORE SHALL NOT BE SECURED FROM THE EGRESS SIDE DURING PERIODS THAT THE BUILDING IS OPEN TO THE GENERAL PUBLIC.

AUTOMATIC SLIDING DOORS W/ EMERGENCY BREAKAWAY FEATURES

IN ACCORDANCE WITH IBC 2012 SECTION 1008.1.9.1, ... HORIZONTAL SLIDING DOORS PERMITTED TO BE A COMPONENT OF A MEANS OF EGRESS IN ACCORDANCE WITH EXCEPTION 6 TO SECTION 1008.1.2 SHALL COMPLY WITH ALL OF THE FOLLOWING CRITERIA:

1. THE DOOR SHALL BE POWER OPERATED AND SHALL BE CAPABLE OF BEING OPERATED MANUALLY IN THE EVENT OF POWER FAILURE.
2. THE DOORS SHALL BE OPENABLE BY A SINGLE METHOD FROM BOTH SIDES WITHOUT SPECIAL KNOWLEDGE OR EFFORT.
3. THE FORCE REQUIRED TO OPERATE THE DOOR SHALL NOT EXCEED 30 POUNDS (133 N) TO SET THE DOOR IN MOTION AND 15 POUNDS (67 N) TO CLOSE THE DOOR OR OPEN IT TO THE MINIMUM REQUIRED WIDTH.
4. THE DOORS SHALL BE OPENABLE WITH A FORCE NOT EXCEED 15 POUNDS (67 N) WHEN A FORCE OF 250 POUNDS (1100 N) IS APPLIED PERPENDICULAR TO THE DOOR ADJACENT TO THE OPERATING DEVICE.
5. THE DOOR ASSEMBLY SHALL COMPLY WITH THE APPLICABLE FIRE PROTECTION RATING AND, WHERE RATED, SHALL BE SELF-CLOSING OR AUTOMATIC CLOSING BY SMOKE DETECTION IN ACCORDANCE WITH SECTION 715.4.6.3, SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 80 AND SHALL COMPLY WITH SECTION 715.
6. THE DOOR ASSEMBLY SHALL HAVE AN INTEGRATED STANDBY POWER SUPPLY.
7. THE DOOR ASSEMBLY POWER SUPPLY SHALL BE ELECTRICALLY SUPERVISED.
8. THE DOOR SHALL OPEN TO THE MINIMUM REQUIRED WIDTH WITHIN 10 SECONDS AFTER ACTIVATION OF THE OPERATING DEVICE.
9. HORIZONTAL SLIDING DOORS SHALL NOT BE USED ACROSS CORRIDORS.

ABBREVIATIONS & LEGEND:

E#	EXTERIOR DOOR	ALUM	ALUMINUM
A	GUEST UNIT DOORS	GALV	GALVANIZED
HM	HOLLOW METAL	PTD	PAINTED
STRFRNT	ALUMINUM STOREFRONT	M.F.	MOBILITY FEATURES
HMF	HOLLOW METAL FLUSH PANEL		
S/D	SMOKE AND DRAFT CONTROL DOOR AND HARDWARE ASSEMBLY		
WDF & SC WD	WOOD FLUSH PANEL & SOLID CORE WOOD INCLUDES PARTICLEBOARD CORE, WOOD VENEER FACE, PLASTIC LAMINATE FACE, THERMALLY FUSED FACE (MELAMINE, OPT) & VINYL-ACRYLIC FACE		
PLAM	HIGH PRESSURE PLASTIC LAMINATE		
T	TEMPERED, SAFETY GLAZING. MATERIAL SHALL COMPLY WITH BUILDING CODE REQUIREMENTS INCLUDING IDENTIFICATION AND LABELING.		
PR	PAIR OF DOORS		
PREFIN ALUM/GLASS	PREFINISHED STOREFRONT - ALUMINUM STILE AND RAIL, MEDIUM STILE, FULLY GLAZED		

DOOR TYPES

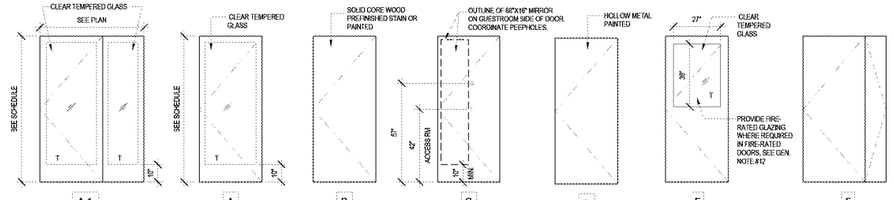

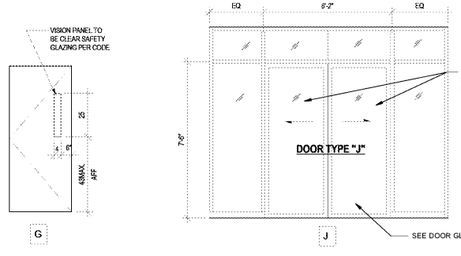

DOOR GLAZING NOTES:

1. ALL GLAZING IN DOORS TO BE TEMPERED SAFETY GLASS.
2. GLAZING IN FIRE-RATED DOOR ASSEMBLIES TO BE F.R. AS REQ. TO COMPLY WITH ASSEMBLY RATING
3. ALL FIRE-RATED GLAZING ADJACENT TO FIRE SPRINKLERS TO BE "THERMAL SHOCK RESISTANT" (HOSE STREAM TESTED).
4. THE FLOOR ON BOTH SIDES OF ALL DOORWAYS SHALL BE SUBSTANTIALLY LEVEL AND SHALL BE EQUAL TO THE WIDTH OF THE WIDEST LEAF.
5. GLAZING IN ALL EXTERIOR DOORS TO BE INSULATED, TEMPERED SAFETY GLASS, 6. PER 2012 IBC 5.1609.1.2, IN WIND-BORNE DEBRIS REGIONS, GLAZED OPENINGS IN BUILDINGS SHALL BE IMPACT RESISTANT OR AN APPROVED IMPACT-RESISTANT STANDARD AS FOLLOWS:
   1. GLAZED OPENINGS LOCATED WITHIN 30 FEET OF GRADE SHALL MEET THE REQUIREMENTS OF THE LARGE MISSILE TEST OF ASTM E1996.
   2. GLAZED OPENINGS LOCATED MORE THAN 30 FEET ABOVE GRADE SHALL MEET THE PROVISIONS OF THE SMALL MISSILE TEST OF ASTM E1996.

Bid Set Plans @ WWW.IDLine.com

PHILLIPS

KEYPLAN

CONSULTANT

SEAL

ISSUE & REVISION RECORD

#	DATE	DESCRIPTION

This document is © Phillips Partnership, PC and is considered an Instrument of Service and is solely for use with respect to the project as indicated below. All rights reserved. This document may not be reproduced without the prior written consent of Phillips Partnership, PC.

PROJECT

Fairfield BY MARRIOTT INN & SUITES

DAWSONVILLE, GEORGIA

PROTOTYPE VERSION 2016
REV 7 12-21-18

4 STORY, 92 UNITS
w/ INDOOR POOL

FAIRFIELD DAWSON FOREST ROAD DAWSONVILLE, GA 30534

CLIENT

RIMROCK COMPANIES
10000 RIVERSIDE AVE
SUITE 32201
JACKSONVILLE, FL 32204

PHILLIPS JOB NUMBER 1972101

ISSUE DATE 08/23/2019

DRAWN BY/CHECKED BY Author / Checker

DRAWING TITLE

DOOR SCHEDULE, ELEVATIONS, & NOTES

SHEET NUMBER

A-8.1

5901 PEACHTREE DUNWOODY RD.
BUILDING A, SUITE 450
ATLANTA, GEORGIA 30328
PHILLIPSPART.COM 770-394-1616