

PHILLIPS

KEY PLAN

CONSULTANT



PROFICIENT ENGINEERING

6991 Peachtree Industrial Blvd Building 700  
Peachtree Corners, Georgia 30092  
404.330.9795  
PROJECT # 119288

SEAL



ISSUE & REVISION RECORD

#	DATE	DESCRIPTION
06	06.10.2019	30% DESIGN REVIEW SET
08	08.15.2019	90% REVIEW SET
08	08.23.2019	PERMIT SET

This document is ©Phillips Partnership, PC and is considered an instrument of service and is solely for use with respect to the project as indicated herein. All rights reserved. This document may not be reproduced without the prior written consent of Phillips Partnership, PC.

PROJECT

**Fairfield  
BY MARRIOTT  
INN & SUITES**  
DAWSONVILLE, GEORGIA

PROTOTYPE VERSION 2016  
REV 7.12.21-18

4 STORY, 92 UNITS  
w/ INDOOR POOL

**FAIRFIELD  
DAWSON FOREST ROAD  
DAWSONVILLE, GA  
30534**

CLIENT

**RIMROCK COMPANIES**  
10000 RIVERSIDE AVE  
SUITE 32201  
JACKSONVILLE, FL 32204

PHILLIPS JOB NUMBER 1972101

ISSUE DATE 08/23/2019

DRAWN BY/CHECKED BY AT/TK

DRAWING TITLE  
**FLOOR PLAN LEVEL 1 -  
POWER**

SHEET NUMBER

**E-1.1**

5901 PEACHTREE DUNWOODY RD.  
BUILDING A, SUITE 450  
ATLANTA, GEORGIA 30328  
PHILLIPS PART.COM 770-394-1816

GENERAL NOTES

REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATIONS OF ALL CEILING MOUNTED DEVICES.

ALL RECEPTACLES SHALL BE GROUNDED AS REQUIRED BY ARTICLE 250-146.

PROVIDE UNSWITCHED HOT LEG OF CIRCUIT TO EMERGENCY LIGHTING AND EXIT SIGNS.

LOCATE INTERCOM AT REGISTRATION DESK/RECEPTION AREA.

LOCATE DURESS ALARM AT REGISTRATION DESK.


ALL SWITCH AND RECEPTACLE DEVICES LOCATED IN THE LOBBY SHALL BE SIMILAR TO "DECORA" STYLE OR ACCEPTED SUBSTITUTION BY LISTED MANUFACTURERS. COLOR OF THE DEVICES AND COVER PLATES AS SPECIFIED IN THE PROJECT MANUAL MASTER SECTION 26 27 26.

REFER TO ENLARGED PLANS FOR ADDITIONAL GUESTROOM INFORMATION.

WHERE TELEPHONE OR TV OUTLETS ARE INDICATED AT THE SAME LOCATION AS A DUPLEX RECEPTACLE, THEY ARE TO BE IN A QUAD BOX WITH DIVIDER.

KEYNOTES

- TV AND ELECTRIC JUNCTION BOX LOCATED IN CEILING. PROVIDE ACCESS PANEL.
- CAMERAS SHOWN ARE REQUIRED FOR MANAGED SITES AND OPTIONAL FOR FRANCHISEES. LOCATE CAMERA (1) AT FRONT DESK, CAMERA (2) AT ENTRANCE OF STORAGE LOCATION FOR POSSE SERVER & CAMERA (3) AT SAFE. DIGITAL VIDEO RECORDER FOR SYSTEM TO BE SECURED IN LOCK BOX.
- IN FLOOR ELECTRICAL DUCT WITH ACCESS PANELS AT EACH FITNESS MACHINE (TYPICAL), AT EACH MACHINE, PROVIDE A CABLE OUTLET AND STANDARD ELECTRICAL DUPLEX RECEPTACLE FOR ATTACHED LCD SCREEN. AT ALL TREADMILLS PROVIDE AN ADDITIONAL 120V/60A DEDICATED CIRCUIT. ALL CONNECTION LOCATIONS TO BE COORDINATED WITH MACHINE PLACEMENT AND TO BE FLUSH MOUNTED.
- LOCATE HOUSE PHONES 12" FROM DOOR U.N.O., 44" AFF. HOUSE TELEPHONE LOCATION AND REQUIREMENTS TO BE COORDINATED WITH OWNER/ARCHITECT.
- INSTALL APPROVED MOBILE KEY CERTIFIED RFID LOCK SYSTEM WITH BLUETOOTH LOW ENERGY KEY READER. COORDINATE REQUIREMENTS WITH LOW VOLTAGE SUPPLIER. (TYPICAL).
- PROVIDE A TERMINATED DATA DROP (AT WAP) WITH A 25' COILED LOOP LEFT ABOVE THE CEILING FOR WIRELESS ACCESS POINT. DATA DROPS SHALL BE INSTALLED BACK TO THE NEAREST TECHNOLOGY CLOSET. FIELD COORDINATE WIRELESS ACCESS POINT LOCATIONS. A SITE SURVEY BY THE DATA COMMUNICATIONS CONTRACTOR MUST BE COMPLETED BEFORE FINAL INSTALLATION OF ACCESS POINTS.
- ROUTE (B) 2" FROM TELEPHONE UTILITY DEMARCATION POINT WITH FULL STRING. COORDINATE EXACT LOCATION WITH OWNER/LOW VOLTAGE CONSULTANT.
- POWER TO AUTOMATIC DOOR. CONNECT AS REQUIRED BY MANUFACTURER.
- POWER FOR HYDRATION STATION. FIELD COORDINATE LOCATION AND CONCEAL WITHIN THE MILLWORK.
- RECEPTACLE FOR POWER/USB PROVIDED BY MILLWORKER AND INSTALLED IN TABLE EDGE. ROUTE PLUG AND CORD THROUGH MILLWORK TABLE. RECEPTACLE TO BE "MINI-TAP" AS MANUF. BY BYRNE. 12' CORD THROUGH MILLWORK TO OUTLETS AT WALL; COLOR TO BE BLACK.
- POWER FOR FIRE SMOKE DAMPERS. SEE MECHANICAL DRAWINGS FOR ADDITIONAL REQUIREMENTS. TYPICAL.
- POWER FOR MOTORIZED DAMPER. SEE MECHANICAL DRAWINGS FOR ADDITIONAL REQUIREMENTS.
- POWER FOR EV CHARGERS. COORDINATE EXACT LOCATION WITH ARCHITECT/OWNER. COORDINATE EXACT ELECTRICAL REQUIREMENTS WITH EQUIPMENT INSTALLER.
- TO BE INSTALLED 6" BELOW COUNTER.
- PROVIDE CLOCK RECEPTACLE AND DATA OUTLET FOR SURVEILLANCE MONITOR.
- PROVIDE (1) 2" CONDUIT BACK TO COMPUTER/COMMUNICATION FOR ALL SYSTEMS.
- POP-UP TYPE DUPLEX RECEPTACLE INSTALLED INTO TOP OF MILLWORK WALL BEHIND BANQUETTE AND CENTERED ON METAL DIVIDERS. RECEPTACLE TO BE "GLENDENIGH CONTEMPORARY" AS MANUF. BY BYRNE. (2) 15 AMP DUPLEX RECEPTACLES FINISH TO BE "MIDNIGHT BLACK" HARDWIRED.

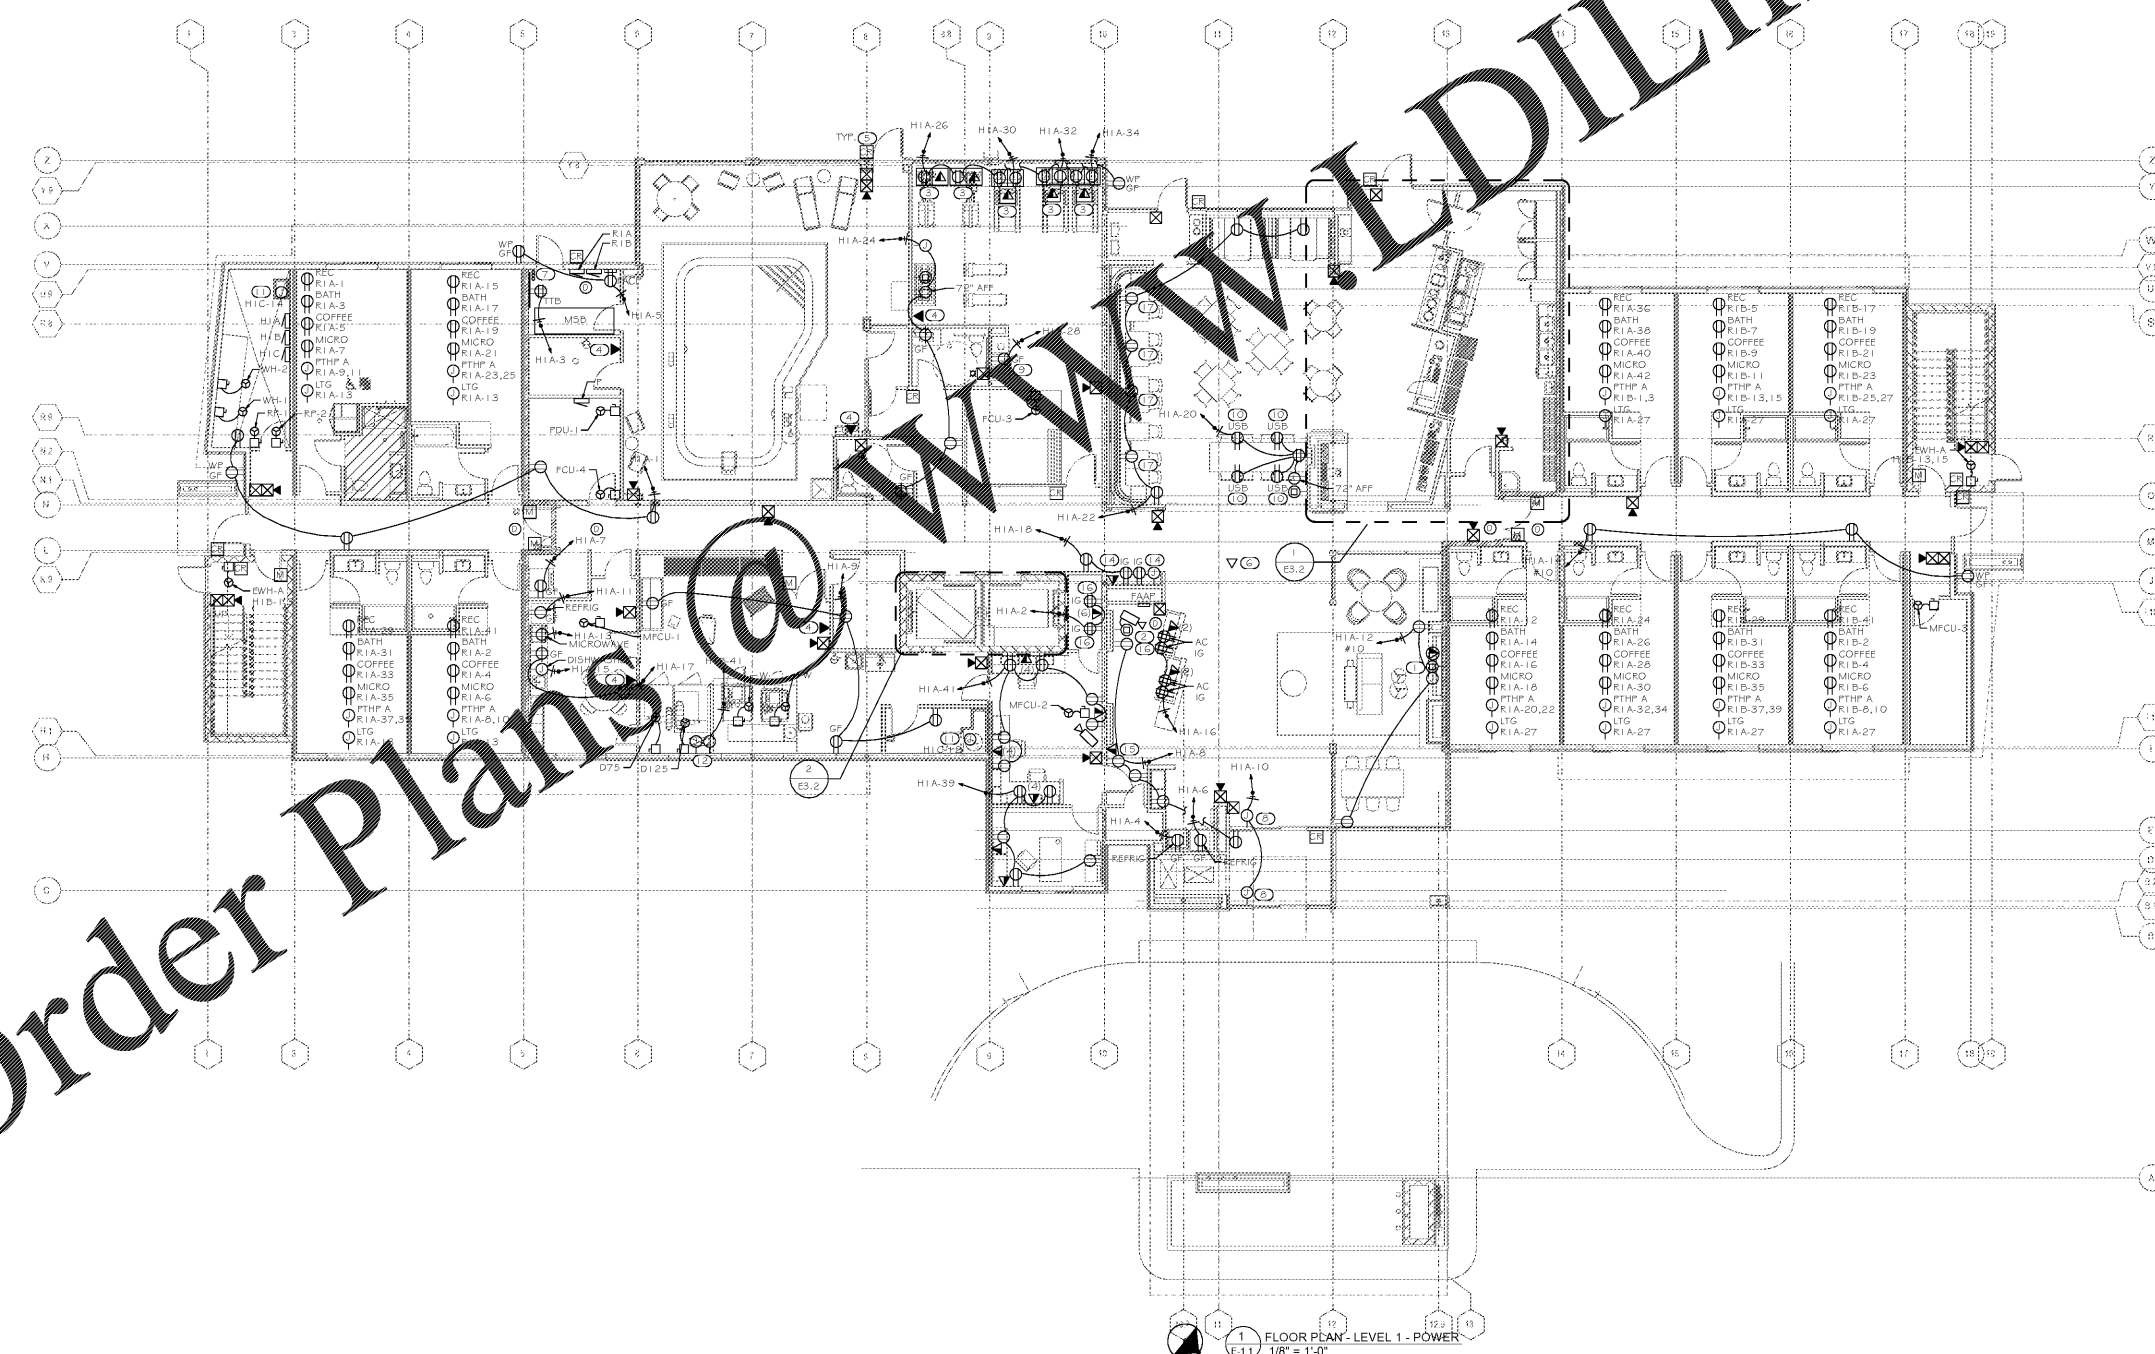

Order Plans @

1 FLOOR PLAN - LEVEL 1 - POWER  
E-1.1  
1/8" = 1'-0"