GENERAL NOTES

ALL RECEPTACLES SHALL BE GROUNDED AS REQUIRED BY ARTICLE 250-146.

REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION OF HVAC EQUIPMENT.

KEYNOTES

(1) PROVIDE WEATHERPROOF GFCI RATED TOMBSTONE RECEPTACLE.

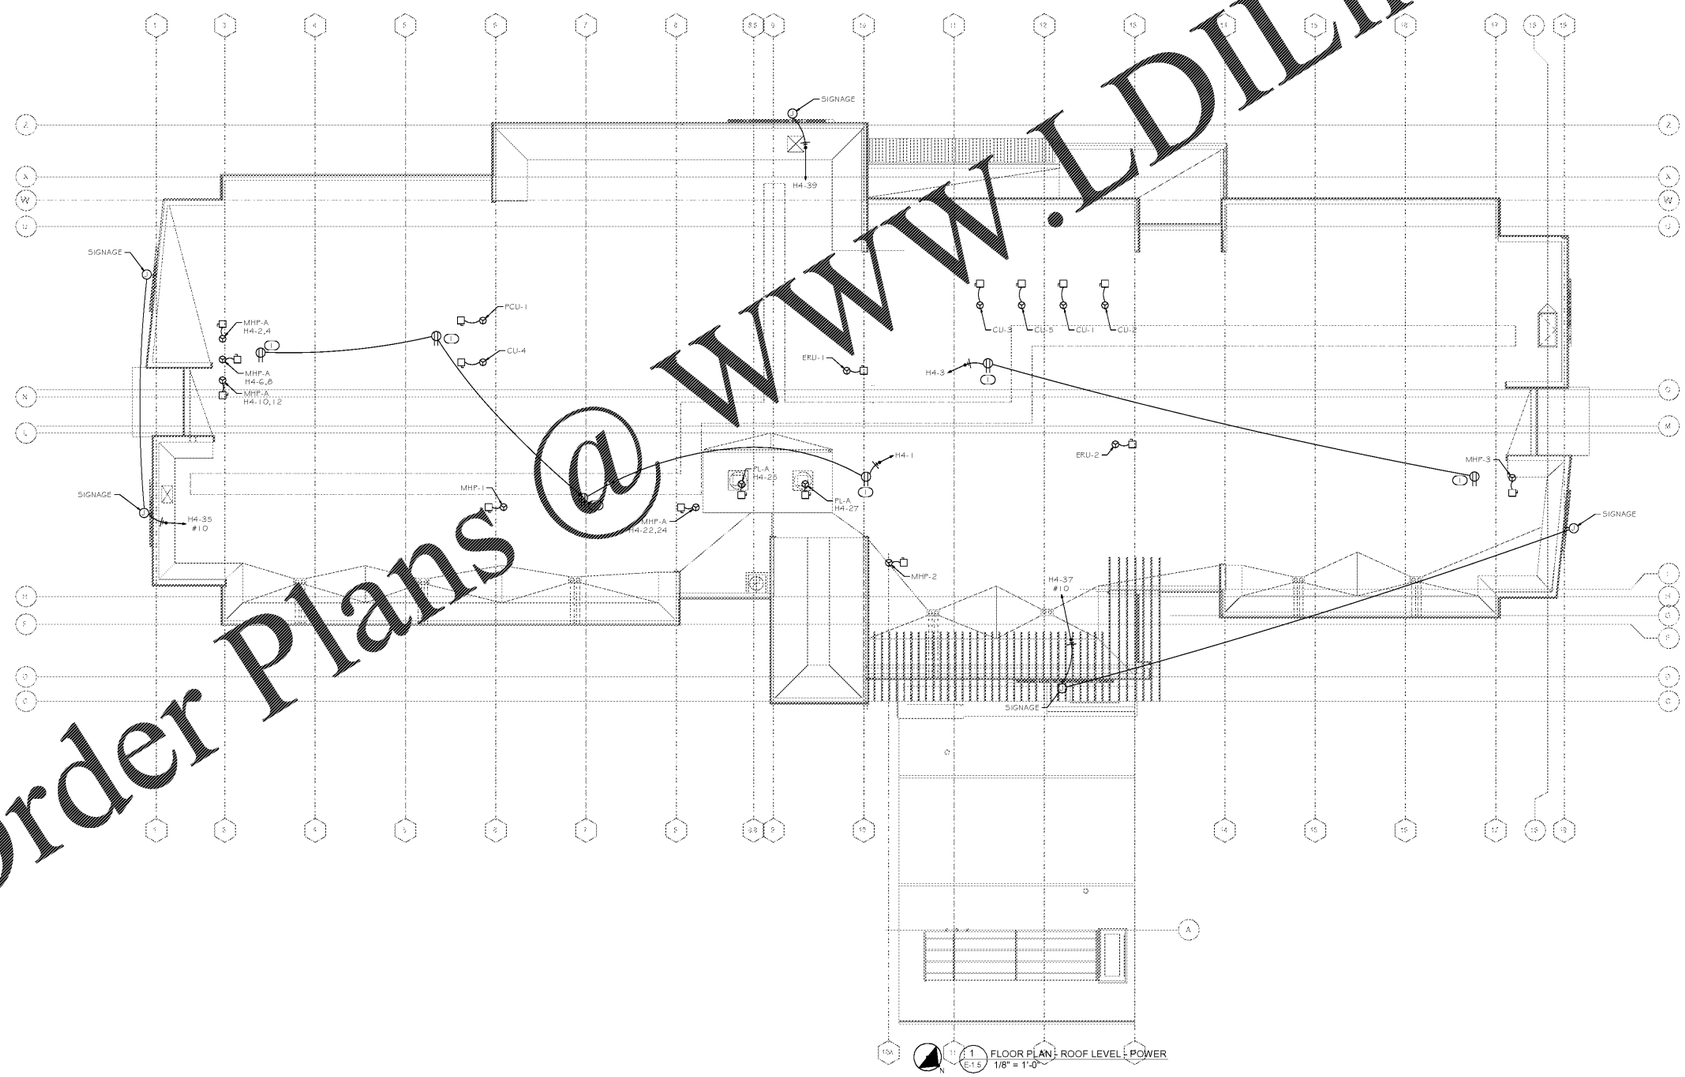

1 FLOOR PLAN - ROOF LEVEL - POWER
E-1.5 1/8" = 1'-0"

Order Plans @ WWW.LDILine.com

PHILLIPS

KEYPLAN

CONSULTANT

PROFICIENT ENGINEERING
6991 Peachtree Industrial Blvd Building 700
Peachtree Corners, Georgia 30092
404.330.9798
PROJECT # 119288

SEAL

GEORGIA REGISTERED PROFESSIONAL ENGINEER BRIAN M. ARMENTA

ISSUE & REVISION RECORD

#	DATE	DESCRIPTION
	06.10.2019	30% DESIGN REVIEW SET
	08.16.2019	90% REVIEW SET
	08.23.2019	PERMIT SET

This document is ©Phillips Partnership, PC and is considered an Instrument of Service and is solely for use with respect to the project as indicated below. All rights reserved. This document may not be reproduced without the prior written consent of Phillips Partnership, PC

PROJECT

Fairfield BY MARRIOTT INN & SUITES

DAWSONVILLE, GEORGIA

PROTOTYPE VERSION 2016
REV 7 12-21-18

4 STORY, 92 UNITS
w/INDOOR POOL

FAIRFIELD
DAWASON FOREST ROAD
DAWSONVILLE, GA
30534

CLIENT

RIMROCK COMPANIES
10000 RIVERSIDE AVE
SUITE 32201
JACKSONVILLE, FL 32204

PHILLIPS JOB NUMBER: 1072101

ISSUE DATE: 08/23/2019

DRAWN BY/CHECKED BY: AT/RK

DRAWING TITLE: FLOOR PLAN ROOF LEVEL - POWER

SHEET NUMBER

E-1.5

5901 PEACHTREE DUNWOODY RD.
BUILDING A, SUITE 450
ATLANTA, GEORGIA 30328
PHILLIPSPART.COM 770-394-1616