

PHILLIPS

KEYPLAN

CONSULTANT



PROFICIENT ENGINEERING
6501 Peachtree Industrial Blvd Building 700
Peachtree Corners, Georgia 30092
404.330.9750
PROJECT # 119288

SEAL



ISSUE & REVISION RECORD

#	DATE	DESCRIPTION
06	10/2019	30% DESIGN REVIEW SET
08	15/2019	90% REVIEW SET
08	23/2019	PERMIT SET

This document is ©Phillips Partnership, PC and is considered an Instrument of Service and is solely for use with respect to the project as indicated herein. All rights reserved. This document may not be reproduced without the prior written consent of Phillips Partnership, PC.

PROJECT

**Fairfield
BY MARRIOTT
INN & SUITES**
DAWSONVILLE, GEORGIA

PROTOTYPE VERSION 2016
REV 7.12.21.18

4 STORY, 92 UNITS
w/ INDOOR POOL

FAIRFIELD
DAWSON FOREST ROAD
DAWSONVILLE, GA
30534

CLIENT

RIMROCK COMPANIES
10000 RIVERSIDE AVE
SUITE 32201
JACKSONVILLE, FL 32204

PHILLIPS JOB NUMBER 1972101

ISSUE DATE 08/23/2019

DRAWN BY/CHECKED BY AT/RK

DRAWING TITLE
FLOOR PLAN LEVEL 1 -
LIGHTING

SHEET NUMBER

E-2.1

5901 PEACHTREE DUNWOODY RD.
BUILDING A, SUITE 450
ATLANTA, GEORGIA 30328
PHILLIPSPART.COM 770-394-1816

GENERAL NOTES


REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATIONS OF ALL CEILING MOUNTED DEVICES.
PROVIDE UNSWITCHED HOT LEG OF CIRCUIT TO EMERGENCY LIGHTING AND EXIT SIGNS.
ALL SWITCH AND RECEPTACLE DEVICES LOCATED IN THE LOBBY SHALL BE SIMILAR TO "DECORA" STYLE, OR ACCEPTED SUBSTITUTION BY LISTED MANUFACTURERS. COLOR OF THE DEVICES AND COVER PLATES AS SPECIFIED IN THE PROJECT MANUAL MASTER SECTION 26 27 26.
EXTERIOR FIXTURES TO BE CONTROLLED BY LIGHTING CONTACTOR WITH PHOTOCELL AND TIMER.
LIGHTS THROUGHOUT LOBBY AND PUBLIC SPACE AREAS TO BE DIMMABLE. COORDINATE LOCATION OF LIGHTING CONTROL WITH OWNER/ARCHITECT.
REFER TO ENLARGED PLANS FOR ADDITIONAL GUESTROOM INFORMATION.

KEYNOTES

- 1) PROVIDE KEYSWITCH FOR LOCAL LIGHT SWITCH. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH OWNER/ARCHITECT.
- 2) DIMMING CONTROL PANEL. FIELD COORDINATE EXACT LOCATION WITH OWNER.
- 3) TOUCHSCREEN MASTER STATION LOCATION. FIELD COORDINATE EXACT LOCATION WITH OWNER.
- 4) CONTROL CIRCUIT INDICATED BY LOWER CASE LETTER BELOW FIXTURE. CIRCUITS TO BE DIMMED ARE AS FOLLOWS: a, b, c, d, e, f, g, h, i, j, k. COORDINATE EXACT CONTROLS WITH LIGHTING CONSULTANT/OWNER. (TYPICAL).
- 5) CONTROLS REQUIRED FOR DIMMING LIGHTS TO 50% WHEN FITNESS ROOMS UNOCCUPIED. QUANTITY AND LOCATION TO BE CONFIRMED BY CONTRACTOR. CONTROLS ALSO ENABLE DAYLIGHT HARVESTING FOR THIS ROOM. LIGHTING CONTROLS FOR THE FITNESS ROOM ARE SEPARATE FROM THE MAIN LIGHTING CONTROL SYSTEM.
- 6) PROVIDE POWER FOR COVE LIGHTING. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH OWNER/ARCHITECT.
- 7) PROVIDE WEATHERPROOF JUNCTION BOX FOR EXTERIOR COVE LIGHTING. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH OWNER/ARCHITECT PRIOR TO ROUGH-IN.

Order Plans

WWW.DILine.com

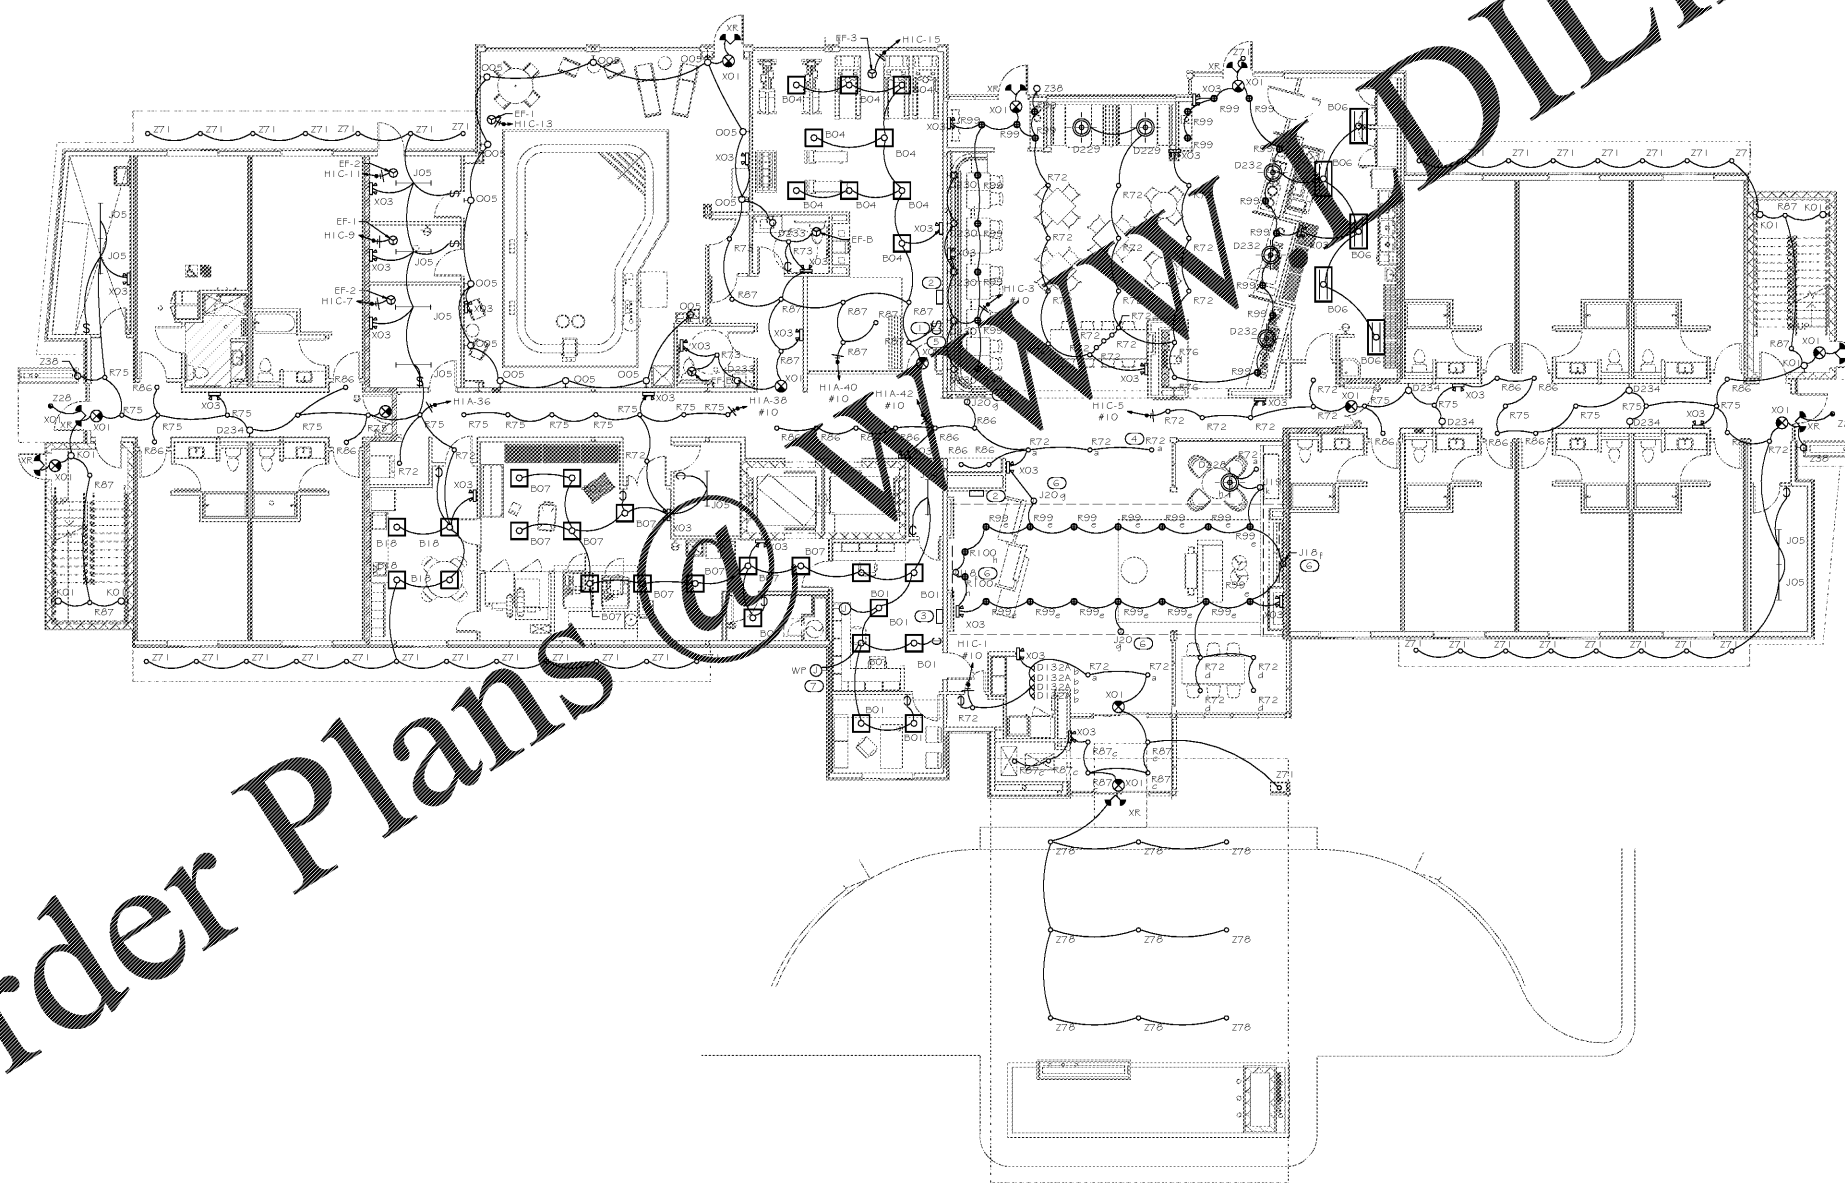

1 FLOOR PLAN - LEVEL 1 - LIGHTING
E-2.1 1/8" = 1'-0"