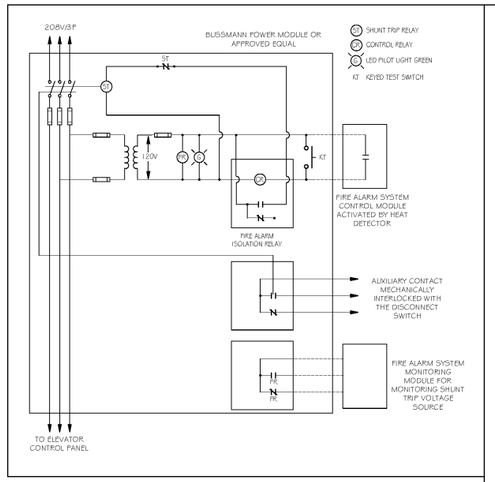

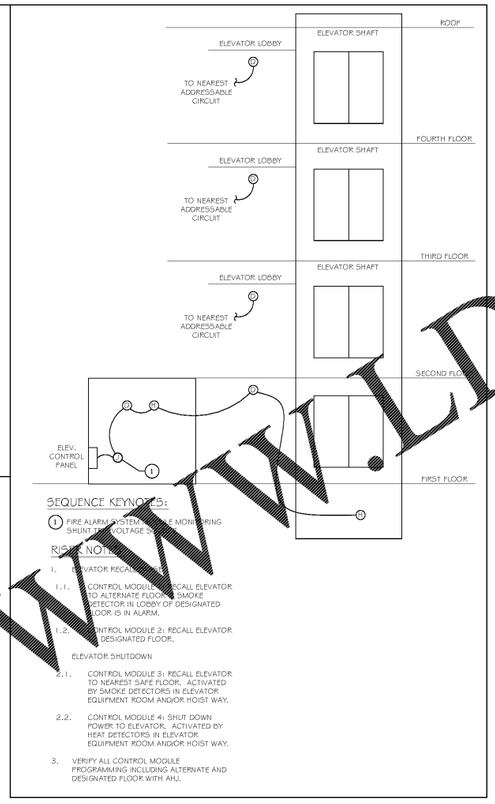

SEQUENCE KEYNOTES:

1. FIRE ALARM SYSTEM [illegible] MONITORING SHUNT TRIP VOLTAGE SOURCE.

RISER NOTES:

1. ELEVATOR RECALL
   - 1.1. CONTROL MODULE 1: RECALL ELEVATOR TO ALTERNATE FLOOR IF SMOKE DETECTOR IN LOBBY OF DESIGNATED FLOOR IS IN ALARM.
   - 1.2. CONTROL MODULE 2: RECALL ELEVATOR TO DESIGNATED FLOOR.

   ELEVATOR SHUTDOWN
   - 2.1. CONTROL MODULE 3: RECALL ELEVATOR TO NEAREST SAFE FLOOR. ACTIVATED BY SMOKE DETECTORS IN ELEVATOR EQUIPMENT ROOM AND/OR HOIST WAY.
   - 2.2. CONTROL MODULE 4: SHUT DOWN POWER TO ELEVATOR. ACTIVATED BY HEAT DETECTORS IN ELEVATOR EQUIPMENT ROOM AND/OR HOIST WAY.
3. VERIFY ALL CONTROL MODULE PROGRAMMING INCLUDING ALTERNATE AND DESIGNATED FLOOR WITH AHJ.

GENERAL NOTES

ALL RECEPTACLES SHALL BE GROUNDED AS REQUIRED BY [illegible] 250-[illegible].

FOR ALL KITCHEN EQUIPMENT, SEE EQUIPMENT SCHEDULE ON [illegible] FOR ELECTRICAL CONNECTION INFORMATION AND OTHER REQUIREMENTS. INFORMATION ON APPLIANCE CONNECTION LOCATION TO BE COORDINATED WITH THE ACTUAL EQUIPMENT INSTALLED. REFER TO ARCHITECTURAL DOCUMENTS FOR MOUNTING HEIGHT AND DIMENSIONS. COORDINATE EXACT REQUIREMENTS WITH KITCHEN EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.

ALL 120VAC RECEPTACLES IN KITCHEN AND FOOD PREP AREAS SHALL BE GFI PER NEC 210.8(B)(6). GFCI MUST BE READILY ACCESSIBLE FOR TESTING. FOR RECEPTACLES OBSTRUCTED FROM ACCESSIBLE EQUIPMENT, ACCEPTABLE ALTERNATIVES TO A GFCI RECEPTACLE ARE REMOTE TEST BUTTONS, GFCI BREAKERS, OR GFCI RECEPTACLES UPSTREAM OF THE SAME CIRCUIT. COUNTER EQUIPMENT AND EQUIPMENT ON CASTERS OR STANDS THAT CAN BE MOVED EASILY ARE DEEMED TO PROVIDE READY ACCESS.

KEYNOTES

1. LOCATE HOUSE PHONES 12" FROM DOOR U.N.O., 44" AFF. HOUSE TELEPHONE LOCATION AND REQUIREMENTS TO BE COORDINATED WITH OWNER/ARCHITECT.

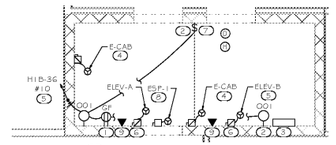

2 / E-3.2 ENLARGED ELEVATOR - ELECTRICAL
1/4" = 1'-0"

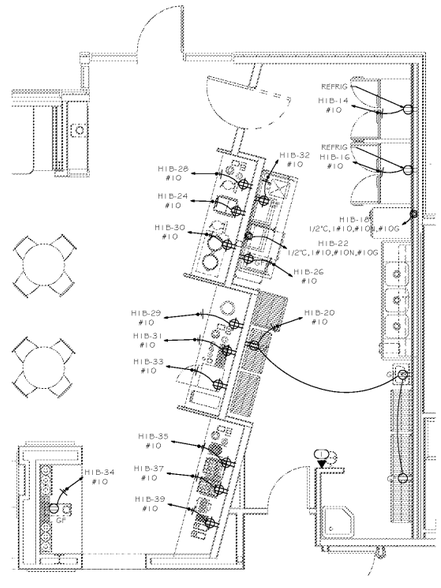

1 / E-3.2 ENLARGED KITCHEN - POWER
1/4" = 1'-0"

ELEVATOR KEYNOTES

1. GFCI DUPLEX RECEPTACLE. PROVIDE ONE AT THE PIT AND ANOTHER AT THE TOP OF THE SHAFT.
2. LIGHTING SHALL NOT BE CONNECTED TO LOAD SIDE OF GFCI RECEPTACLE. PROVIDE LIGHTING FIXTURES AT THE PIT AND AT THE TOP OF THE SHAFT.
3. ELEVATOR CONTROL PANEL
4. 30A/1P/NEMA I DISCONNECT SWITCH WITH 20 AMP FUSE FOR ELEVATOR CAB LIGHTING AND FAN.
5. 3P, 208VAC 20HP ELEVATOR MOTOR. COORDINATE WITH ELEVATOR MANUFACTURER EXACT MODEL AND FINAL RECOMMENDED FUSE SIZE. COORDINATE EXACT LOCATION IN FIELD.
6. 100A/3P/NEMA 3R EQUIPMENT DISCONNECT SWITCH AND 80 AMP FUSE FOR ELEVATOR MOTOR. COORDINATE WITH ELEVATOR MANUFACTURER FOR FINAL RECOMMENDED FUSE SIZE.
7. PROVIDE LIGHT SWITCHES AT PIT LEVEL AND AT TOP OF THE SHAFT. EACH SWITCH SHALL CONTROL EACH RESPECTIVE LIGHT FIXTURE.
8. POWER FOR SUMP PUMP. SEE PLUMBING DRAWINGS FOR ADDITIONAL REQUIREMENTS.
9. ELEVATOR PHONE. COORDINATE EXACT LOCATION WITH ELEVATOR INSTALLER.

ELEVATOR GENERAL NOTES

ALL ELECTRICAL DEVICES, FOR THEIR SIZES AND LOCATIONS, ASSOCIATED WITH ELEVATOR EQUIPMENT SHALL BE COORDINATED WITH ELEVATOR MANUFACTURER PRIOR TO INSTALLATION.

CONTRACTOR SHALL PROVIDE ALL LIGHTS, DISCONNECTS AND CONNECTIONS AS REQUIRED BY ELEVATOR MANUFACTURER FOR ELEVATOR EQUIPMENT INSTALLATION.

CONTRACTOR SHALL COORDINATE ALL FINAL VOLTAGE, AMPACITY AND PHASE REQUIREMENTS WITH THE ELEVATOR MANUFACTURER.

ELEVATOR EQUIPMENT SCHEDULE

CALLOUT	SYMBOL	VOLTS	KVA	BREAKER	CIRCUIT	WIRE CALLOUT	DISCONNECT DESCRIPTION
E-CAB		120V 1P 2W	1.2	20/1	H1B-42	1/2"C, 1#12, #12N, #12G	30A/1P/NEMA 1
E-CAB		120V 1P 2W	1.2	20/1	H1B-38	1/2"C, 1#12, #12N, #12G	30A/1P/NEMA 1
ELEV-A		208V 3P 4W	22.45	80/3	M5B-7	1-1/4"C, 3#2, #2N, #8G	100/3/NEMA 1/80A
ELEV-B		208V 3P 4W	22.45	80/3	M5B-8	1-1/4"C, 3#2, #2N, #8G	100/3/NEMA 1/80A
ESP-1		120V 1P 2W	1.92	20/1	H1B-40	1/2"C, 1#12, #12N, #12G	30A/1P/NEMA 1

Order Plans @ WWW.LDLine.com

PHILLIPS

KEYPLAN

CONSULTANT

PROFICIENT ENGINEERING
6691 Peachtree Industrial Blvd Building 700
Peachtree Corners, Georgia 30092
404.330.9798
PROJECT # 119288

SEAL

GEORGIA REGISTERED PROFESSIONAL ENGINEER BRIAN M. ARMENTA

ISSUE & REVISION RECORD

#	DATE	DESCRIPTION
	08.10.2019	30% DESIGN REVIEW SET
	08.16.2019	90% REVIEW SET
	08.23.2019	PERMIT SET

This document is ©Phillips Partnership, PC and is considered an Instrument of Service and is solely for use with respect to the project as indicated below. All rights reserved. This document may not be reproduced without the prior written consent of Phillips Partnership, PC.

PROJECT

Fairfield BY MARRIOTT INN & SUITES

DAWSONVILLE, GEORGIA

PROTOTYPE VERSION 2016
REV 7 12-21-18

4 STORY, 92 UNITS
w/ INDOOR POOL

FAIRFIELD
DAWSON FOREST ROAD
DAWSONVILLE, GA
30534

CLIENT

RIMROCK COMPANIES
10000 RIVERSIDE AVE
SUITE 32201
JACKSONVILLE, FL 32204

PHILLIPS JOB NUMBER 1972101

ISSUE DATE 08/23/2019

DRAWN BY/CHECKED BY AT/RK

DRAWING TITLE
FOOD PREP AND ELEVATOR

SHEET NUMBER
E-3.2

5901 PEACHTREE DUNWOODY RD.
BUILDING A, SUITE 450
ATLANTA, GEORGIA 30328
PHILLIPSPART.COM 770-394-1616