


- NOTES: (AS INDICATED ON THIS PLAN BY A NUMBER IN A ○)
- MECHANICAL CONTRACTOR TO PROVIDE AND LOCATE CONDENSATE PUMP AT AHU UNIT. HARD WIRE PUMP TO CIRCUIT INDICATED - SWITCH AT AHU UNIT WILL BE DISCONNECT FOR PUMP.
 - CEILING FAN PROVIDED BY OWNER. E.C. WILL INSTALL JUNCTION BOX FOR POWER TO FAN FLUSH IN CEILING AND INSTALL OWNER PROVIDED FAN. TYPICAL - 1 OF 3.
 - PENDANT LIGHT PROVIDED BY OWNER. E.C. WILL INSTALL JUNCTION BOX FOR POWER TO LIGHT FLUSH IN CEILING AND INSTALL OWNER PROVIDED LIGHT FIXTURE. TYPICAL - 1 OF 5.
 - POWER PACK MAY NOT BE INSTALLED OVER GYPSUM BOARD CEILING. MOUNT IN BOX AS HIGH AS POSSIBLE ON WALL AND PAINT BOX TO MATCH WALL COLOR. RUN LOW VOLTAGE WIRING TO OCCUPANCY SENSORS ABOVE GYPSUM BOARD CEILING IN CONDUIT.
 - COMBINATION EXIT SIGN/BATTERY LIGHTS AND BATTERY LIGHTS WILL BE CONNECTED TO THE UNSWITCHED LEG OF THE LIGHTING CIRCUIT IN THE ROOM. (TYPICAL)
 - INSTALL RECEPTACLE IN EXISTING JUNCTION BOX AND REUSE EXISTING CONDUIT FOR WIRING.
 - POWER TO ELECTRIC HEAT FOR BACKFLOW AT STREET. REFER TO CIVIL DRAWINGS FOR LOCATION.

ELECTRICAL DISCONNECT SCHEDULE - YARD OFFICE

UNIT	POWER V/P/PH	MCA	MOPD MOPC	WATTS	DISCONNECT
AHU-1	115/1/60	11.9	20	-	FACTORY MOUNTED DISCONNECT
HP-1	208/3/60	37.3	60	-	60A HD DISCONNECT FUSED AT 60A, NEMA 3R, BY E.C.
EF-1, 2, 3, 4, 5	115/1/60	-	-	80 W	FACTORY MOUNTED DISCONNECT

1 YARD OFFICE- POWER PLAN
SCALE: 1/4" = 1'-0"
SCALE: 1/4" = 1'

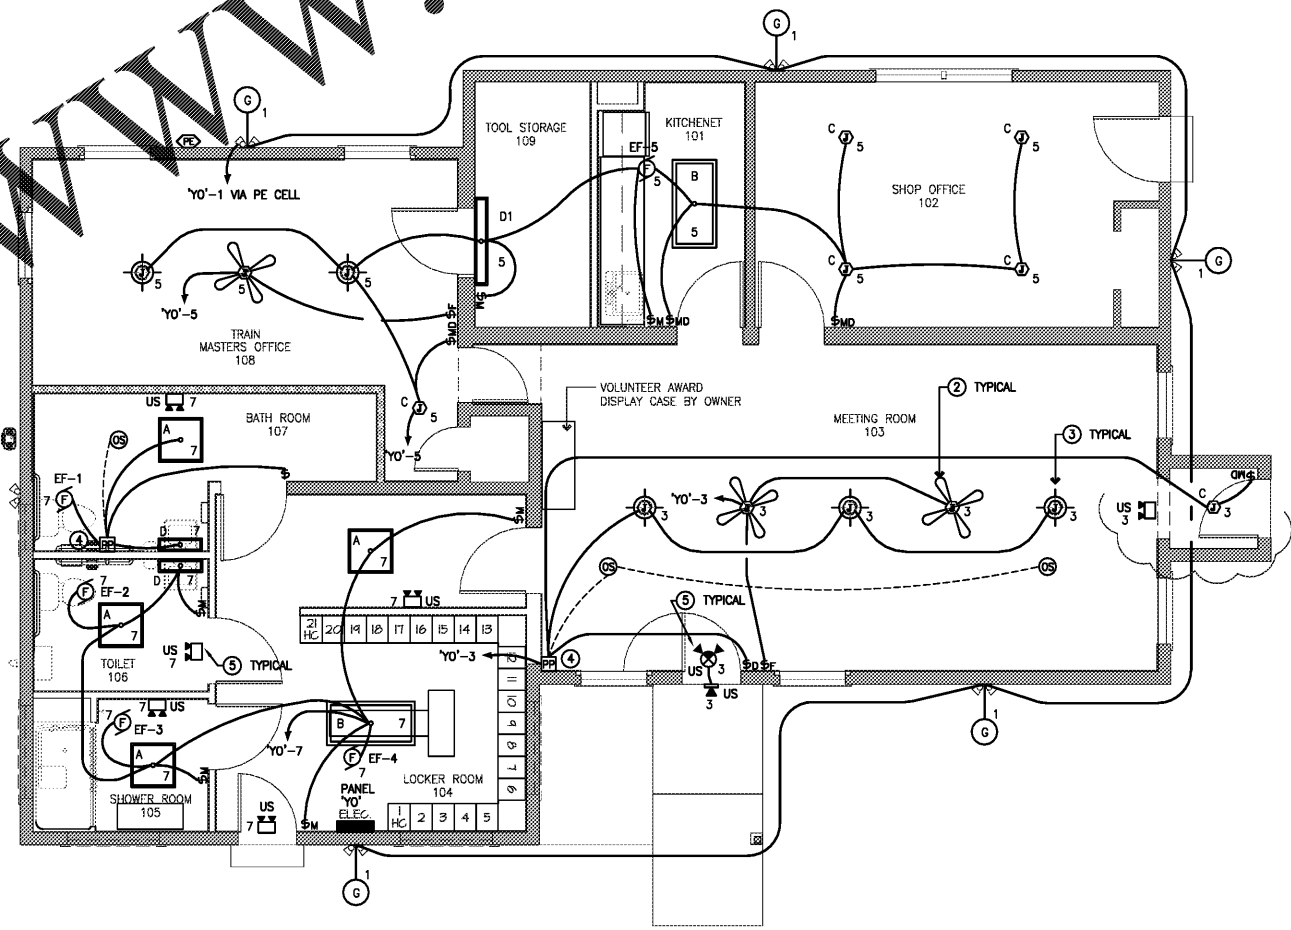

2 YARD OFFICE- LIGHTING PLAN
SCALE: 1/4" = 1'-0"
SCALE: 1/4" = 1'

Order Plans @

WWW.DOWNLOADING.COM

**YARD OFFICE
ELECTRICAL
PLANS**

**POWER PLAN
LIGHTING PLAN**

2198 East Holly Grove Road
P.O. Box 1256
Lexington, N.C. 27293
Design Engineering, Inc. 336/224-0100
336/224-0099 (fax)

**HISTORIC
SPENCER
SHOPS
YARD OFFICE**

