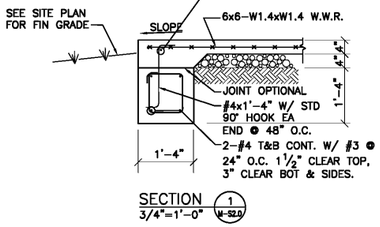


SECTION 1 — 3/4"=1'–0" (M-S2.0)

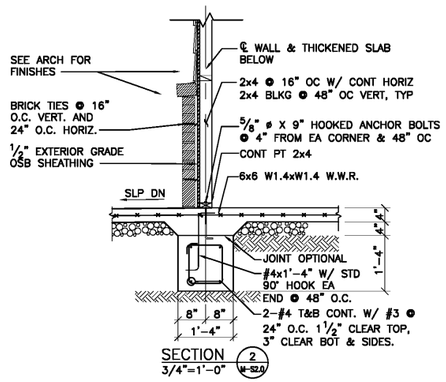


SECTION 2 — 3/4"=1'–0" (M-S2.0)

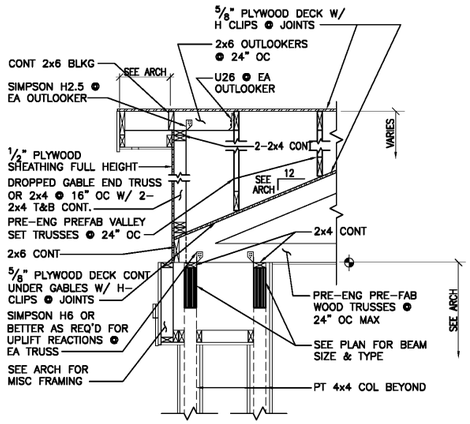


SECTION 3 — 3/4"=1'–0" (M-S2.0)

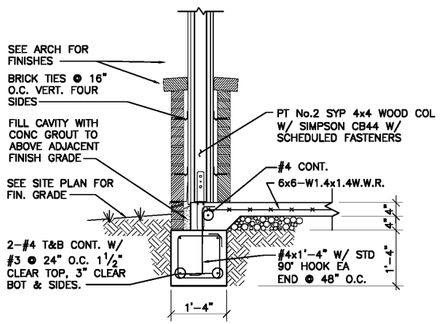


DETAIL A — 3/4"=1'–0" (M-S2.0)

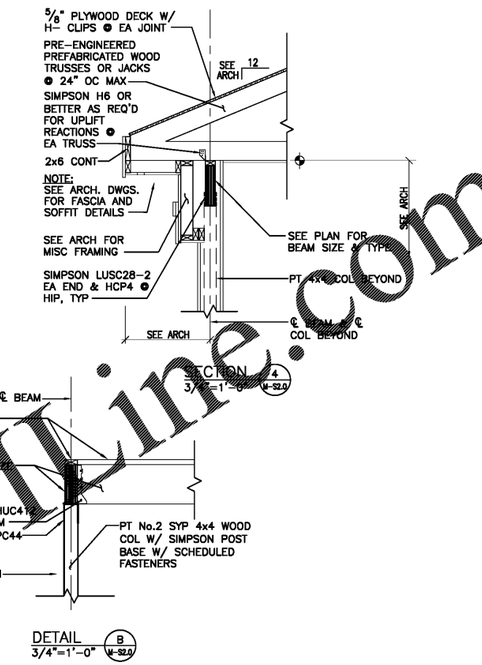


DETAIL B — 3/4"=1'–0" (M-S2.0)

**NOTES:**

1. TOP & BOTTOM CHORDS OF TRUSSES SHALL BE 2x6 MIN.
2. PROVIDE PANEL POINTS IN TRUSSES @ 8'–0"O.C. MAX. & PANEL POINTS IN HIP JACKS & GIRDER TRUSSES @ 6'–0"O.C. MAX.
3. COORDINATE ALL TRUSS DIAGRAMS W/ ARCH. DRAWINGS.
4. COORDINATE TRUSS PANEL POINTS WITH MECHANICAL DUCT WORK. SEE MECHANICAL DRAWINGS.
5. DESIGN SPECIAL TRUSSES WHERE MECHANICAL DUCT WORK REQUIRES SEPARATION OF TRUSSES (3'O.C. MAX.)
6. PROVIDE 2x6 BLOCKING @ 24"O.C. MAX. BETWEEN TOP & BOTTOM CHORD OF TRUSSES WHERE TRUSSES ARE SEPARATED.
7. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION ALL TRUSS PROFILES AND DIMENSIONS WITH ARCHITECTURAL, MECHANICAL, AND OTHER DRAWINGS

PROVIDE CONTINUOUS 2x6 BLOCKING AT ALL HIPS, RIDGES, VALLEYS, CHANGES IN DECK DIRECTION, AND ALL OTHER UNSUPPORTED DECK EDGE CONDITIONS BETWEEN TRUSSES OR OTHER FRAMING WITH 2–16d EACH END, TYPICAL

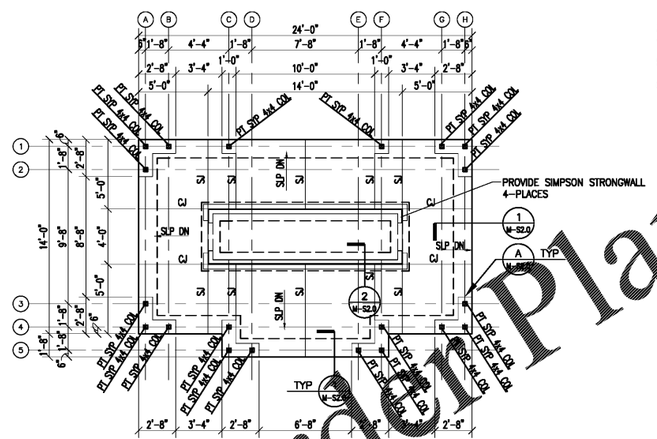


**FLOOR CONSTRUCTION**
4" CONCRETE SLAB W/ 6x6–W1.4x W1.4 W.W.R. OVER VAPOR BARRIER OVER 4" POROUS FILL.
FINISH FLOOR ELEVATION = 0'–0"

STEP FOOTING AS REQUIRED TO MAINTAIN DEPTHS PER GEOTECHNICAL REPORT PER SITE PLAN FINISH GRADES, BUT NOT LESS THAN 12" COVER BELOW GRADE, TYP.

**NOTE: CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND COORDINATE BUILDING FINISHES AND LOCATIONS WITH ARCHITECTURAL DRAWINGS.**

1. PROVIDE FOOTING STEPS AS REQUIRED BY FINISHED GRADES. SEE M–S1.0 FOR TYPICAL DETAIL.
2. SLOPE SLABS TO DRAINS AND DEPRESS AS REQUIRED– SEE ARCH.
3. SEE M–S1.0 FOR SJ & CJ DETAILS.

## 1 FOUNDATION PLAN
SCALE: 1/4"=1'-0"

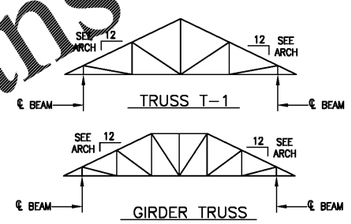


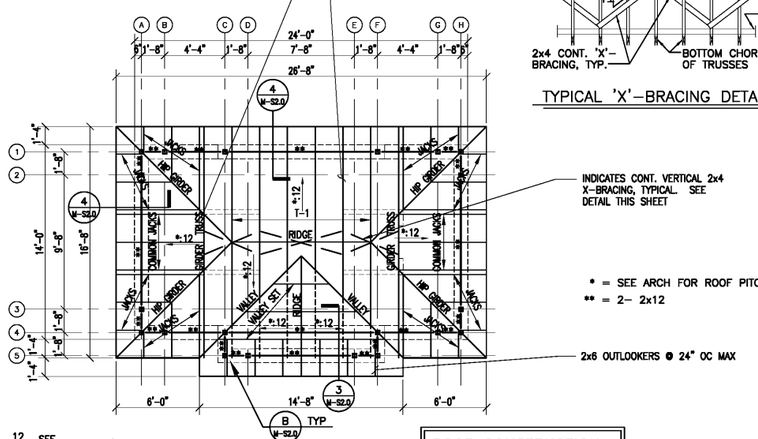


## 2 ROOF FRAMING PLAN
SCALE: 1/4"= 1'-0"

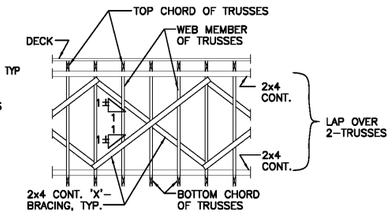


TYPICAL 'X'–BRACING DETAIL

ANCHOR SHEATHING TO GIRDER TRUSS TYP – PROVIDE 2x4 BLKG AS REQ'D

PRE–ENG PREFAB WOOD TRUSSES @ 24" OC W/ HORIZ BRIDGING PER BLDG MFR

**ROOF CONSTRUCTION**
5/8" THICK APA RATED PLYWOOD DECK, EXPOSURE 1, WITH PANEL IDENTIFICATION INDEX OF 40/20 OVER PRE–ENGINEERED PREFAB–RICATED WOOD TRUSSES & JACKS @ 24"O.C. MAX., OR CLOSER SPACING IF/AS REQUIRED BY TRUSS DESIGN ENGINEER.

NOTE: MAXIMUM DEFLECTIONS FOR ALL TRUSSES SHALL BE:
DEAD PLUS LIVE-----L/240
LIVE LOAD ONLY-----L/360


AUBURN STRUCTURAL DESIGN, INC.
ROY H. MAYO, JR. P.E.
2008 JANABROOKE LN
AUBURN, AL 36830
(334) 826-9040
engineer@austructure.com/
www.austructure.com



Pate Design Group, Inc.
Architecture / Interiors
4168 Abbotts Bridge Road
Duluth, Georgia 30097
(p) 770.814.0885
(f) 770.814.0886
Kirby@patedesigngroup.com


MAIL KIOSK
WISTERIA RIDGE
Will–O–War LLC
75 North Main Street
Watkinsville, GA 30677

Issue & Revisions:

| No. | Date | Description |
|---|---|---|
| 1 | 04.01.19 | CLARIFICATION |

**FOUNDATION + ROOF FRAMING PLANS AND SECTNS + DTLS**

Drawn: CKT
Checked: RHM
Contract No.: 07-03
Scale: AS NOTED

REGISTERED PROFESSIONAL ENGINEER — RICHARD HOWARD MAYO

**M-S2.0**
040119 of sheets


THIS DRAWING IS THE PROPERTY OF PATE DESIGN GROUP AND IS NOT TO BE COPIED IN WHOLE OR IN PART. IT IS TO BE USED FOR THE PROJECT AND SITE SPECIFICALLY DESIGNED HEREIN AND IS NOT TO BE USED IN ANY OTHER PROJECT. IT IS TO BE RETURNED UPON REQUEST.


RELEASED FOR CONSTRUCTION


Order Plans @ WWW.LDRline.com