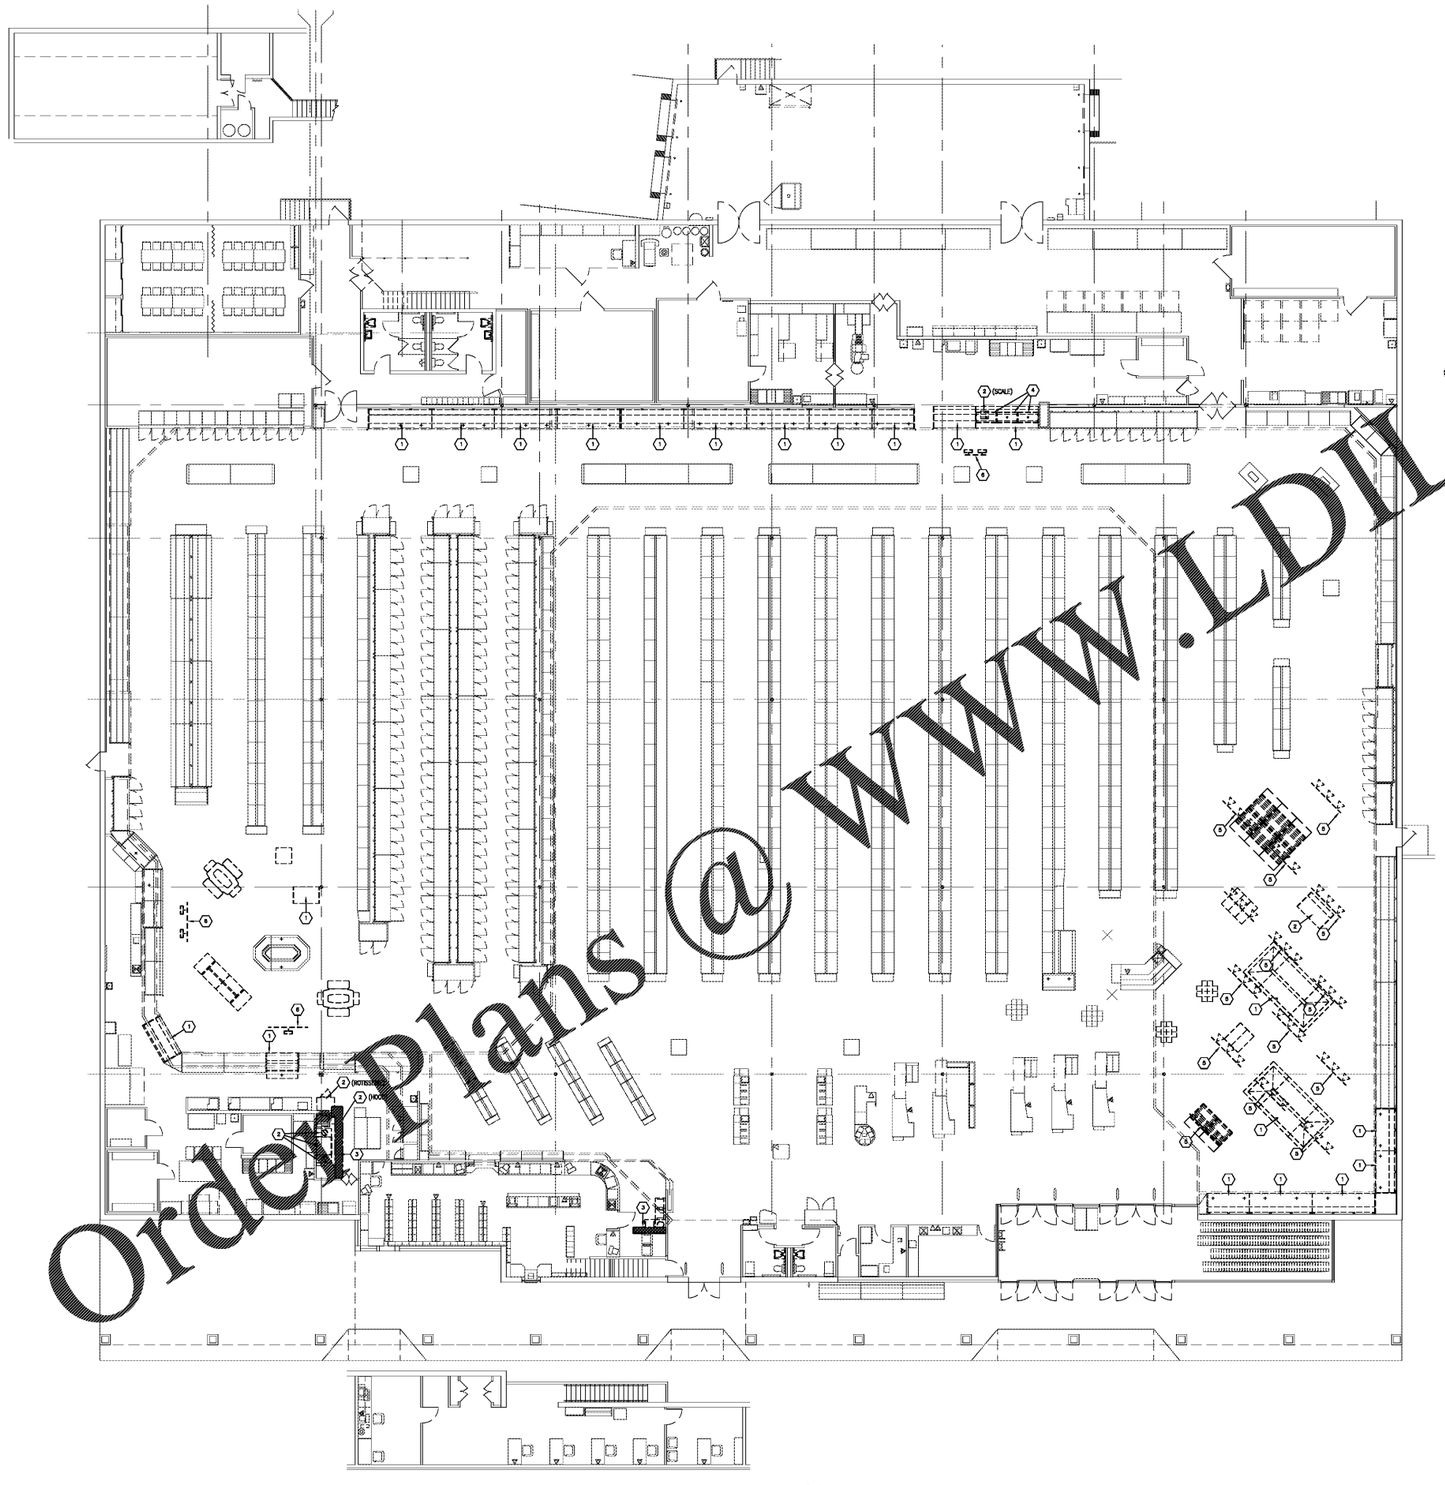

1 ED1.1 ELECTRICAL DEMOLITION PLAN
3/32" = 1'-0"

ELECTRICAL DEMOLITION NOTES (TYPICAL)

A. THE CONTRACTOR SHALL VISIT THE SITE AND INSPECT THE ELECTRICAL SYSTEMS PRIOR TO BID. DEMOLITION OF ELECTRICAL WORK SHALL FOLLOW THE ARCHITECTURAL WORK.
B. REMOVE ALL ELECTRICAL DEVICES, CONDUIT AND WIRE FROM WALLS TO BE REMOVED AND ON WALLS WHERE NEW CONSTRUCTION CONFLICTS WITH EXISTING DEVICES IN THE REMODELED AREA.
C. PROVIDE NEW TYPED PANEL DIRECTORIES FOR ALL PANELS ASSOCIATED WITH THIS WORK. SHOW EQUIPMENT NAMES AS INDICATED ON OWNERS DRAWINGS. PROVIDE DATE AT TOP OF DIRECTORY.
D. CHASE AND PATCH EXISTING WALLS TO ABOVE SUSPENDED CEILING AS REQUIRED WHERE NEW DEVICES ARE INDICATED SUCH THAT DEVICES WILL BE FLUSH WITH WALL FINISH.
E. THE CONTRACTOR SHALL VERIFY THE CONDITION OF THE EXISTING DEVICES IN AREAS OF NEW WORK, DEVICES THAT ARE IN NEED OF REPLACEMENT SHALL BE REMOVED.
F. ALL FIXTURES CALLED FOR REMOVAL SHALL BE DISCARDED BY THIS CONTRACTOR, UNLESS NOTED OTHERWISE.
G. REMOVE WIRE BACK TO SOURCE AND LABEL BREAKERS AS "SPARE" FOR ALL CIRCUITS THAT ARE NOT REUSED AND ARE INDICATED HERE TO BE REMOVED. COORDINATE WITH NEW WORK PLANS FOR REUSED CIRCUITS.

ELECTRICAL DEMOLITION NOTES (SPECIFIC)

1. REFRIGERATED CASE TO BE REMOVED. COORDINATE WITH THE REFRIGERATION CONTRACTOR. DISCONNECT AS REQUIRED, REMOVE WIRE BACK TO SOURCE AND LABEL BREAKERS AS "SPARE" FOR NON-REUSED CIRCUITS.
2. EQUIPMENT TO BE REMOVED. DISCONNECT AS REQUIRED, REMOVE WIRE BACK TO SOURCE AND LABEL NON-REUSED BREAKERS AS "SPARE".
3. WALL, COOLER PANEL OR SOFFIT TO BE DEMOLISHED. REMOVE ALL AFFECTED DEVICES, CONDUITS, WIRE, ETC. AS REQUIRED. MAKE MAKE PROVISIONS NECESSARY TO MAINTAIN DOWNSTREAM DEVICES.
4. LIGHTING FIXTURE TO BE REMOVED / REPLACED. CIRCUITRY TO REMAIN FOR RECONNECTION TO NEW FIXTURES.
5. PRODUCE AREA TRACK LIGHTING TO BE REPOSITIONED. SEE E1.1 FOR NEW LOCATIONS.
6. TRACK / DECOR LIGHTING TO BE REMOVED. CIRCUITRY TO REMAIN FOR RECONNECTION TO NEW FIXTURES.

Order Plans @ WWW.LDILine.com

CAPSTONE
project services, plc
2211 WIDMAN WAY, SUITE 220
FORT MYERS, FL. 33901

SEAL

CONSULTANT

HAAS & KENNEDY ENGINEERS, P.A.
ELECTRICAL ENGINEERS

PROJECT
A REMODEL FOR:
KROGER GA-429
730 NORTH MAIN STREET
CEDARTOWN, GA

DATE 8-12-2019
CONSTRUCTION SET

SHEET TITLE
ELECTRICAL DEMOLITION PLAN

REVISIONS

MARK	DATE	DESCRIPTION

PROJECT NO: 19317
CAD DWG FILE: GA-429 ED1.1
DRAWN BY: WSM
CHK'D BY: HCK

SHEET NO.
ED1.1