


1 FAN COIL COOLING UNIT
M401 NO SCALE

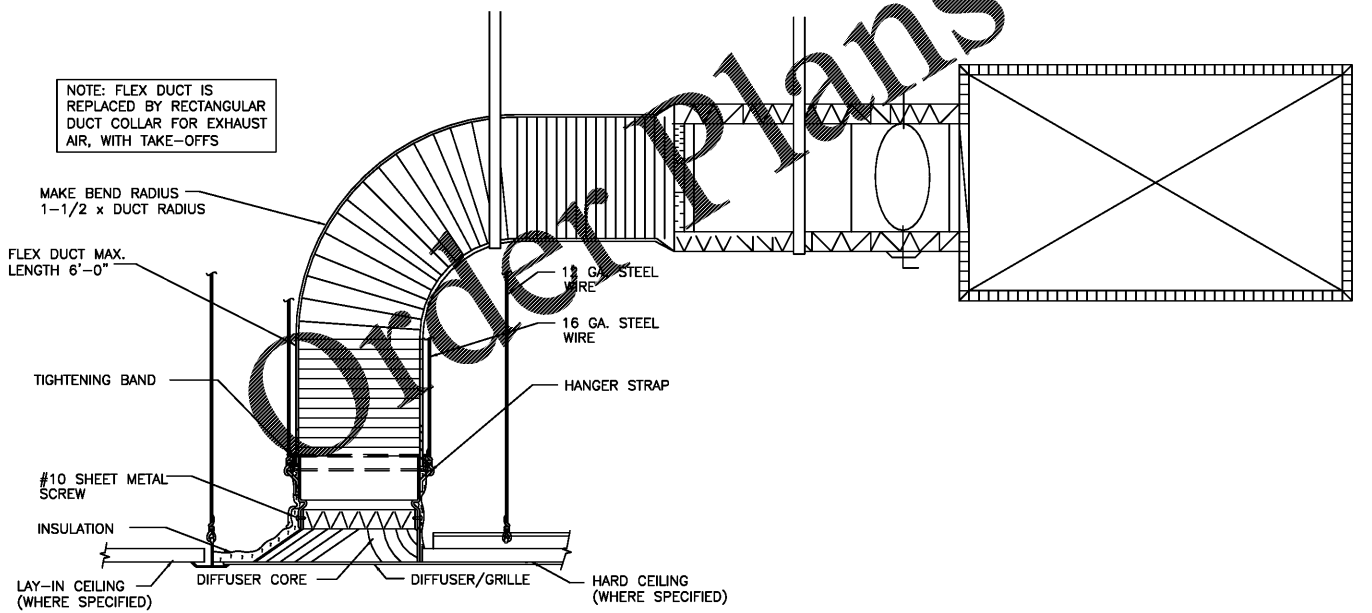

2 TYPICAL CEILING DIFFUSER TAKE-OFF DETAIL
M401 NO SCALE

NOTE: FLEX DUCT IS REPLACED BY RECTANGULAR DUCT COLLAR FOR EXHAUST AIR, WITH TAKE-OFFS

MAKE BEND RADIUS
1-1/2 x DUCT RADIUS

FLEX DUCT MAX.
LENGTH 6'-0"

TIGHTENING BAND

#10 SHEET METAL
SCREW

INSULATION

LAY-IN CEILING
(WHERE SPECIFIED)

DIFFUSER CORE

DIFFUSER/GRILLE

HARD CEILING
(WHERE SPECIFIED)

1/2 GA. STEEL
WIRE

16 GA. STEEL
WIRE

HANGER STRAP

Order Plans @ www.LDILine.com

LORD AECK SARGENT
A KATERRA COMPANY

© 2018 Lord Aeck Sargent, Inc. All rights reserved. This document is the property of Lord Aeck Sargent and is to be returned upon demand. The information contained herein may not be used for anything without the written permission of Lord Aeck Sargent.

Kramer Engineering Services, plc
5517 Cascade Dr.
Chapel Hill, NC 27514
TEL: (919) 933-3350
email: Donna@KESplc.com
Firm License: P-1099




REVISION

SHEET TITLE
MECHANICAL DETAILS

UNC SCHOOL OF MEDICINE
NEUROSCIENCES RESEARCH BUILDING
7th & 8th FLOORS FOR DERMATOLOGY

LOCATION
115 Mason Farm Road, Campus Box 7250
Chapel Hill, North Carolina 27598-7250



ISSUE DATE
09/25/2019

JOB NO.
10761-00

DWG. NO.
M401

BID SET