

STIPULATION FOR REUSE
 THIS DRAWING WAS PREPARED FOR THE PROJECT AND SITE AT MICCO, FL. REUSING THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HARRISON FRENCH & ASSOCIATES, LTD. IS PROHIBITED. THE USER OF THIS DRAWING FOR ANY OTHER PROJECT IS NOT AUTHORIZED AND MAY BE SUBJECT TO THE LAW.


Cumberland
 A R M S
 Store # 9747
 Oracle # V1735
 Oracle # FL1735
 8090 US 1 AND MICCO RD
 MICCO, FL 32976
 JOB NUMBER: 41-17-00190

ISSUE BLOCK

CLIENT REVIEW	08/30/19
100%	09/27/19

CHECKED BY: GGB
 DRAWN BY: AHM

ROOF FRAMING PLAN

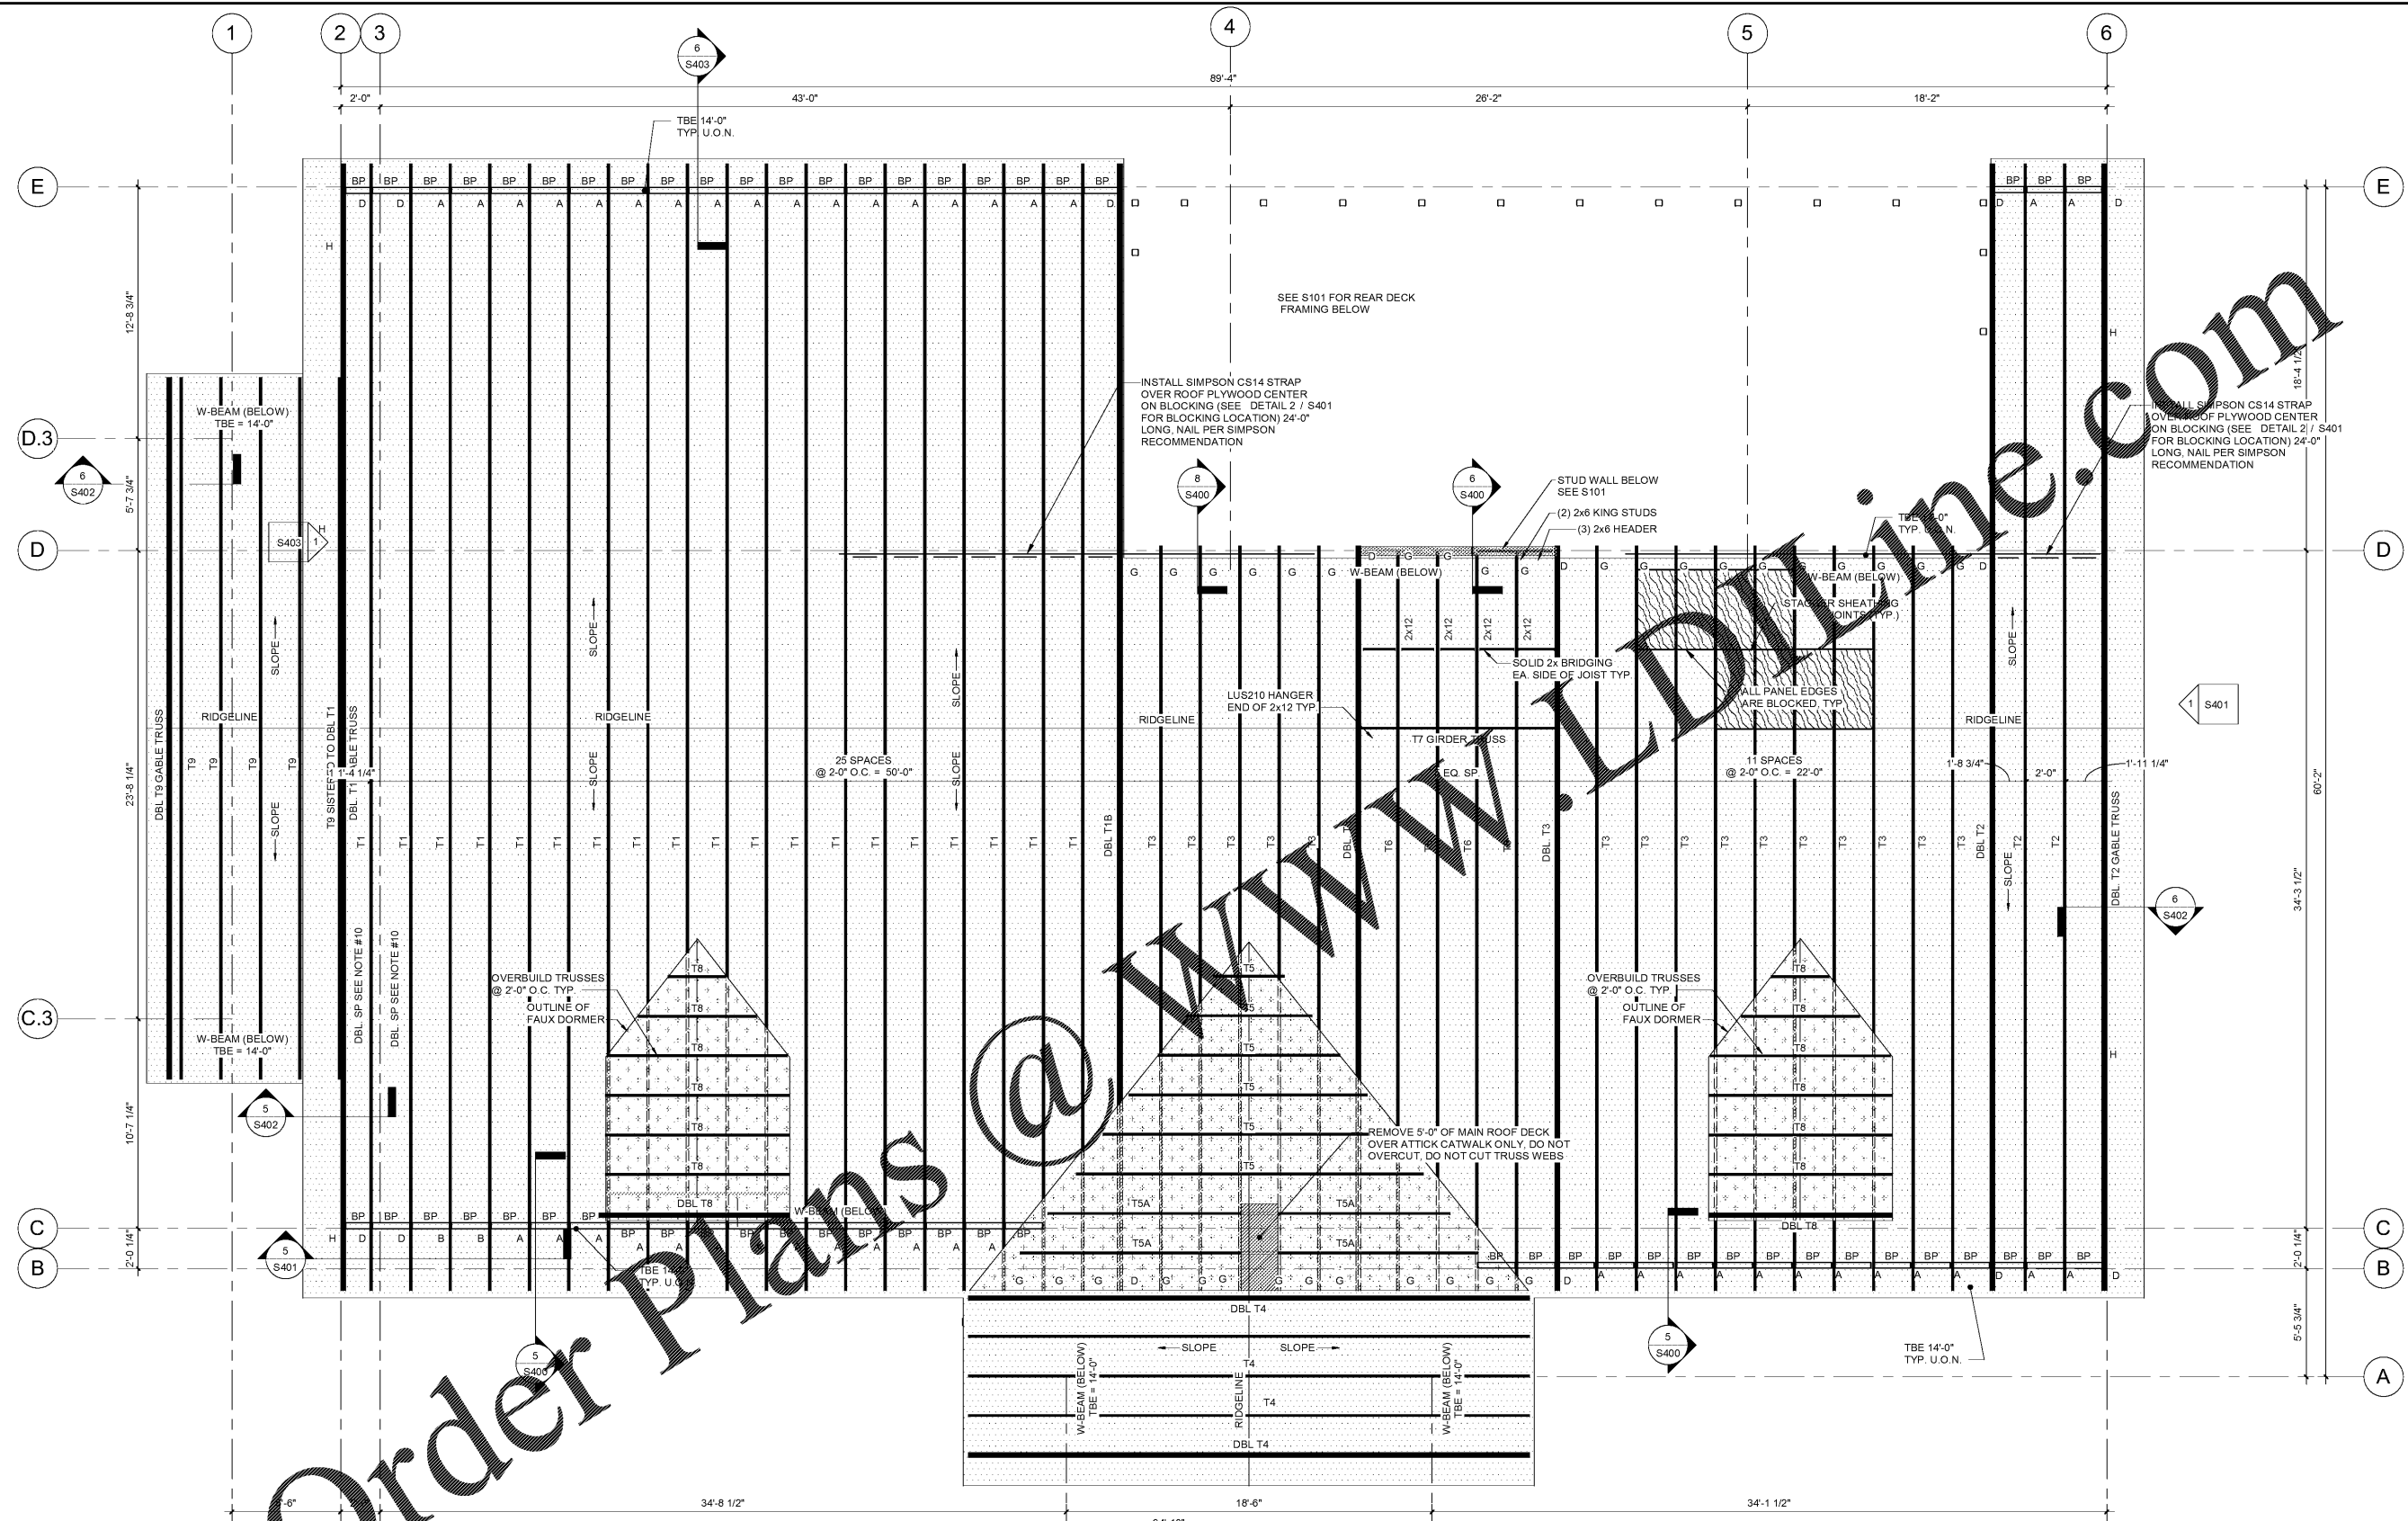

1 ROOF FRAMING PLAN
 1/4" = 1'-0"

- LEGEND:**
- O.F. DENOTES OUTSIDE FACE
 - TBE DENOTES TRUSS BEARING ELEVATION
 - T1 DENOTES TRUSS PER MFR.
 - BP DENOTES BLOCKING PANEL (DETAIL 3 / S402)
 - SP DENOTES SHEAR PANEL (DETAIL 4 vfa / S401)
 - (Dotted pattern) DENOTES LIMITS OF ROOF SHEATHING (SEE PLAN NOTES)
 - (Dashed pattern) DENOTES LIMITS OF OVERFRAMING
 - (Arrow) SLOPE DENOTES DIRECTION & PITCH OF ROOF SLOPE (COORD. W/ ARCH.)
 - (Cross-hatch pattern) DENOTES STUD WALL

PLAN NOTES:

- ROOF SHEATHING: 5/8" APA RATED PANEL SYSTEM SHEATHING (40/20) WITH EXPOSURE 1 CLASSIFICATION WITH 2X4 FLAT BLOCKING AT ALL JOINTS. ATTACH SHEATHING TO TRUSSES/RAFTERS WITH 10d COMMON NAILS @ 4" o.c. ALONG PANEL EDGES AND 8" o.c. AT INTERMEDIATE TRUSSES/RAFTERS
- ALL ELEVATIONS BASED ON FIN. FLR. EL. 0'-0". FIELD VERIFY ACTUAL FIN. FLR. EL.
- ROOF TRUSS BEARING ELEVATION 14'-0", TYP. U.O.
- ALL TRUSSES ARE SPACED @ 24" o.c. MAXIMUM. FIELD ADJUST AS REQUIRED.
- SEE ARCH. DWGS. & FOUNDATION PLAN FOR DIMENSIONS NOT SHOWN.
- SEE DWG. S001 + S002 FOR GENERAL NOTES AND TYPICAL DETAILS.
- ALL LOAD BEARING WALLS SHALL HAVE 2 x 6 HORIZONTAL BLOCKING AT HORIZONTAL PANEL JOINTS.
- REFER TO TRUSS MFR. DWGS. FOR CONNECTION OF PIGGY-BACK TRUSS TO THE TRUSS BELOW. THIS ONLY APPLIES TO TRUSSES DELIVERED "BROKEN" INTO TWO PIECES FOR TRANSPORTATION PURPOSES.
- DESIGN TRUSS FOR ADD'L 15K HORIZONTAL SHEAR LOAD FROM DIAPHRAGM TO BOT. CHORD. SEE DETAIL 3 / S403 AND DETAIL 4 / S403

HURRICANE TIE SCHEDULE

DESIGNATION	TYPE	CAPACITIES (LBS)	CONNECTION
JOISTS & TRUSSES U.O.N.	H10A	1,140	
JOISTS & TRUSSES MARKED 'A'	DETAL20	2,480	DETAIL 5 / S400
JOISTS & TRUSSES MARKED 'B'	2-HTS16	2,520	
JOISTS & TRUSSES MARKED 'C'	H8	795	
JOISTS & TRUSSES MARKED 'D'	MGT	3,965	DRILL & ANCHOR DETAIL 7 / S400
JOISTS & TRUSSES MARKED 'E'	2-LTS12	1,550	
JOISTS & TRUSSES MARKED 'G'	H10A & HGA10KT	1,835	
JOISTS & TRUSSES MARKED 'H'	HD7B	6,645	

9/27/2019 8:30:29 AM
 C:\Users\ahm\OneDrive\Documents\2019 Rev\Project\41-17-00190\AMK&FL_CDF_SDC_v19_ahm.mxd
 1902-ROOF FRAMING PLAN