## LIGHT FIXTURE SYMBOLS




LED 2' X 2' LIGHTING FIXTURE,RECESSED MOUNTED AND RECESSED MOUNTED WITH EMERGENCY BACKUP. SEE LIGHTING KEYNOTE 5.

"B" DENOTES LIGHTING FIXTURE TYPE (SEE FIXTURE SCHEDULE), "LBP-1" INDICATES CIRCUIT NUMBER, "a" DENOTES SWITCH CONTROL, z1 DENOTES DIMMING ZONE, TYP.

LED CAN LIGHT FIXTURE, RECESSED MOUNTED.

LED LINEAR LIGHT FIXTURE SURFACE MOUNTED AND SURFACE MOUNTED WITH EMERGENCY BACKUP

4' STRIP FIXTURE SURFACE WALL MOUNTED AND SURFACE WALL MOUNTED WITH EMERGENCY BALLASTS.

REMOTE HEAD EMERGENCY LIGHT

EXTERIOR CEILING MOUNTED EXIT SIGN

INTERIOR CEILING MOUNTED EXIT SIGN

EXTERIOR WALL PACK

ANGLED REFLECTOR WITH GOOSE-NECK MOUNTING

2' STRIPS FIXTURE SURFACE WALL MOUNTED AND, WITH EMERGENCY BACKUP.

## OCCUPANCY SENSORS

OS — CEILING MOUNTED OCCUPANCY SENSOR, 360° (28' DIAMETER), ACUITY CONTROLS NO. CMR PDT 10 (LT WHEN SPECIFIED)

| KEYNOTES | |
|---|---|
| 1 | CEILING MOUNTED SPEAKERS (BY OTHERS) TYP TO STEREO SYSTEM. (COORDINATE LOCATION WITH OWNER) |
| 2 | ELECTRICAL CONTRACTOR TO INSTALL ALL WIRING IN THIS AREA ABOVE WALK-IN COOLER AND POKE DOWN INTO ALL LIGHTING FIXTURES SO THAT THERE IS NO EXPOSED PIPING ON CEILING OF WALK-IN COOLER. ANY PENETRATION THAT GOES THROUGH COOLER CEILING OR WALL SHALL BE SEALED WITH SILICONE CAULK SEALANT AT TOP AND BOTTOM. |
| 3 | SEAL LIGHTING FIXTURES AT CEILING TO MAINTAIN COOLER/FREEZER TEMPERATURE. |
| 4 | ALL OVERHEAD WIRING SHALL BE IN MC CABLE OR EMT WITH JUNCTION BOXES. |
| 5 | CONNECT EXIT SIGNS AND EMERGENCY BALLASTS TO THE UNSWITCHED LEG OF THE CIRCUIT. EMERGENCY CAN TEST BUTTON SHALL NOT BE INSTALLED. TESTING FOR SALES FLOOR EMERGENCY LIGHTING TO BE ACCOMPLISHED AT BREAKER LPB-7. |
| 6 | REFER TO ARCHITECTURAL DRAWINGS FOR EXACT QUANTITIES AND LOCATIONS FOR BOTH INTERIOR AND EXTERIOR LIGHTING FIXTURES. |
| 7 | EC TO REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION OF EF-1 UNITS. EC TO ALSO CONNECT EXHAUST FAN TO THE OCCUPANCY SENSOR FOR CONTROLS. |
| 8 | REFER TO E503 DETAIL 1.6 FOR PHOTOSENSOR INSTALLATION DETAIL. COORDINATE EXACT LOCATION OF PHOTOSENSOR IN THE FIELD. |
| 9 | E.C. SHALL REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION OF EF-2 UNIT. |
| 10 | REFER TO E600 FOR SALES FLOOR DIMMING SCHEDULE. E.C. TO TERMINATE LIGHTING CIRCUITS INDICATED IN SCHEDULE TO CONTACTOR TERMINALS IN CPI CABINET. E.C. TO RUN 10V DIMMING CONDUCTORS TO CONTROLLERS LOCATED IN CPI LOW VOLTAGE CABINET. |

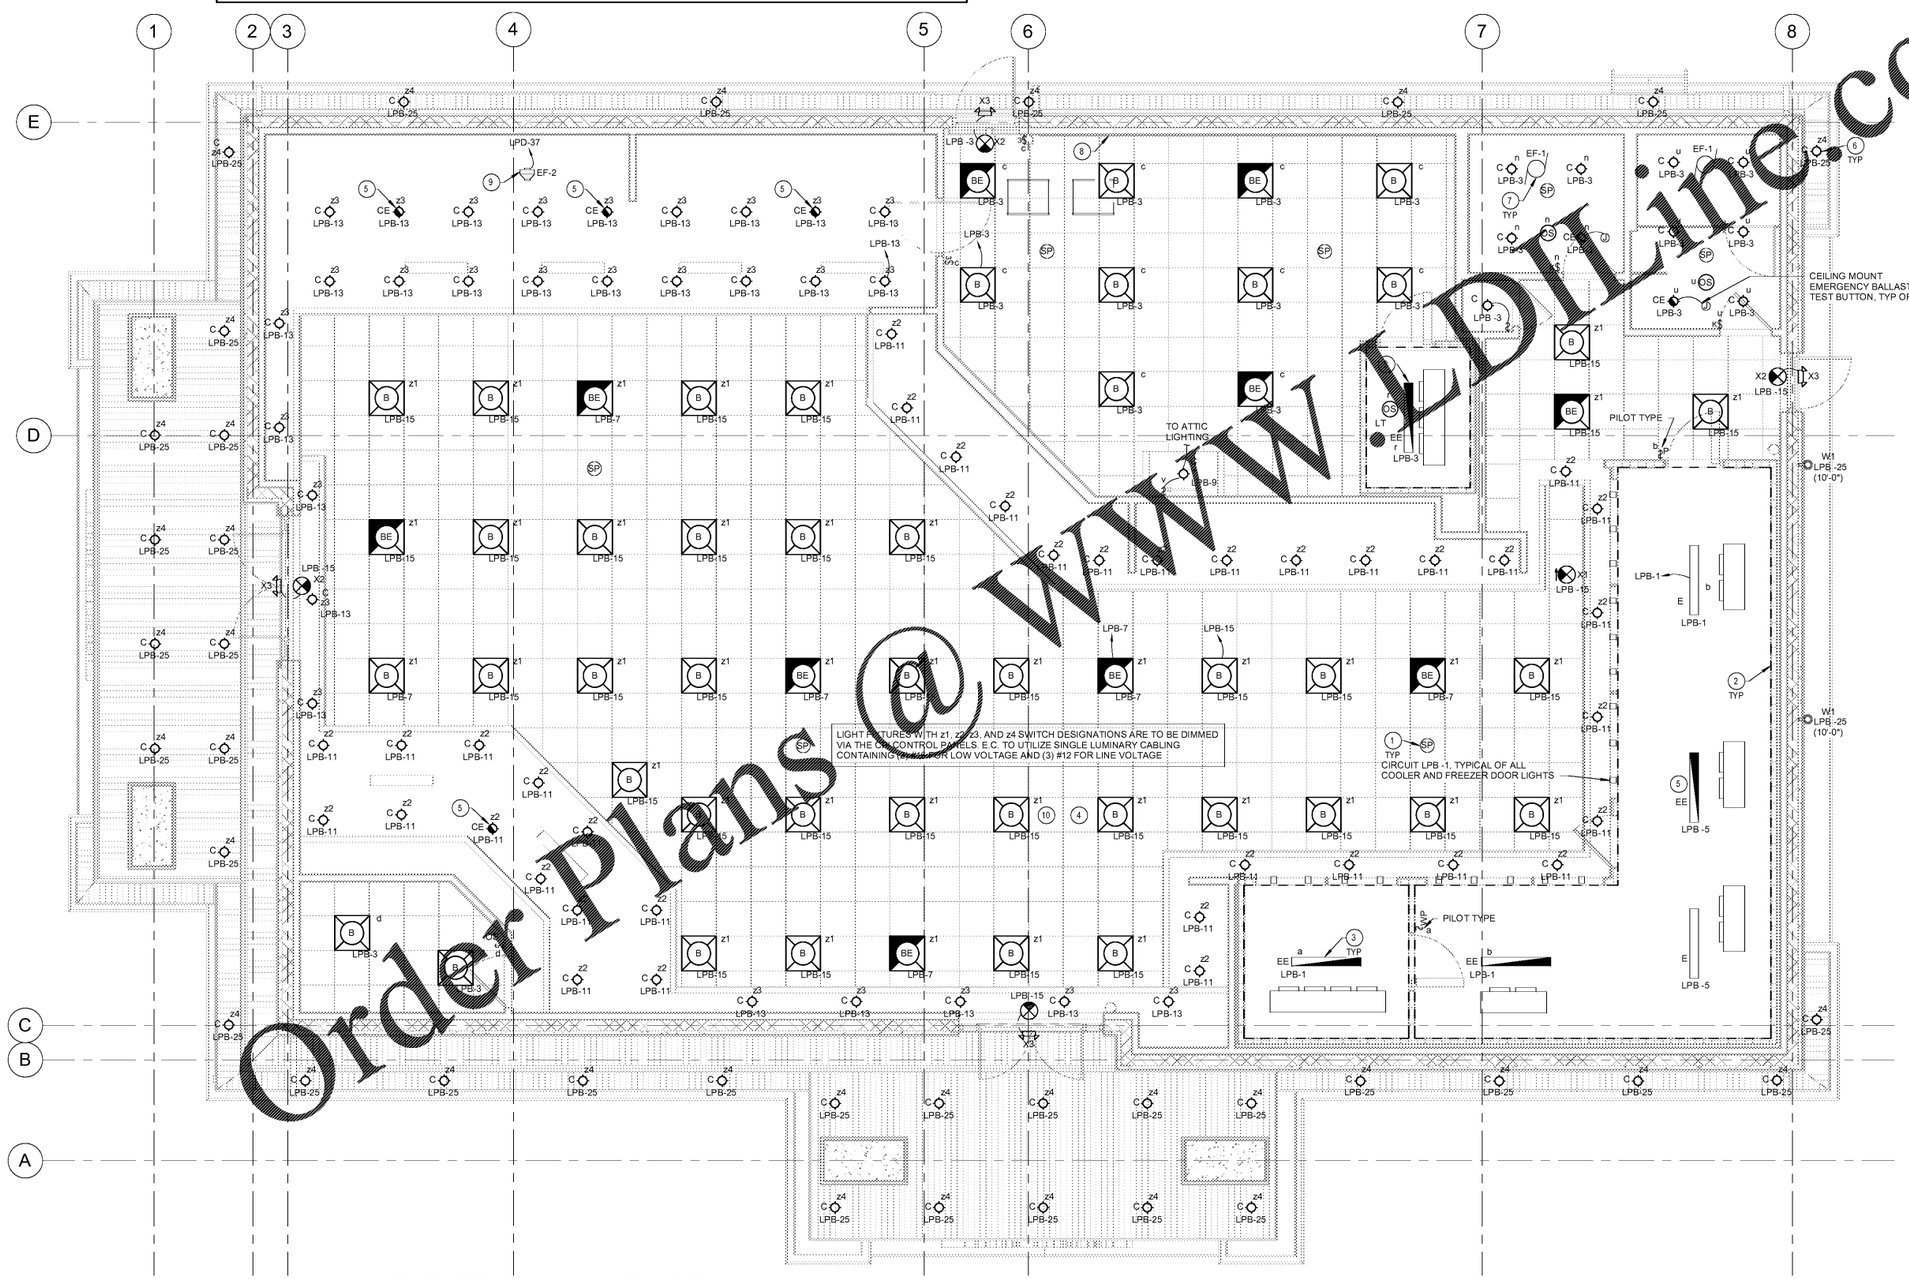


1 ELECTRICAL - LIGHTING PLAN
1/4" = 1'-0"

Order Plans @ www.PDFLine.com

HFA
Architecture & Interiors
Harrison French & Associates, Ltd
t 479.273.7780
1705 S. Walton Blvd., Suite 3
Bentonville, Arkansas 72712
www.hfa-ae.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT A SPECIFIC TIME AND IS NOT SUITABLE FOR USE ON A DIFFERENT SITE OR AT A DIFFERENT TIME. ANY REUSE OF THIS DRAWING FOR REFERENCE OR AS THE BASIS FOR ADAPTATION REQUIRES THE SERVICES OF PROPERLY QUALIFIED DESIGN PROFESSIONALS. ANY REPRODUCTION OF THIS DRAWING FOR REUSE BY ANY PARTY NOT EMPLOYED BY US IS UNAUTHORIZED AND MAY BE CONTRARY TO THE LAW

Cumberland Farms
Store Number: 9747
8090 US1 & MICCO ROAD
MICCO, FL
JOB NUMBER: 41-17-00190

| ISSUE BLOCK | | |
|---|---|---|
| 1 | CLIENT REVIEW | 08/30/19 |
| 2 | 100% | 09/27/19 |

| | |
|---|---|
| CHECKED BY: | JAC |
| DRAWN BY: | JLB |
| DOCUMENT DATE: | |

ELECTRICAL LIGHTING PLAN

SHEET: E100

9/26/2019 1:30:54 PM
C:\Users\jbrittain\Documents\20191Revit Projects\41-17-00190_Micco_FL_ARM-FIN_MidWest-LH_Elec_r19.jbrittain.rvt
R: HC ENV ELECTRICAL LIGHTING PLAN 100%