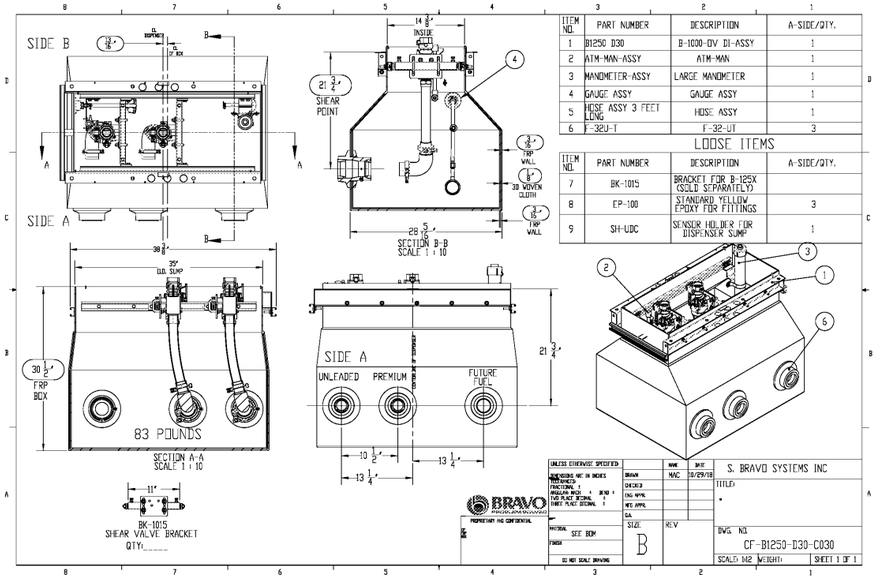

ITEM NO.	PART NUMBER	DESCRIPTION	A-SIDE/QTY.
1	B1250 D30	B-1000-OV DI-ASSY	1
2	ATM-MAN-ASSY	ATM-MAN	1
3	MANOMETER-ASSY	LARGE MANOMETER	1
4	GAUGE ASSY	GAUGE ASSY	1
5	HOSE ASSY 3 FEET LONG	HOSE ASSY	1
6	F-32U-T	F-32-UT	3

LOOSE ITEMS

ITEM NO.	PART NUMBER	DESCRIPTION	A-SIDE/QTY.
7	BK-1015	BRACKET FOR B-125X (SOLD SEPARATELY)	
8	EP-100	STANDARD YELLOW EPOXY FOR FITTINGS	3
9	SH-UDC	SENSOR HOLDER FOR DISPENSER SUMP	1

UNLESS OTHERWISE SPECIFIED		NAME	DATE
DIMENSIONS ARE IN INCHES	DRAWN	MAC	10/29/18
TOLERANCES: FRACTIONAL ± 1/64 ANG ± 1° TWO PLACE DECIMAL ± .01 THREE PLACE DECIMAL ± .005	CHECKED		
	ENG APPR.		
	MFG APPR.		
	QA		
MATERIAL SEE BOM	SIZE B	REV	
FINISH			
DO NOT SCALE DRAWING			

S. BRAVO SYSTEMS INC

TITLE:

DWG. NO. CF-B1250-D30-C030

SCALE: 1/2 WEIGHT: SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL

01 CFG14.4B DISPENSER SUMP DETAILS (3+0 OR 3+1)

NO SCALE

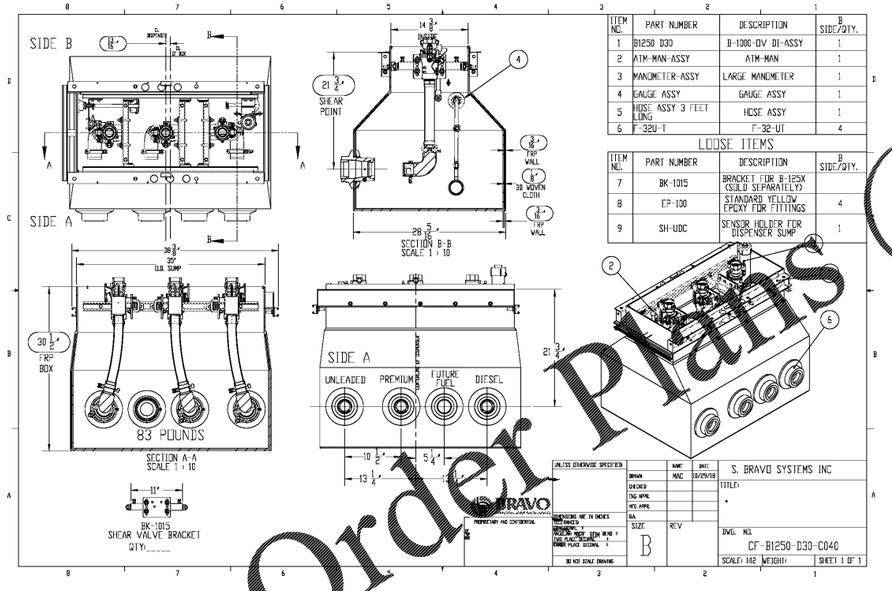

ITEM NO.	PART NUMBER	DESCRIPTION	B SIDE/QTY.
1	B1250 D30	B-1000-OV DI-ASSY	1
2	ATM-MAN-ASSY	ATM-MAN	1
3	MANOMETER-ASSY	LARGE MANOMETER	1
4	GAUGE ASSY	GAUGE ASSY	1
5	HOSE ASSY 3 FEET LONG	HOSE ASSY	1
6	F-32U-T	F-32-UT	4

LOOSE ITEMS

ITEM NO.	PART NUMBER	DESCRIPTION	B SIDE/QTY.
7	BK-1015	BRACKET FOR B-125X (SOLD SEPARATELY)	
8	EP-100	STANDARD YELLOW EPOXY FOR FITTINGS	4
9	SH-UDC	SENSOR HOLDER FOR DISPENSER SUMP	1

UNLESS OTHERWISE SPECIFIED		NAME	DATE
DIMENSIONS ARE IN INCHES	DRAWN	MAC	10/29/18
TOLERANCES: FRACTIONAL ± 1/64 ANG ± 1° TWO PLACE DECIMAL ± .01 THREE PLACE DECIMAL ± .005	CHECKED		
	ENG APPR.		
	MFG APPR.		
	QA		
MATERIAL SEE BOM	SIZE B	REV	
FINISH			
DO NOT SCALE DRAWING			

S. BRAVO SYSTEMS INC

TITLE:

DWG. NO. CF-B1250-D30-C040

SCALE: 1/2 WEIGHT: SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL

02 CFG14.4B DISPENSER SUMP DETAILS (3+1+1)

NO SCALE

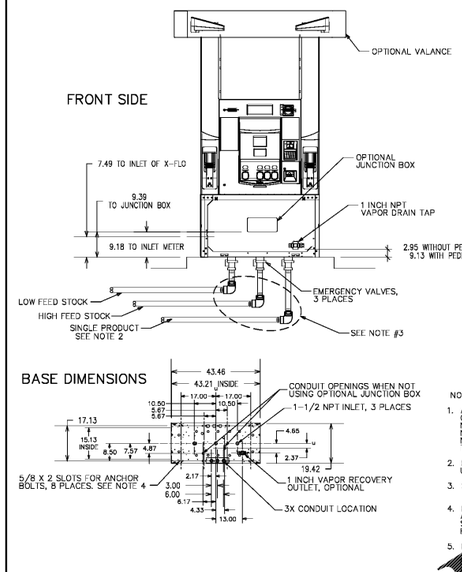

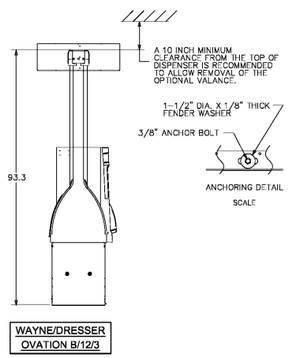

WAYNE/DRESSER OVATION B/12/3

BASE DIMENSIONS

NOTES: UNLESS OTHERWISE SPECIFIED

1. ALL PIPING AND ELECTRICAL INSTALLATIONS MUST CONFORM TO ALL APPLICABLE REGULATIONS INCLUDING NFPA30, FLAMMABLE & COMBUSTIBLE LIQUIDS CODE; NFPA30A, AUTOMOTIVE & MARINE SERVICE STATION CODE; NFPA70, NATIONAL ELECTRICAL CODE. DO NOT "DAISY CHAIN" THE DISPENSER POWER CIRCUIT TO ANY OTHER EQUIPMENT.
2. PIPING FROM TANK TO DISPENSER SHALL SLOPE UPWARDS TO AVOID AIR OR LIQUID TRAPS.
3. SEE DETAILS 01 & 02 ON SHEET CFG14.4B FOR ACTUAL PIPING COMPONENTS.
4. FIRMLY MOUNT THE DISPENSER TO THE ISLAND USING THE ANCHOR BOLT LOCATIONS SHOWN. SEE ANCHORING DETAIL. USE OF ALL ANCHOR LOCATIONS RECOMMENDED.
5. EMERGENCY SHUT-OFF VALVES AND BREAKAWAY DEVICES (FOR EXAMPLES OF REQUIREMENTS SEE NFPA30A AUTOMOTIVE & MARINE SERVICE STATION CODE. THESE, AS WELL AS ANY OTHER SAFETY DEVICES REQUIRED BY NFPA AND AHJ, MUST BE INSTALLED AND MAINTAINED PER THE MANUFACTURER'S INSTRUCTIONS.
6. THE FEED STOCKS MUST BE PLUMBED AS SHOWN FOR DISPENSER TO WORK PROPERLY.
7. CONNECTIONAL INTERCOM CIRCUIT TO A LISTED CLASS 2 POWERED INTERCOM ONLY WITH 18 GAUGE MINIMUM, ALLEA-94 90 DEGREE C, 600 V GAS & OIL RESISTANT UL LISTED WIRE. WIRES BACK TO INTERCOM POWER MUST BE RUN IN SEPARATE DEDICATED LISTED METALLIC CONDUIT.

04 CFG14.4B DISPENSER FOOTING DETAIL

SCALE: N.T.S.

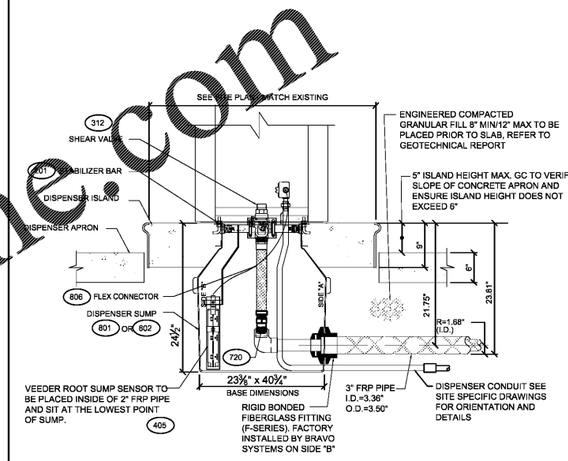

6 CFG14.4B DISPENSER SUMP DETAILS

SCALE: N.T.S.

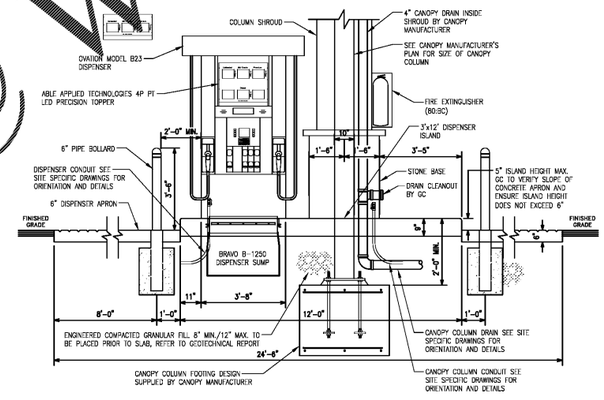

03 CFG14.4B DISPENSER ELEVATION LABELS & DIMENSIONS

SCALE: N.T.S.

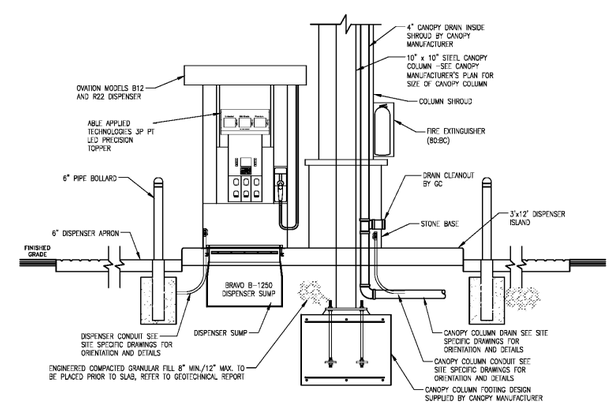

05 CFG14.4B DISPENSER ISLAND DETAILS

SCALE: N.T.S.

Order Plans @ www.PDFLine.com

stillwater TECHNOLOGIES
203 Hillcrest Street
Orlando, Florida 32801
(407) 206-7222
(407) 206-7223 fax
FL. Cert. of Auth. #8326

STILLWATER PROJECT #547-020

FREDERICK A. BLECHA LICENSE No. 50701 STATE OF FLORIDA PROFESSIONAL ENGINEER

REVISIONS			
NO.	DATE	REV. BY.	DESCRIPTION
1	09/12/18	MHF	UPDATE GUIDELINES
2	10/19/18	FAB	CLIENT REVIEW
3	12/05/18	FAB	REV. PER CLIENT REVIEW

V# n/a
Store# n/a
Gas Station# n/a

MICCO ROAD & US HWY 1
BREVARD COUNTY, FLORIDA

XERXES - DOUBLE WALL FIBERGLASS TANK INSTALLATION FOR:
ONE (1) 24,000 (18/6 SPLIT)/ONE (1) 24,000 (6/12/6 SPLIT) GAL. TANKS

Cumberland FARMS

CUMBERLAND FARMS, INC.
100 Crossing Boulevard
Framingham, MA 01702

SCALE: AS NOTED
DATE: September 12, 2018
FILE: CFG (2)24K_CFG14_3 XER
DRAWN BY: DSA

DISPENSER DETAILS

CFG14.4B