


Order Plans @ WWW.LDILine.com

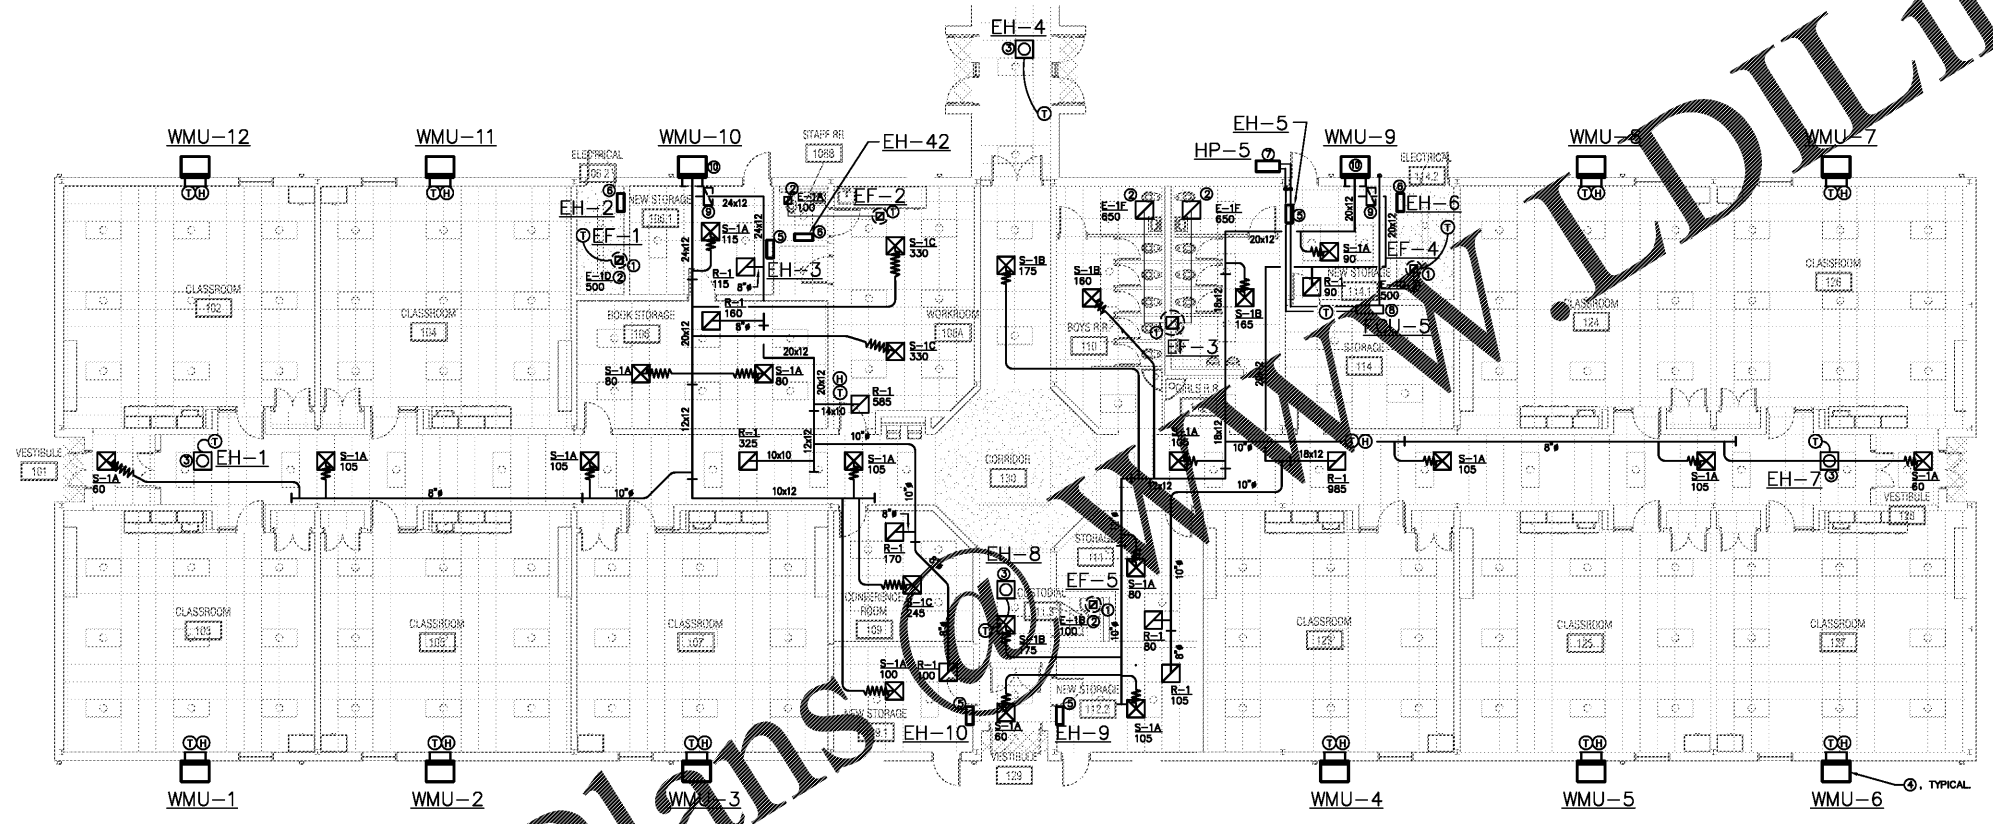

1 WING A CLASSROOMS-HVAC RENOVATION PLAN
M1.1 1/8" = 1'-0"

- KEY NOTES:** (THIS SHEET ONLY)
- 1 REPLACE EXISTING FAN ON ROOF. EXISTING DUCTWORK TO REMAIN. EXTEND/MODIFY EXISTING DUCT AS REQUIRED FOR CONNECTION TO NEW FAN.
 - 2 REPLACE EXISTING CEILING AIR DEVICE. CONNECT NEW SA DIFFUSER/EXH/RA GRILLE TO EXISTING DUCT. PROVIDE NEW FLEXIBLE CONNECTION FOR SA DIFFUSERS. PROVIDE ALL NECESSARY TRANSITIONS FOR CONNECTING TO EXISTING DUCT.
 - 3 REPLACE EXISTING ELECTRIC CEILING HEATER AND ASSOCIATED WALL MOUNT T'STAT.
 - 4 NEW GAS WALL MOUNT UNIT. PROVIDE MOUNT T'STAT & HUMIDITY SENSOR BETWEEN SUPPLY AND RETURN GRILLES UNLESS SHOWN IN DIFFERENT LOCATION. PROVIDE NEW DRY WELL FOR CONDENSATE. SEE SHEET M0.2 FOR DETAIL. SEE ARCH. DWGS. FOR EXACT UNIT LOCATION.
 - 5 REPLACE EXISTING ELECTRIC WALL HEATER. RELOCATE TO ±8'-0" A.F.F.
 - 6 REPLACE EXISTING ELECTRIC WALL HEATER.
 - 7 NEW DUCTLESS OUTDOOR HEAT PUMP UNIT. MOUNT ON EXISTING CONC. PAD. UTILIZE EXISTING OPENINGS FOR NEW REF. LINES.
 - 8 NEW DUCTLESS INDOOR HIGH SIDEWALL UNIT. ROUTE CONDENSATE FROM PUMP ABOVE CEILING TO EXTERIOR WALL. DROP TIGHT TO WALL AND SPILL IN DRY WELL. PROVIDE SHEETMETAL COVER OVER COND. PIPE.
 - 9 DROP RA DUCT THRU CEILING AND CONNECT TO UNIT.
 - 10 MOUNT UNIT HIGH IN ORDER TO GET SA DISCHARGE ABOVE CEILING.

NO.	DESCRIPTION	DATE

