



Order Plans

WWW.IDLINE.COM

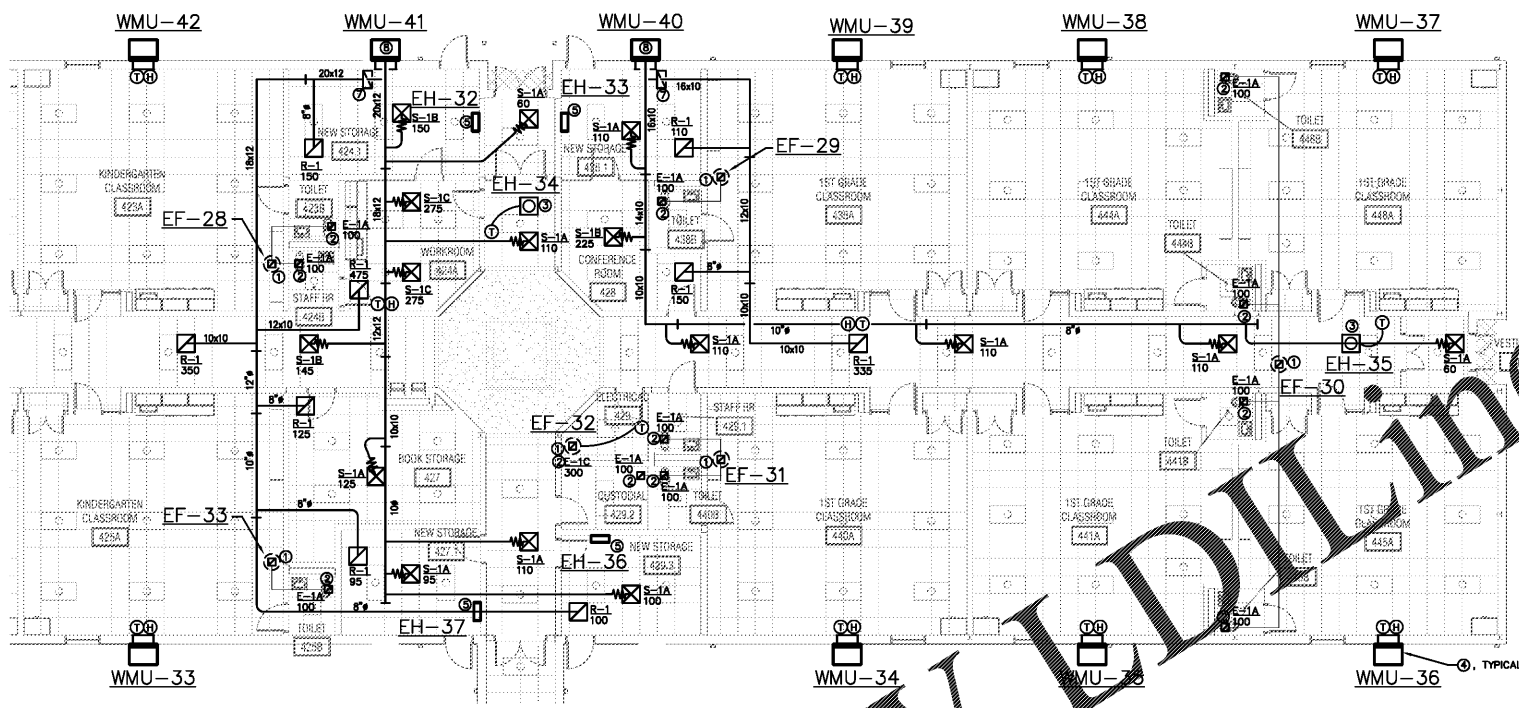


1 WING D CLASSROOMS-PARTIAL HVAC RENOVATION PLAN
M1.5 1/8" = 1'-0"

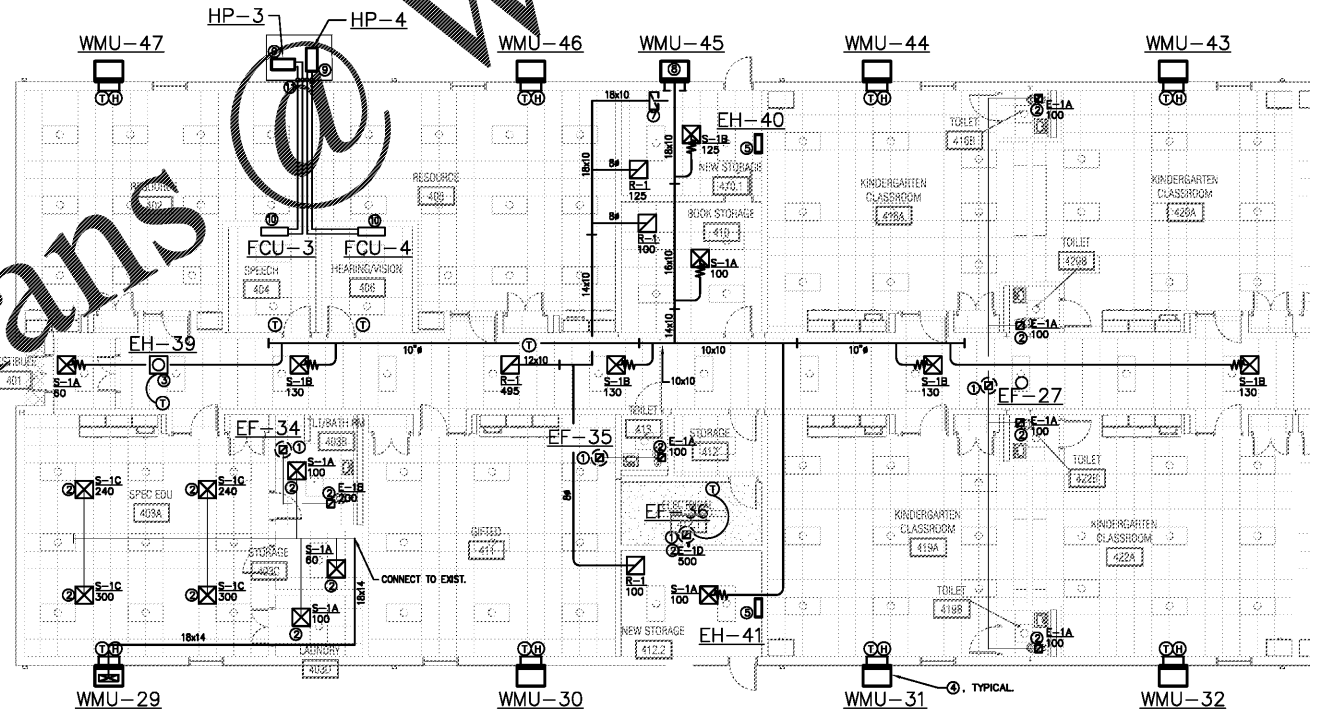

2 WING D CLASSROOMS-PARTIAL HVAC RENOVATION PLAN
M1.5 1/8" = 1'-0"

- KEY NOTES: (THIS SHEET ONLY)**
- 1 REPLACE EXISTING FAN ON ROOF. EXISTING DUCTWORK TO REMAIN. EXTEND/MODIFY EXISTING DUCT AS REQUIRED FOR CONNECTION TO NEW FAN.
 - 2 REPLACE EXISTING CEILING AIR SERVICE. CONNECT NEW DIFFUSER/EXH/RA GRILLE TO EXISTING DUCT. PROVIDE NEW FLEXIBLE CONNECTION FOR SA DIFFUSERS. PROVIDE ALL NECESSARY TRASTINGS FOR CONNECTION TO EXISTING DUCT.
 - 3 REPLACE EXISTING ELECTRIC CEILING HEATER AND ASSOCIATED WALL MOUNT T'ST.
 - 4 NEW GAS WALL MOUNT UNIT. PROVIDE MOUNT T'STAT BETWEEN SUPPLY AND RETURN GRILLES UNLESS SHOWN IN DIFFERENT LOCATION. NEW DRY WELL FOR CONDENSATE. SEE SHEET M1.2 FOR DETAIL. SEE ARCH. DWGS. FOR EXACT UNIT LOCATION.
 - 5 REPLACE EXISTING ELECTRIC WALL HEATER. RELOCATE TO A 48" W/ A.F.F.
 - 6 REPLACE EXISTING ELECTRIC WALL HEATER.
 - 7 DROP RA DUCT THRU CEILING AND CONNECT TO UNIT.
 - 8 MOUNT UNIT HIGH IN ORDER TO GET SA DISCHARGE ABOVE CEILING.
 - 9 NEW DUCTLESS OUTDOOR HEAT PUMP UNIT. PROVIDE NEW CONC. PAD.
 - 10 NEW DUCTLESS INDOOR HIGH SIDEWALL UNIT. PUMP AND ROUTE CONDENSATE ABOVE CEILING TO EXTERIOR WALL. DROP TIGHT TO WALL AND SPILL IN DRY WELL. PROVIDE SHEETMETAL COVER FOR EXPOSED PIPING.
 - 11 ROUTE NEW REF. PIPING TIGHT TO WALL UP TO ABOVE CEILING. PROVIDE PAINTED SHEETMETAL COVER.

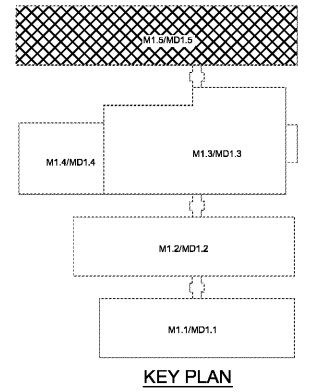

NO.	DESCRIPTION	DATE