



Order Plans @ WWW.DIline.com

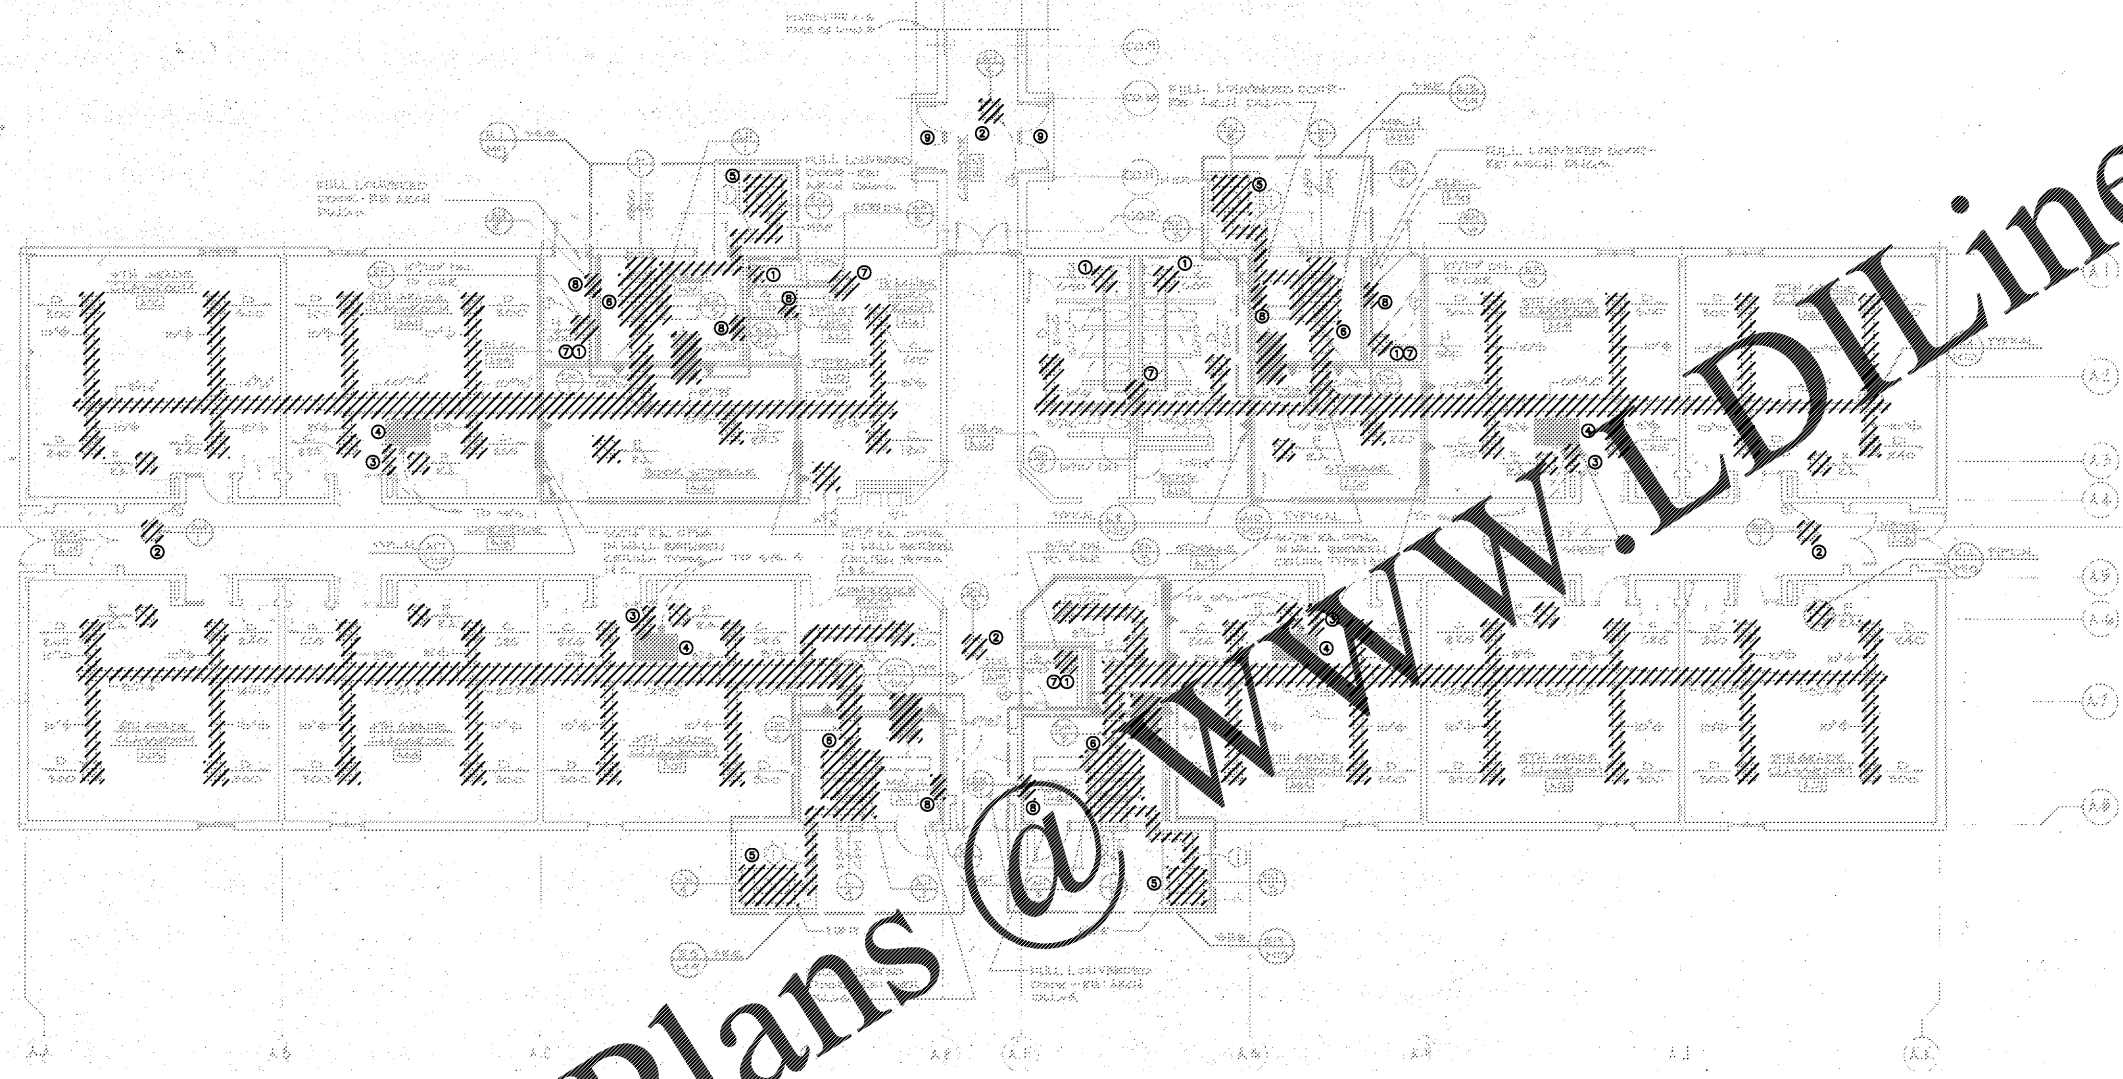

**GENERAL NOTE:**  
REMOVE ALL EXISTING DDC CONTROLS. ALL COMPONENTS SHALL BE TURNED OVER TO OWNER.

- KEY NOTES:**
- 1 EXISTING CEILING DEVICE AND ASSOCIATED FLEX DUCT (IF APPLICABLE) TO BE REPLACED.
  - 2 EXISTING ELECTRIC CEILING HEATER AND ASSOCIATED THERMOSTAT TO BE REPLACED.
  - 3 REMOVE EXISTING TIME SWITCH, THERMOSTAT, AND NIGHT THERMOSTAT. COVER UNUSED JUNCTION BOXES WITH STAINLESS STEEL COVER PLATE.
  - 4 REMOVE EXISTING MOTOR OPERATED DAMPER, DAMPER OPERATOR, AND ALL RELATED CONTROLS AT SYSTEM RELIEF VENT. CLOSE OFF RELIEF OPENING WITH INSULATED SHEET METAL CAP.
  - 5 REMOVE EXISTING CONDENSING UNIT AND ALL RELATED PIPING AND CONTROLS. RECOVER REFRIGERANT FROM UNIT TO BE REMOVED - SEE SPECIFICATIONS. DEMO CONCRETE HOUSEKEEPING PAD AND CHAIN LINK FENCE. FILL IN WITH DIRT TO MATCH SURROUNDING GRADE AND SOD DISTURBED AREA.
  - 6 REMOVE EXISTING AIR HANDLER AND DUCT FURNACE AND ALL RELATED PIPING, DUCTWORK, AND CONTROLS. CAP EXISTING FLUE FROM DUCT FURNACE BELOW ROOF.
  - 7 EXISTING FAN ON ROOF TO BE REPLACED.
  - 8 EXISTING ELECTRIC WALL HEATER TO BE REPLACED.
  - 9 PROVIDE SHEET-METAL BLANK-OFF BEHIND EXISTING SOFFIT GRILLES AT CONNECTION CORRIDOR.

1 WING A CLASSROOMS-HVAC DEMOLITION PLAN  
MD11 1/8" = 1'-0"

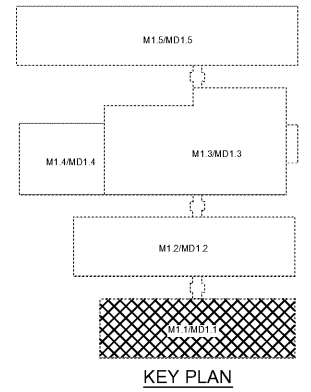

DUNLEITH ELEMENTARY SCHOOL  
RENOVATIONS & MODIFICATIONS  
120 SAINTE DR. SW  
MARIETTA, GA 30008  
  
MARIETTA CITY SCHOOLS

WING A  
CLASSROOMS-  
HVAC  
DEMOLITION  
PLAN

DATE 08/30/2019  
PROJECT NO. 18122

MD1.1