GENERAL NOTE:

1. REMOVE ALL EXISTING DDC CONTROLS. ALL COMPONENTS SHALL BE TURNED OVER TO OWNER.

KEY NOTES:

1. EXISTING CEILING DEVICE AND ASSOCIATED FLEX DUCT (IF APPLICABLE) TO BE REPLACED.
2. EXISTING ELECTRIC CEILING HEATER AND ASSOCIATED THERMOSTAT TO BE REPLACED.
3. REMOVE EXISTING TIME SWITCH, THERMOSTAT, AND NIGHT THERMOSTAT. COVER UNUSED JUNCTION BOXES WITH STAINLESS STEEL COVER PLATE.
4. REMOVE EXISTING MOTOR OPERATED DAMPER, DAMPER OPERATOR, AND ALL RELATED CONTROLS AT SYSTEM RELIEF VENT. CLOSE OFF RELIEF OPENING WITH INSULATED SHEET METAL CAP.
5. REMOVE EXISTING CONDENSING UNIT AND ALL RELATED PIPING AND CONTROLS. RECOVER REFRIGERANT FROM UNIT TO BE REMOVED – SEE SPECIFICATIONS. DEMO CONCRETE HOUSEKEEPING PAD AND CHAIN LINK FENCE. FILL IN WITH DIRT TO MATCH SURROUNDING GRADE AND SOD DISTURBED AREA.
6. REMOVE EXISTING AIR HANDLER AND DUCT FURNACE AND ALL RELATED PIPING, DUCTWORK, AND CONTROLS. CAP EXISTING FLUE FROM DUCT FURNACE BELOW ROOF.
7. EXISTING FAN ON ROOF TO BE REPLACED.
8. EXISTING ELECTRIC WALL HEATER TO BE REPLACED.
9. PROVIDE SHEET-METAL BLANK-OFF BEHIND EXISTING SOFFIT GRILLES AT CONNECTION CORRIDOR.

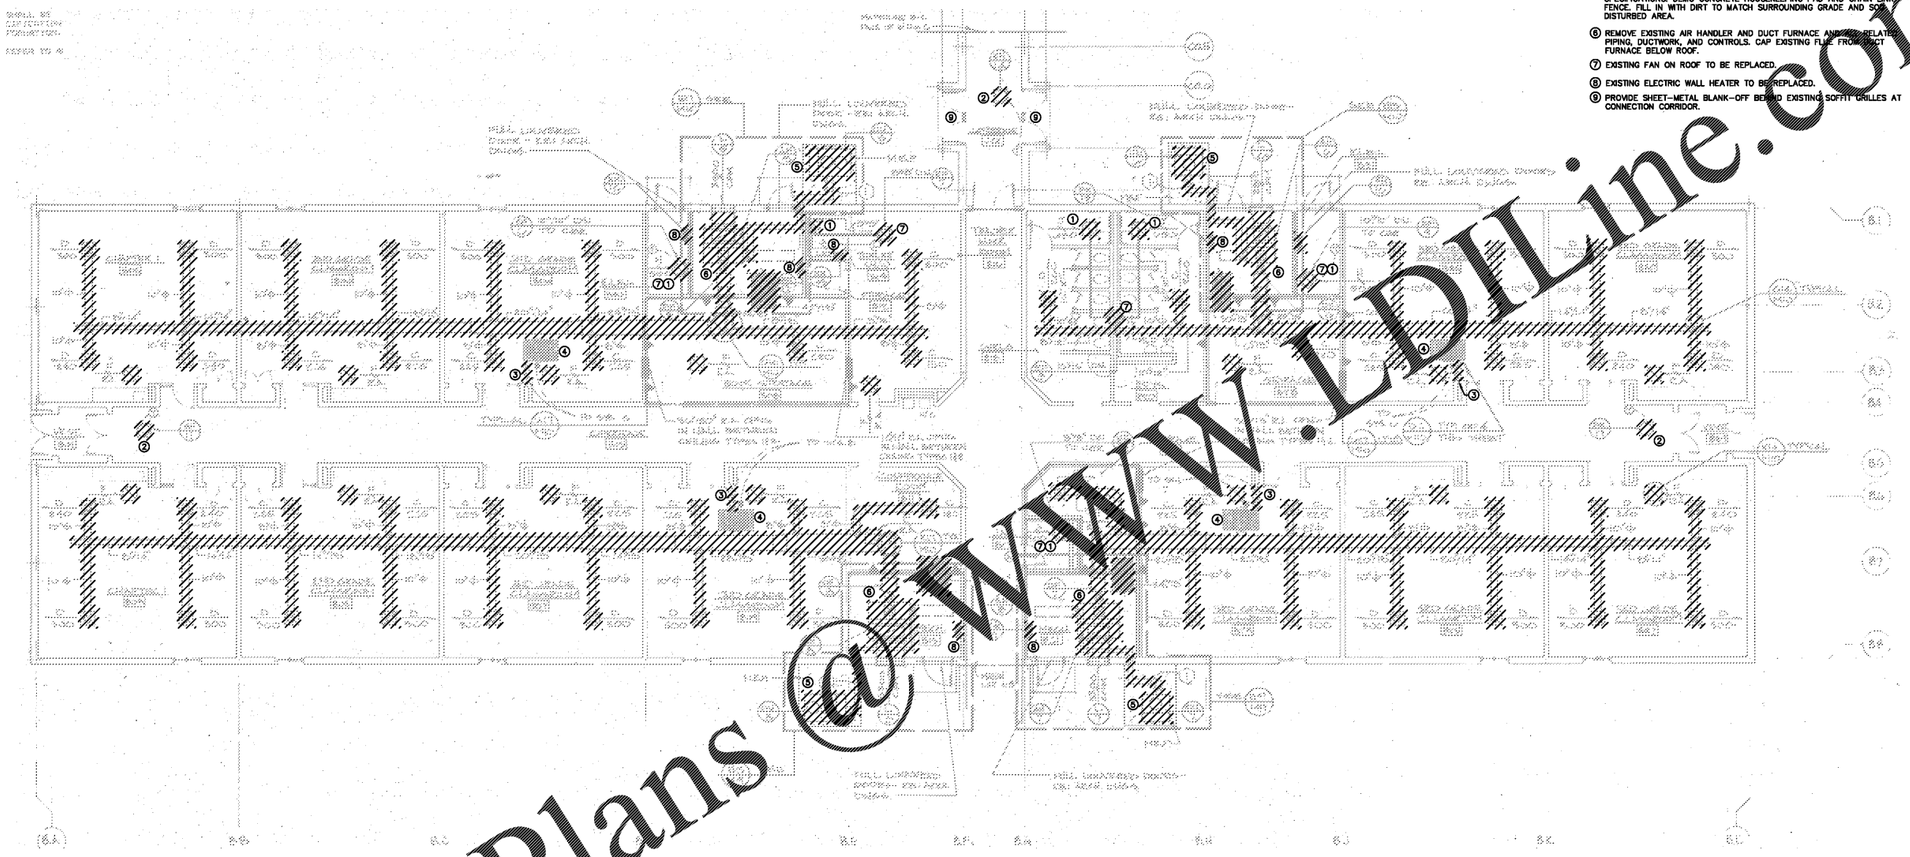

1 MD1.2 WING B CLASSROOMS-HVAC DEMOLITION PLAN
1/8" = 1'-0"

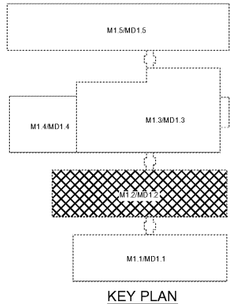

KEY PLAN

Order Plans @ WWW.LDILine.com

BAA Breaux & Associates ARCHITECTS
5955 Shiloh Road East, Suite 200
Alpharetta, Georgia 30005 | (678) 585-4506

GEORGIA REGISTERED PROFESSIONAL ENGINEER JOHN E. MAYES
08/30/2019

BAA MECHANICAL ENGINEERS INC
500 Bishop Street Suite I-3 Atlanta, GA 30318 Ph: 404-355-0250 Fax: 404-355-1050

NO	DESCRIPTION	DATE

DUNLEITH ELEMENTARY SCHOOL RENOVATIONS & MODIFICATIONS
120 SAINE DR. SW
MARIETTA, GA 30008

MARIETTA CITY SCHOOLS

WING B CLASSROOMS-HVAC DEMOLITION PLAN

DATE	08/30/2019
PROJECT NO.	18122

MD1.2