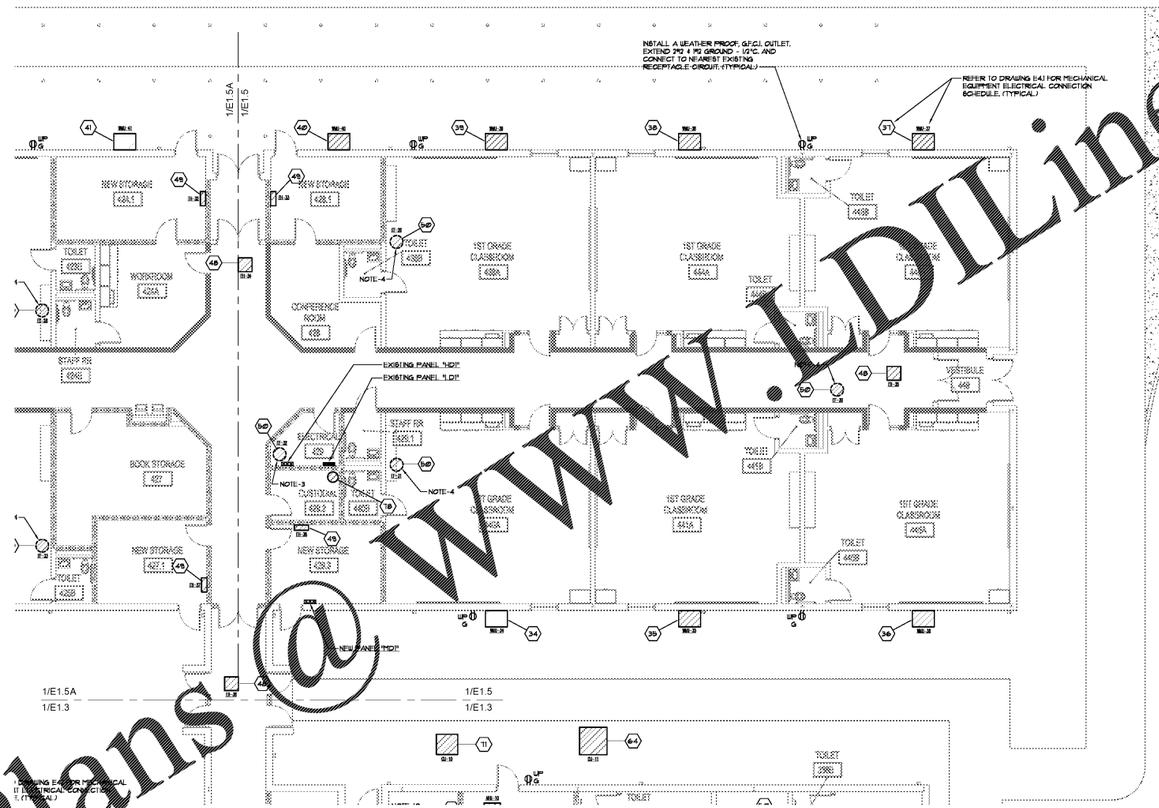

1 / E1.5 PARTIAL FLOOR PLAN - BLDG 400 - POWER

SCALE: 1/8" = 1'-0"

ELECTRICAL NOTES

1. INSTALL JUNCTION BOX TO ACCOMMODATE WALL MOUNTED HAND DRYER. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECT. FURNISH AND INSTALL A XLERATOR * XL-BU HAND DRYER.
2. EXTEND 2#12 + #12 GROUND - 1/2"C. AND CONNECT TO A NEW 20A/1P G.F.C.I. TYPE BREAKER IN NEAREST EXISTING 120/208V PANELBOARD. NEW BREAKER SHALL BE OF SAME MANUFACTURER AS EXISTING PANEL, AND MATCH AIC RATING OF EXISTING BREAKERS. PROPERLY UPDATE PANEL DIRECTORY.
3. INSTALL A NEW LINE VOLTAGE T-STAT FURNISHED BY DIVISION 23.
4. INSTALL A RELAY TO ALLOW 120 VOLT FAN TO BE CONTROLLED BY 277 VOLT CORRIDOR LIGHTING. FAN SHALL ENERGIZE WHEN NON-EMERGENCY CORRIDOR LIGHTS ARE ENERGIZED.

KEY PLAN



BXA
Breaux & Associates
ARCHITECTS
5965 Shiloh Road East, Suite 200
Alpharetta, Georgia 30005 | (678) 565-4508

REGISTERED PROFESSIONAL ENGINEER
No. PE029910
PROFESSIONAL
KEITH MATHIS
09-09-2019

MATHIS & ROBERDS
CONSULTING ENGINEERS
244 O'DELL ROAD, SUITE 6
CANTON, GEORGIA 30115
TELEPHONE 770-213-4160

2019-460 | JRM

NO	DESCRIPTION	DATE

DUNLEITH ELEMENTARY SCHOOL
RENOVATIONS & MODIFICATIONS
120 SAINE DR. SW
MARIETTA, GA 30008

MARIETTA CITY SCHOOLS

PARTIAL FLOOR PLAN - BLDG. 400 - POWER

DATE 08/30/2019

PROJECT NO. 18122

E1.5

Order Plans @ WWW.LDILine.com

Dunleith Elem. School - Renovations