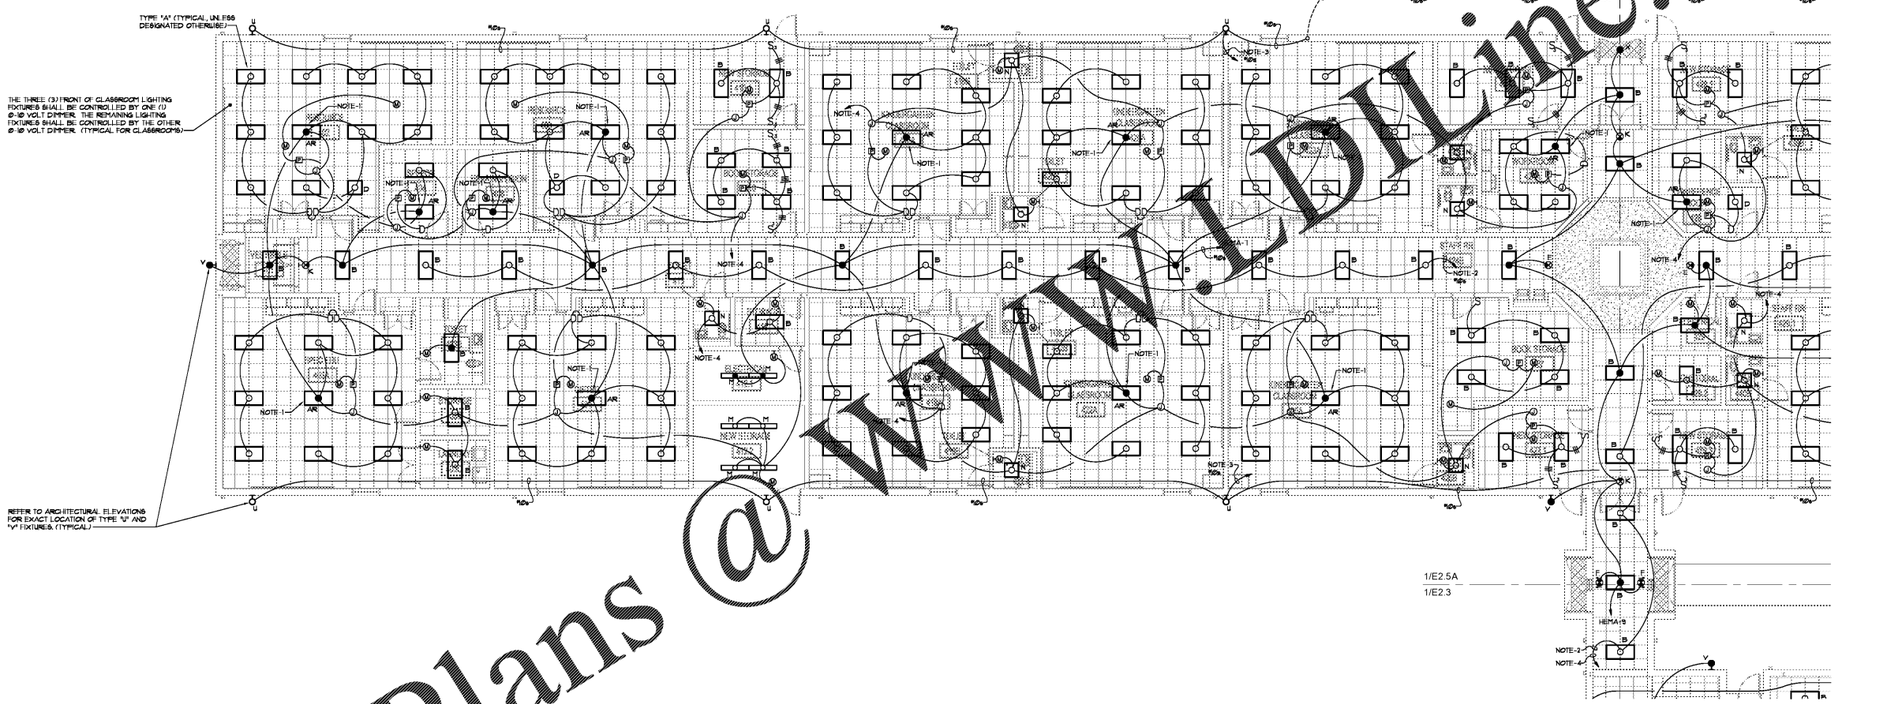
TYPE 'A' (TYPICAL, UNLESS DESIGNATED OTHERWISE)
THE THREE (3) FRONT OF CLASSROOM LIGHTING FIXTURES SHALL BE CONTROLLED BY ONE (1) 0-10 VOLT DIMMER. THE REMAINING LIGHTING FIXTURES SHALL BE CONTROLLED BY THE OTHER 0-10 VOLT DIMMER. (TYPICAL FOR CLASSROOMS)
REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT LOCATION OF TYPE 'U' AND 'V' FIXTURES. (TYPICAL)
CONTRACTOR SHALL PROVIDE POINT-TO-POINT FOOTCANDLE LEVELS FOR SIDEWALK UNDER BUS CANOPY. SUBMIT WITH SHOP DRAWINGS.
1/E2.5A
1/E2.5
1/E2.5A
1/E2.3
NOTE-2
NOTE-4
NOTE-3
NOTE-1
NOTE-4
NOTE-2
NOTE-3
NOTE-4
NOTE-1
NOTE-4
NOTE-1
NOTE-4
NOTE-1