


NOTE: ANY AND ALL FENCING OR RAILING SHALL BE LOCATED A MINIMUM OF 1.0' FROM THE BACK OF RETAINING WALL.


- NOTE:
1. MODULAR RETAINING WALL SHALL BE COMPOSED OF A SINGLE MANUFACTURER'S SYSTEM.
 2. WALL UNITS SHALL HAVE A MECHANICAL CONNECTION CONSISTING OF A PIN, BAR OR A CLIP.
 3. SAMPLES OF THE FULL LINE OF THE MANUFACTURER'S COLORS SHALL BE SUBMITTED TO THE ARCHITECT ALONG WITH A SAMPLE OF ONE UNIT AND THE MECHANICAL CONNECTION DEVICE.
 4. CONTRACTOR SHALL SUBMIT TO THE ARCHITECT DESIGN DRAWINGS AND DETAILS STAMPED WITH ENGINEER'S SEAL PRIOR TO THE START OF WALL CONSTRUCTION.
 5. SEE SPECIFICATION SECTION 32 32 23 FOR ALL WALL SYSTEM REQUIREMENTS.
 6. IT WILL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO OBTAIN AN ENGINEERING DESIGN FOR THE RETAINING WALL. THE WALL SHALL BE DESIGNED BY A QUALIFIED ENGINEER. SOUTHERN ASE WILL REQUIRE SHOP DRAWINGS TO BE SUBMITTED AND APPROVED PRIOR TO THE INSTALLATION TO THE RETAINING WALL. SEND SHOP DRAWINGS TO:
SOUTHERN ASE
ATTN: MIKE EIDSON
7951 TROON CIRCLE
AUSTELL, GA 30168
 7. APPROVED SHOP DRAWINGS WILL BECOME PART OF THE CONTRACT DOCUMENTS FOR CONSTRUCTION PURPOSES. THE CONTRACTOR SHALL CONTRACT WITH A QUALIFIED TESTING FIRM TO PROVIDE QUALITY CONTROL AND TESTING DURING CONSTRUCTION OF THE RETAINING WALLS.

MODULAR CONCRETE RETAINING WALL DETAIL
NOT TO SCALE



PAINTED HANDICAPPED PAVEMENT SYMBOL
NOT TO SCALE SPEC 32 17 23


TRUNCATED DOME PAVER OR STAMPED CONCRETE WIDETECTABLE WARNINGS W/70 PERCENT VISUAL CONTRAST OR CAST-IN-PLACE REPLACEMENT TACTILE WARNING SURFACE PANEL. COLOR SHALL BE YELLOW OR RED.

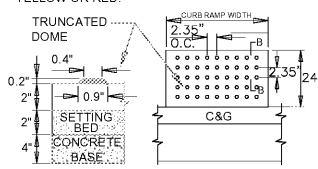


DOME PAVER DOME PAVER
SECTION B-B PLAN VIEW

NOTE: DETECTABLE WARNING SHALL COMPLY WITH GA ACCESSIBILITY CODE 120-3-20-40 FOR PRECAST CONCRETE TRUNCATED DOMES OR CAST-IN-PLACE REPLACEABLE TACTILE WARNING SURFACE PANELS.


TRUNCATED DOME DETAIL
NOT TO SCALE

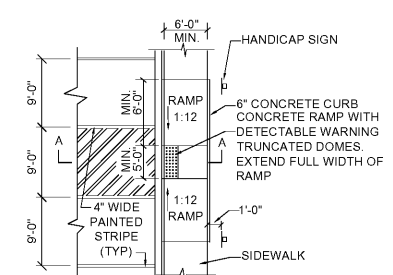


HANDICAP PARKING TYPE B RAMP DETAIL
NOT TO SCALE




HANDICAP PARKING TYPE A RAMP DETAIL
NOT TO SCALE

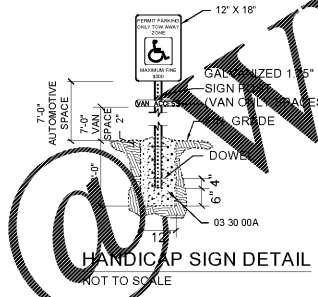


HANDICAP SIGN DETAIL
NOT TO SCALE

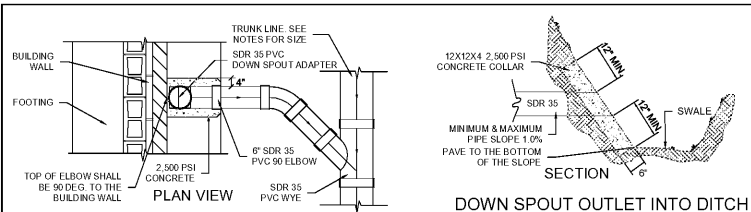

DOWN SPOUT OUTLET INTO DITCH
NOT TO SCALE

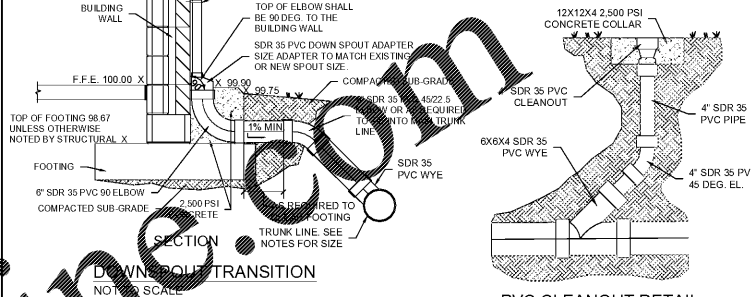

DOWN SPOUT TRANSITION
NOT TO SCALE

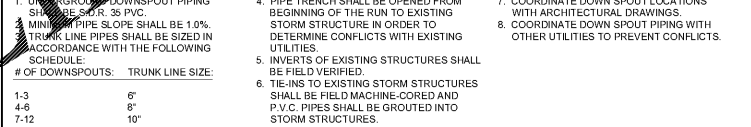

PVC CLEANOUT DETAIL
NOT TO SCALE

DNOWNSPOUT PIPING DETAILS
NOT TO SCALE

- NOTES:
1. USE APPROVED DOWNSPOUT PIPING UNLESS OTHERWISE NOTED.
 2. MINIMUM PIPE SLOPE SHALL BE 1.0%.
 3. TRUNK LINE PIPES SHALL BE SIZED IN ACCORDANCE WITH THE FOLLOWING SCHEDULE:
- | # OF DOWNSPOUTS: | TRUNK LINE SIZE: |
|------------------|------------------|
| 1-3 | 6" |
| 4-6 | 8" |
| 7-12 | 10" |
| 13-19 | 12" |
4. PIPE TRENCH SHALL BE OPENED FROM BEGINNING OF THE RUN TO EXISTING STORM STRUCTURE IN ORDER TO DETERMINE CONFLICTS WITH EXISTING UTILITIES.
 5. INVERTS OF EXISTING STRUCTURES SHALL BE FIELD VERIFIED.
 6. TIE-INS TO EXISTING STORM STRUCTURES SHALL BE FIELD MACHINE-CORED AND P.V.C. PIPES SHALL BE GROUTED INTO STORM STRUCTURES.
 7. COORDINATE DOWN SPOUT LOCATIONS WITH ARCHITECTURAL DRAWINGS.
 8. COORDINATE DOWN SPOUT PIPING WITH OTHER UTILITIES TO PREVENT CONFLICTS.

Order Plans

www.dilling.com

SA&E PROJECT NUMBER	01-615-057
BID PACKAGE/PHASING	BP-1
ISSUED FOR CONSTRUCTION	10/15/2019
REVISIONS	
R #	Doc #
Date	

ADD ALTERNATE #1
BOARD OF EDUCATION OFFICE FOR:
HEARD COUNTY SCHOOL
4647 PEA RIDGE ROAD, FRANKLIN, GA 30127
HEARD COUNTY SCHOOL SYSTEM
FRANKLIN, GEORGIA

CONSTRUCTION DETAILS

STATE OF GEORGIA REGISTERED ARCHITECT	STATE OF GEORGIA REGISTERED ARCHITECT	DRAWING NUMBER
		C503