


KEYNOTES

- ① MODIFY EXISTING GAS METER(S) SERVING PROJECT SCOPE TO FIT PLANT SPACES TO SUPPLY 520 MBTU'S AT 2 PSI. ROUTE PIPING DN TO BIG AND TO EQUIPMENT AS SHOWN.
- ② GAS PIPING UP FROM BIG TO EQUIPMENT WITH SHUT-OFF VALVE, TEST LEG, PRESSURE REDUCING VALVE AND UNIFORM SUPPORTS.

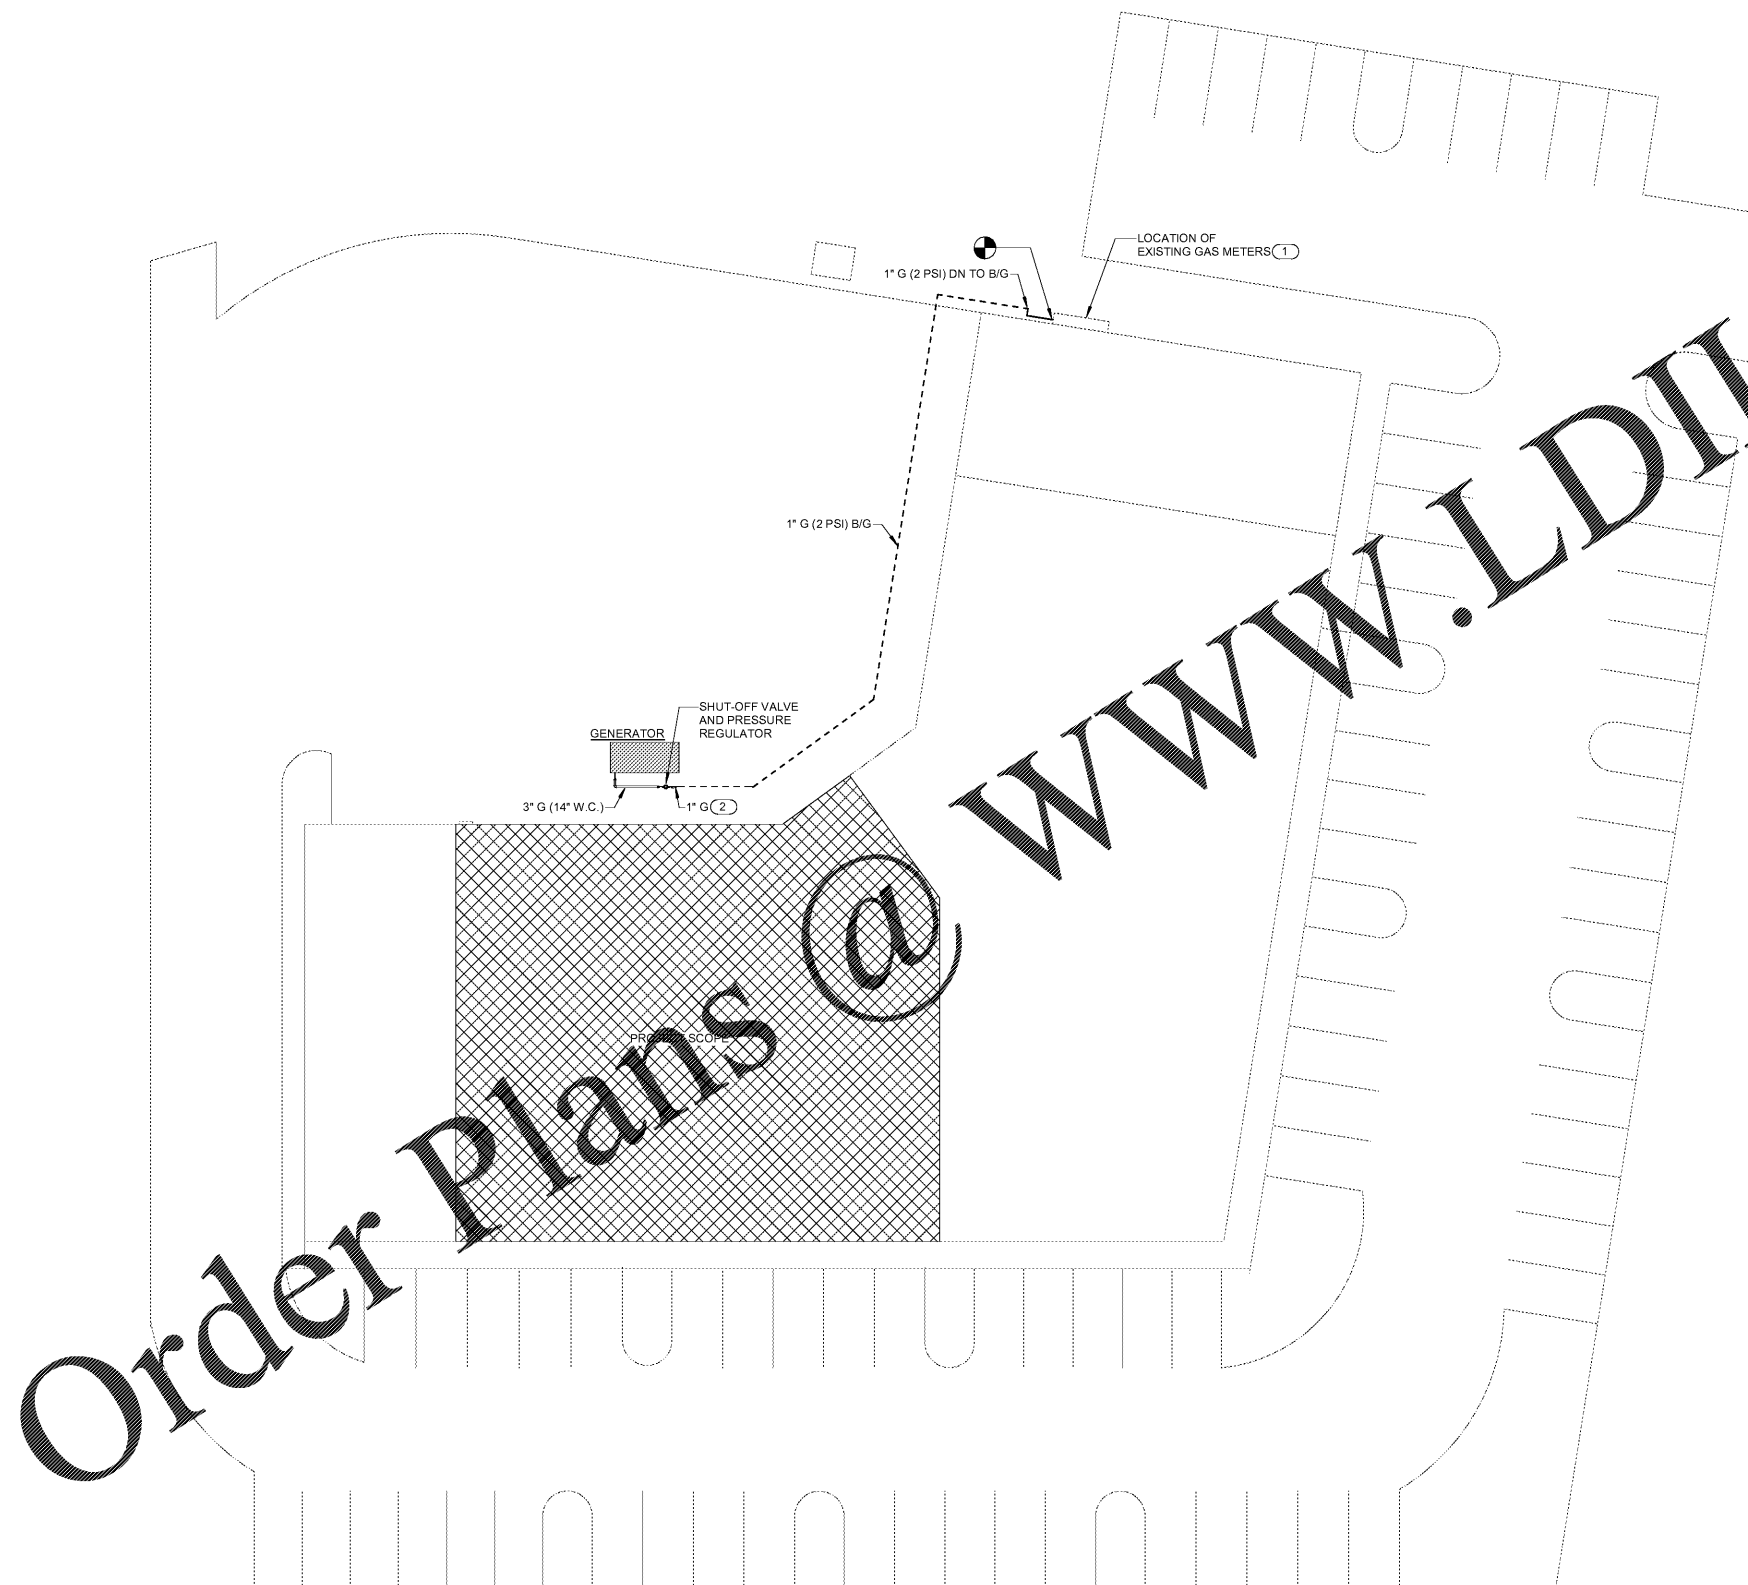

① **OVERALL PLAN**
P1.1 1/16" = 1'-0"

CROSSFIELDS
CHIROPRACTIC OFFICE DESIGN

3265 Brannan Parkway Suite 3015
Kennesaw, GA 30144
Office: 770.424.9220
Web: www.ChiropracticOfficeDesign.com



THIS DRAWING IS THE PROPERTY OF CROSSFIELDS, INC. AND ANY REPRODUCTION OR COPYING OF THIS DRAWING, IN WHOLE OR PART IS PROHIBITED WITH OUT WRITTEN PERMISSION.

**INNOVATION
COMPOUNDING**
DR. SHAWN HODGES
6095 PINE MOUNTAIN RD., SUITE 104
KENNESAW, GA 30152

REVISIONS:

NO.	DATE	DESCRIPTION

DRAWN BY: DS CHECKED BY: MR
DATE: 09.24.19
PROJECT NUMBER: 17125-IC
SHEET NO:

P1.1

ISSUED FOR PERMITTING