


Order Plans @ [www.LDILine.com](http://www.LDILine.com)

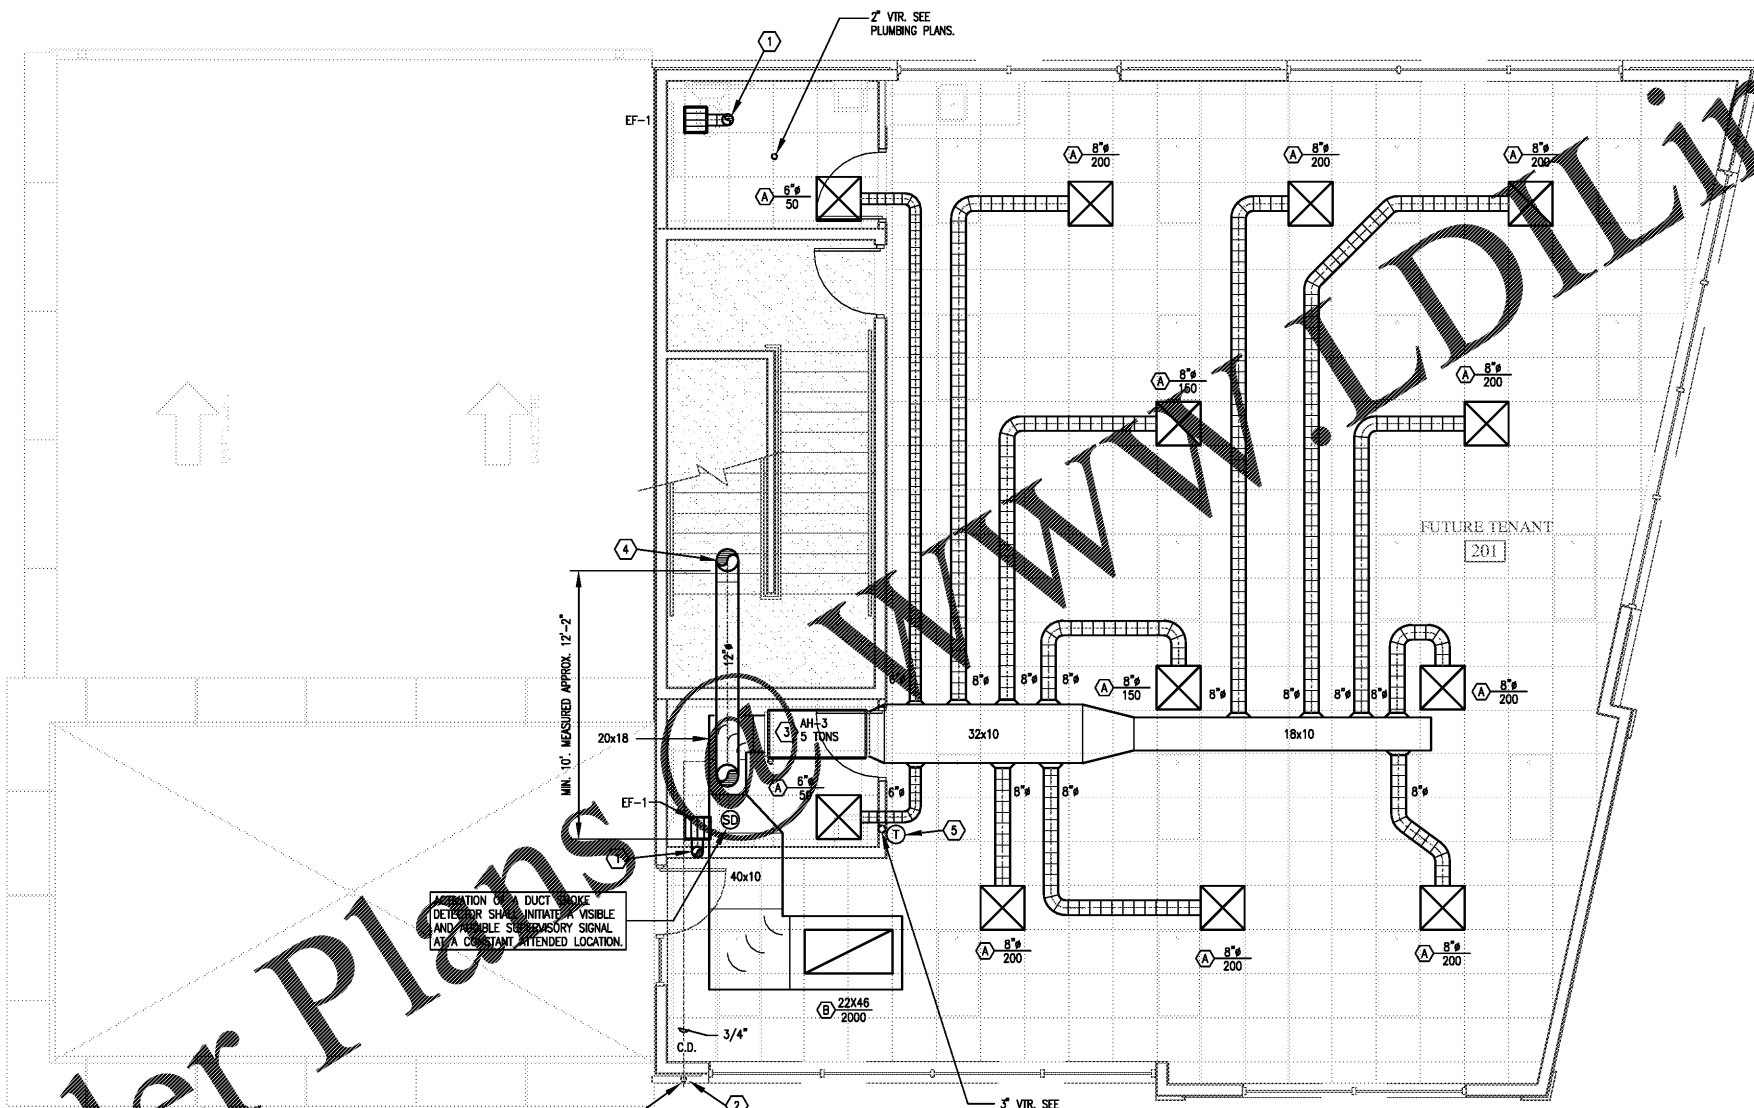

KEY NOTES	
NO.	DATE
1	
2	
3	
4	
5	

- 1 6" EXHAUST UP TO GREENHECK ROOF VENTILATOR MODEL NO. GRSR-8 WITH BACKDRAFT DAMPER & BIRD SCREEN. OFFSET AS REQUIRED TO KEEP 10' MIN. AWAY FROM OUTSIDE AIR.
- 2 ROUTE 3/4" CONDENSATE DRAIN DOWN TO EXTERIOR AREA TO AN APPROVED DISPOSAL WITH A SPLASH BLOCK. PROVIDED WITH CONDENSATE PUMP AS NEEDED. M.C. SHALL FIELD VERIFY EXACT TERMINATION OF CONDENSATE DRAIN. CONDENSATE SHALL NOT DISCHARGE INTO A STREET, ALLEY OR OTHER AREAS SO AS TO CAUSE A NUISANCE.
- 3 AHU SUSPENDED FROM ROOF STRUCTURE. THE CLEARANCE SPACE AROUND AHU IS LIMITED. THE MECHANICAL CONTRACTOR SHALL MAKE A SITE VISIT TO SURVEY THE CONSTRUCTION SPACE PRIOR TO BIDDING & PERFORMING ANY WORK. THE ARCHITECT AND ENGINEER SHOULD BE NOTIFIED OF ANY DISCREPANCY BETWEEN THE PLANS AND THE LATEST CONSTRUCTION CONDITIONS.
- 4 12" O.A. DUCT UP TO GREENHECK ROOF VENTILATOR MODEL NO. GRSI-12 WITH BIRDSCREEN. OFFSET AS REQUIRED TO KEEP MIN. OF 10' AWAY FROM EXHAUST AIR.
- 5 M.C. SHALL VERIFY EXACT LOCATION OF THERMOSTAT WITH OWNER/TENANT PRIOR TO INSTALLING THERMOSTAT. TYPICAL.

1 2ND FLOOR MECHANICAL PLAN  
M-3 1/4"=1'-0"

OPERATION OF DUCT SHOCK DETECTOR SHALL INITIATE A VISIBLE AND AUDIBLE SUPPLEMENTARY SIGNAL AT A CONSTANT ATTENDED LOCATION.

M.C. SHALL FIELD VERIFY EXACT TERMINATION OF CONDENSATE DRAIN. CONDENSATE SHALL NOT DISCHARGE INTO A STREET, ALLEY OR OTHER AREAS SO AS TO CAUSE A NUISANCE.

FOR PRICING ONLY

REVISIONS	
NO.	DATE