


Order Plans @

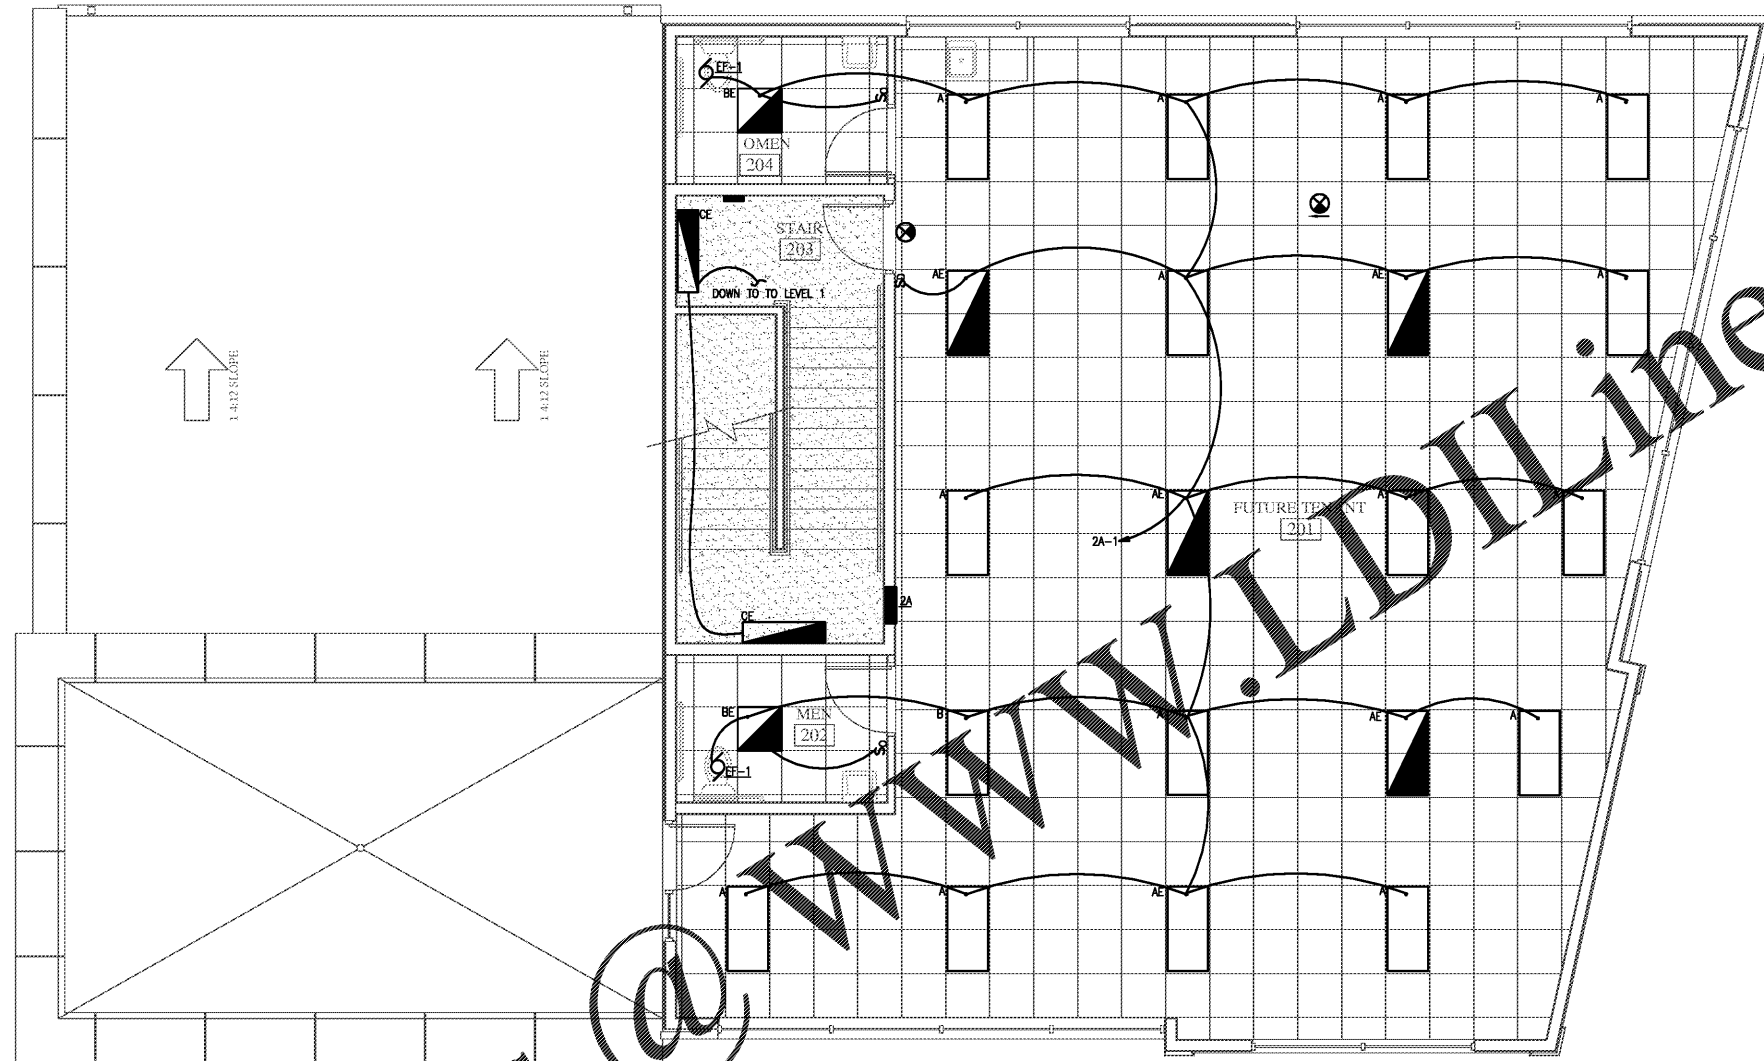

1 2ND FLOOR LIGHTING PLAN
E-3 1/4"=1'-0"

GENERAL NOTES:

- A. ALL EXIT/EM LIGHTS SHALL BE CONNECTED TO NEAREST CIRCUIT AHEAD OF SWITCHING. ALL EXIT AND EMERGENCY BATTERIES SHALL BE TESTED. REPLACE FIXTURE IF BATTERY IS NOT OPERATING.
- B. ALL EXTERIOR LIGHTING ARE NEW AND CONTROLLED BY TIMECLOCK 'ON' AND TIMECLOCK 'OFF'.

www.lidline.com

FOR PRICING ONLY

REVISIONS	
NO.	DATE