


Order Plans @

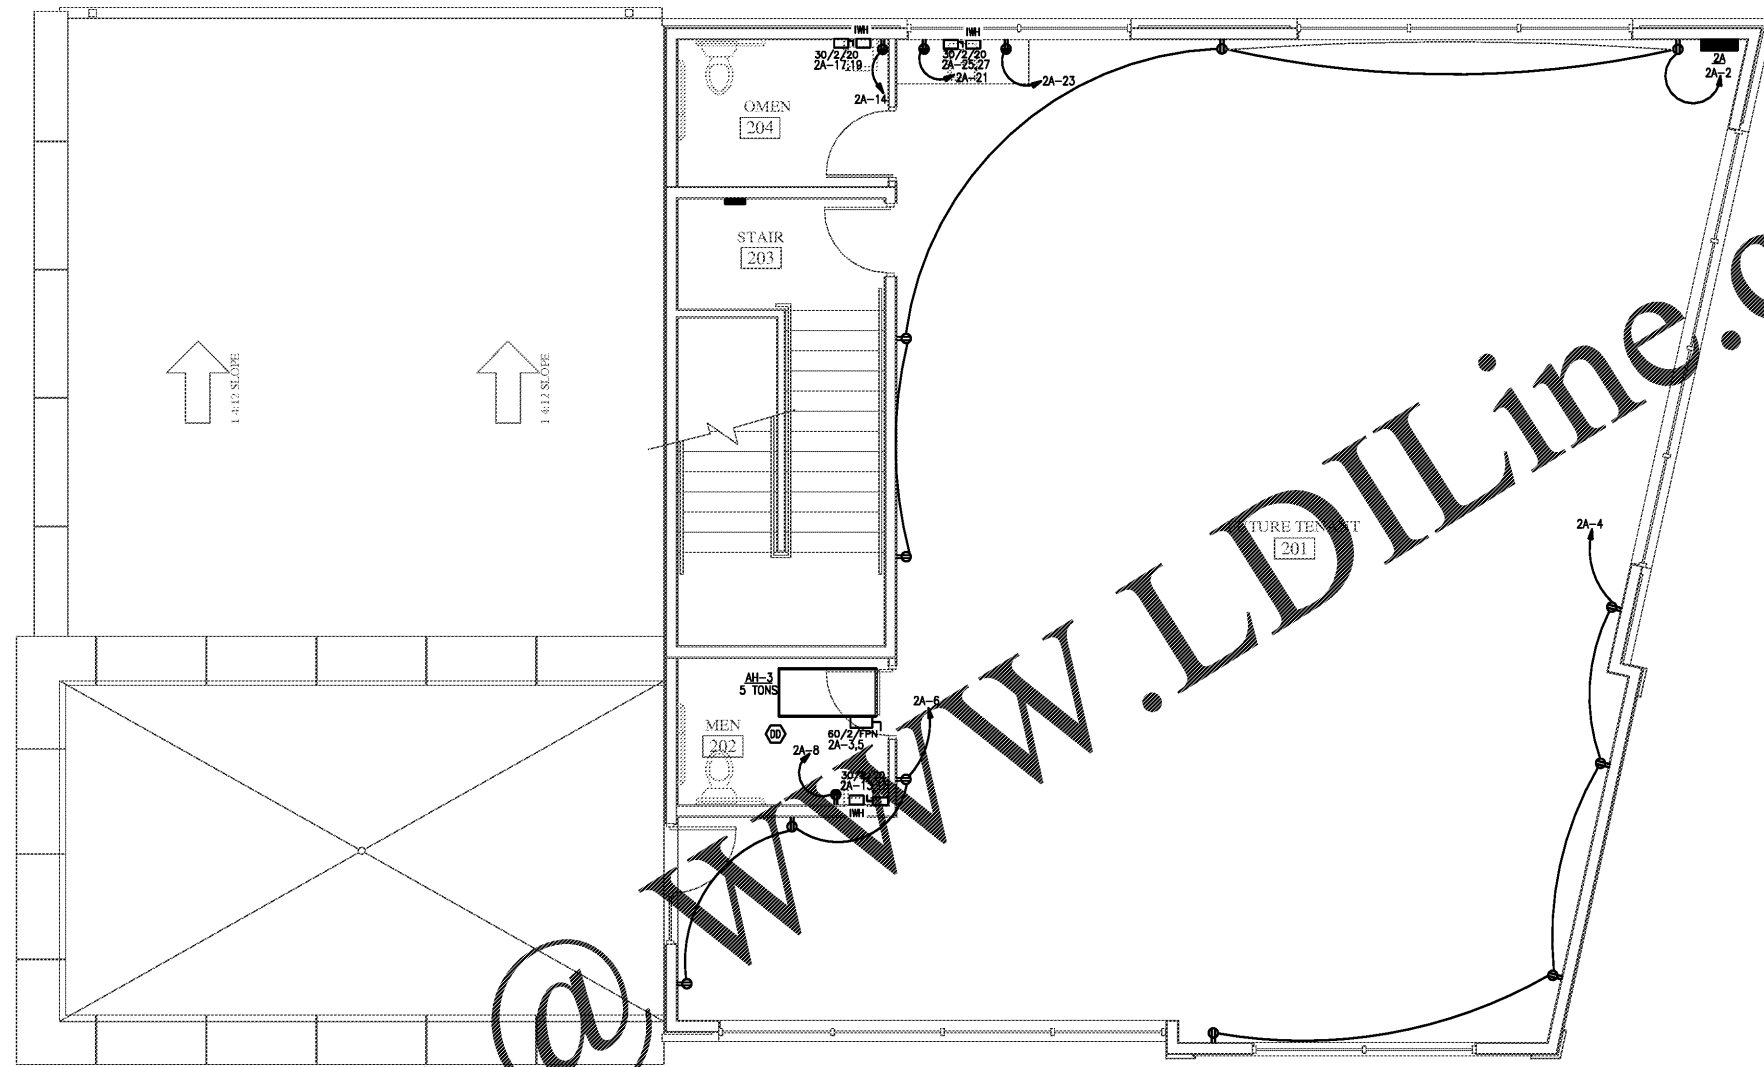

1 2ND FLOOR POWER PLAN  
E-5 1/4"=1'-0"

GENERAL NOTES:

- A. ALL CIRCUITS SHALL BE CONNECTED TO PANELS 'P1' OR 'P2', U.N.O.
- B. MOUNT RECEPTACLES AT 18" AFF U.N.O. RECEPTACLES WITHIN 6" OF A SINK SHALL BE GFCI.
- C. COORDINATE LOCATION OF TELEPHONE BACKBOARD W/ OWNER.
- D. COORDINATE DUCT DETECTOR INSTALLATION WITH MECHANICAL CONTRACTOR.

FOR PRICING ONLY

REVISIONS	
NO.	DATE