

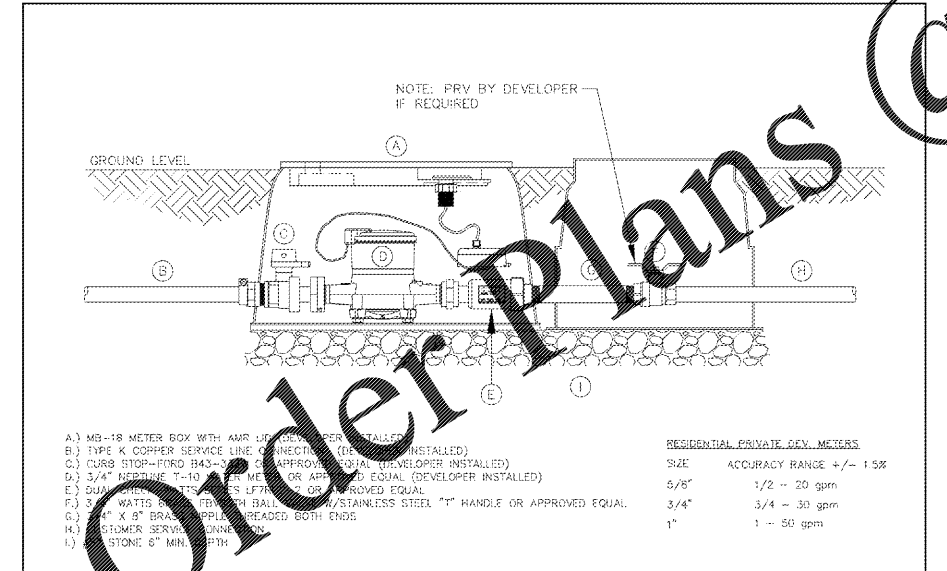
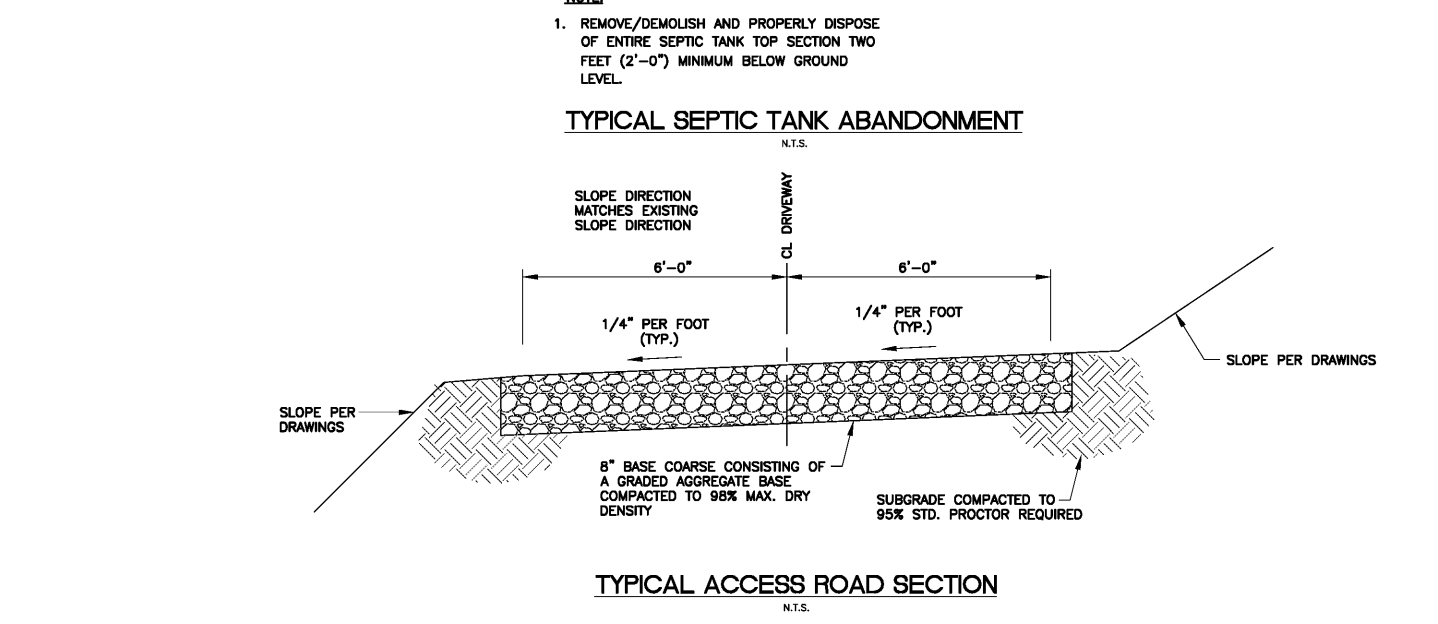


	<b>COWETA COUNTY WATER AND SEWERAGE AUTHORITY</b> 545 CORINTH ROAD NEWNAN, GA 30263 (770) 254-3710	<b>RESIDENTIAL SERVICE CONNECTION</b>	<b>W-0015</b>
	DESIGNED: CORBA DATE: 03/13	DRAWN: AP SCALE: NTS	CHECKED: [ ] DATE: [ ]

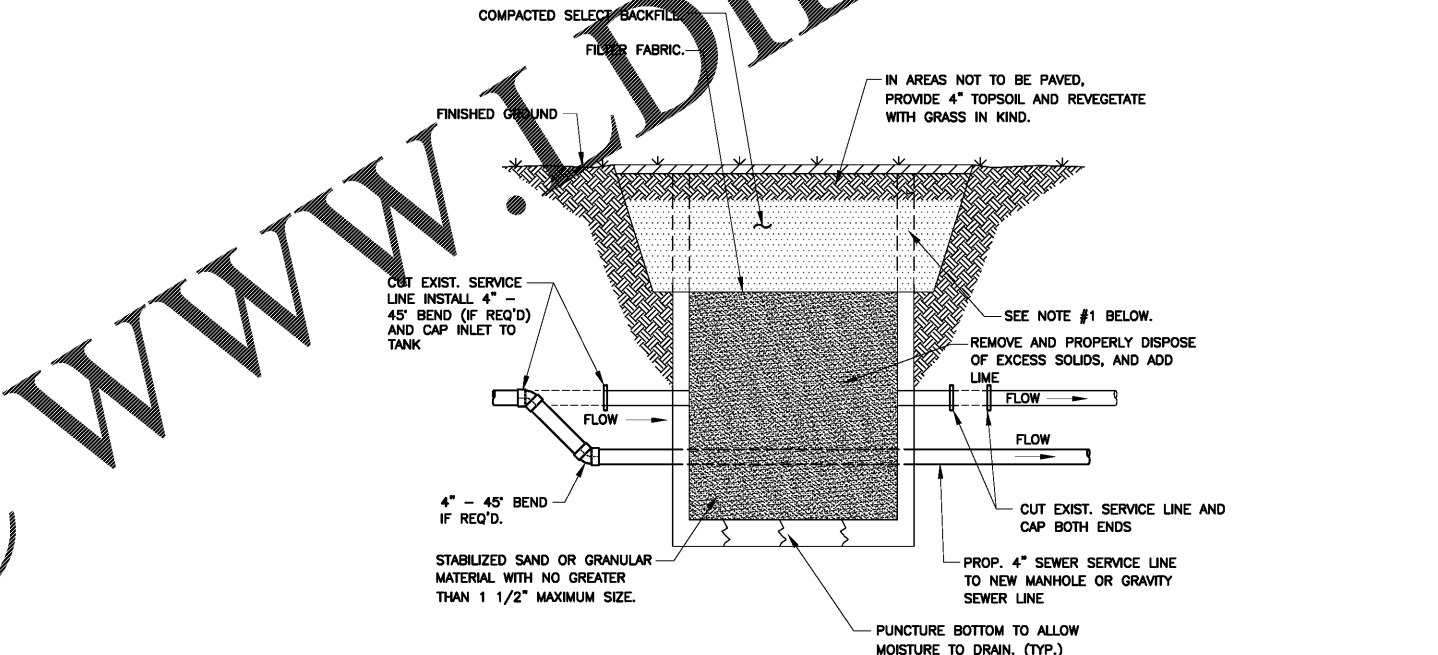

	<b>COWETA COUNTY WATER AND SEWERAGE AUTHORITY</b> 545 CORINTH ROAD NEWNAN, GA 30263 (770) 254-3710	<b>TYPICAL INSTALLATION RESIDENTIAL SERVICE APPLICATION</b>	<b>W-0015A</b>
	DESIGNED: CORBA DATE: 02/04	DRAWN: AP SCALE: NTS	CHECKED: [ ] DATE: [ ]

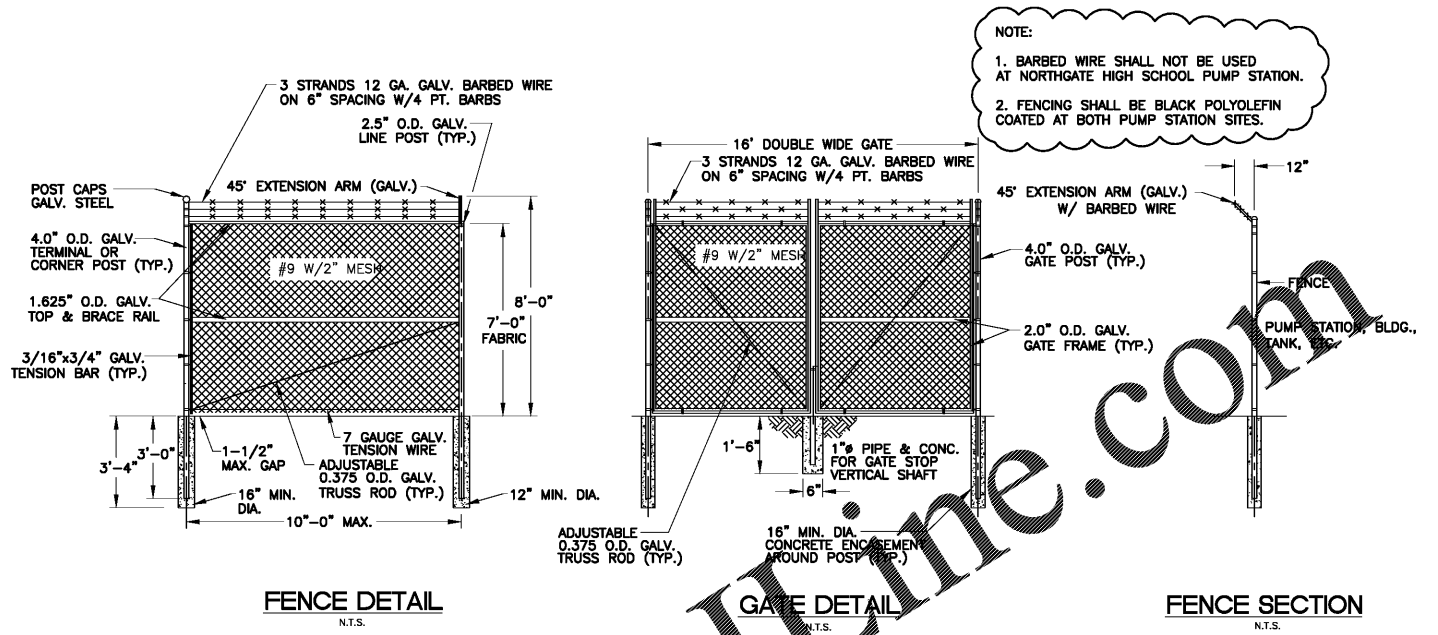

NOTE:  
 1. BARBED WIRE SHALL NOT BE USED AT NORTHGATE HIGH SCHOOL PUMP STATION.  
 2. FENCING SHALL BE BLACK POLYOLEFIN COATED AT BOTH PUMP STATION SITES.

DRAWING FILE: C:\Projects\Coweta\CA1190025 - Northgate High School Sanitary Sewer\DWG\CA1190025-MISC.dwg  
 PLOTTED: Oct 17, 2019 - 8:27am

# GMC

6120 Powers Ferry Road NW, Suite 350  
 Atlanta, GA 30339  
 T 770.952.2481  
 GMCNETWORK.COM

ISSUE	DATE
PRELIMINARY	08.15.2019
75% SUBMITTAL	10.01.2019
BID READY	10.18.2019
DRAWN BY:	
CHECKED BY:	

NORTHGATE HIGH SCHOOL  
 SANITARY SEWER  
 COWETA COUNTY WATER AND SEWERAGE AUTHORITY  
 CATL190025



MISCELLANEOUS STANDARD DETAILS  
**C.44**  
 sheet of