

Order Plans

CITY OF AIKEN NOTES

- 1. ALL MATERIALS AND CONSTRUCTION OF PUBLIC WATER INFRASTRUCTURE SHALL CONFORM TO CITY OF AIKEN SPECIFICATIONS...

UTILITY TESTING NOTES

- NOTE: ADDITIONAL TESTING REQUIREMENTS MAY BE REQUIRED BY PUBLIC UTILITY OWNERS TO WHICH THE MAINS WILL BE DEDICATED...

SCDHEC WATER SPECIFICATIONS

- 1. ALL MATERIAL OR PRODUCTS WHICH COME INTO CONTACT WITH DRINKING WATER SHALL BE THIRD PARTY CERTIFIED AS MEETING THE SPECIFICATIONS OF THE AMERICAN NATIONAL INSTITUTE OF SANITATION FOUNDATION...




UTILITY NOTES

- 1. ALL FILL MATERIAL IS TO BE IN PLACE AND COMPACTED BEFORE INSTALLATION OF PROPOSED UTILITIES...

UTILITY PIPE NOTES

- 1. SANITARY SEWER PIPE
1.1 PVC SANITARY SEWER PIPE
1.1.1 MANUFACTURED PER ASTM D 3034, SDR 35...

ALL WATER BENDS SHALL HAVE THURST BLOCKING, SEE DETAIL
WATER LINES 1/2" AND LARGER MAY USE MEGA LUGS IN- LIEU OF THURST BLOCKING, IF USED, MEGA LUGS SHALL BE INSTALLED ON BOTH ENDS OF FITTING.
ALL WATER METERS, BACKFLOW PREVENTERS, AND HYDRANTS SHALL BE INSTALLED PER CITY OF AIKEN SPECIFICATIONS

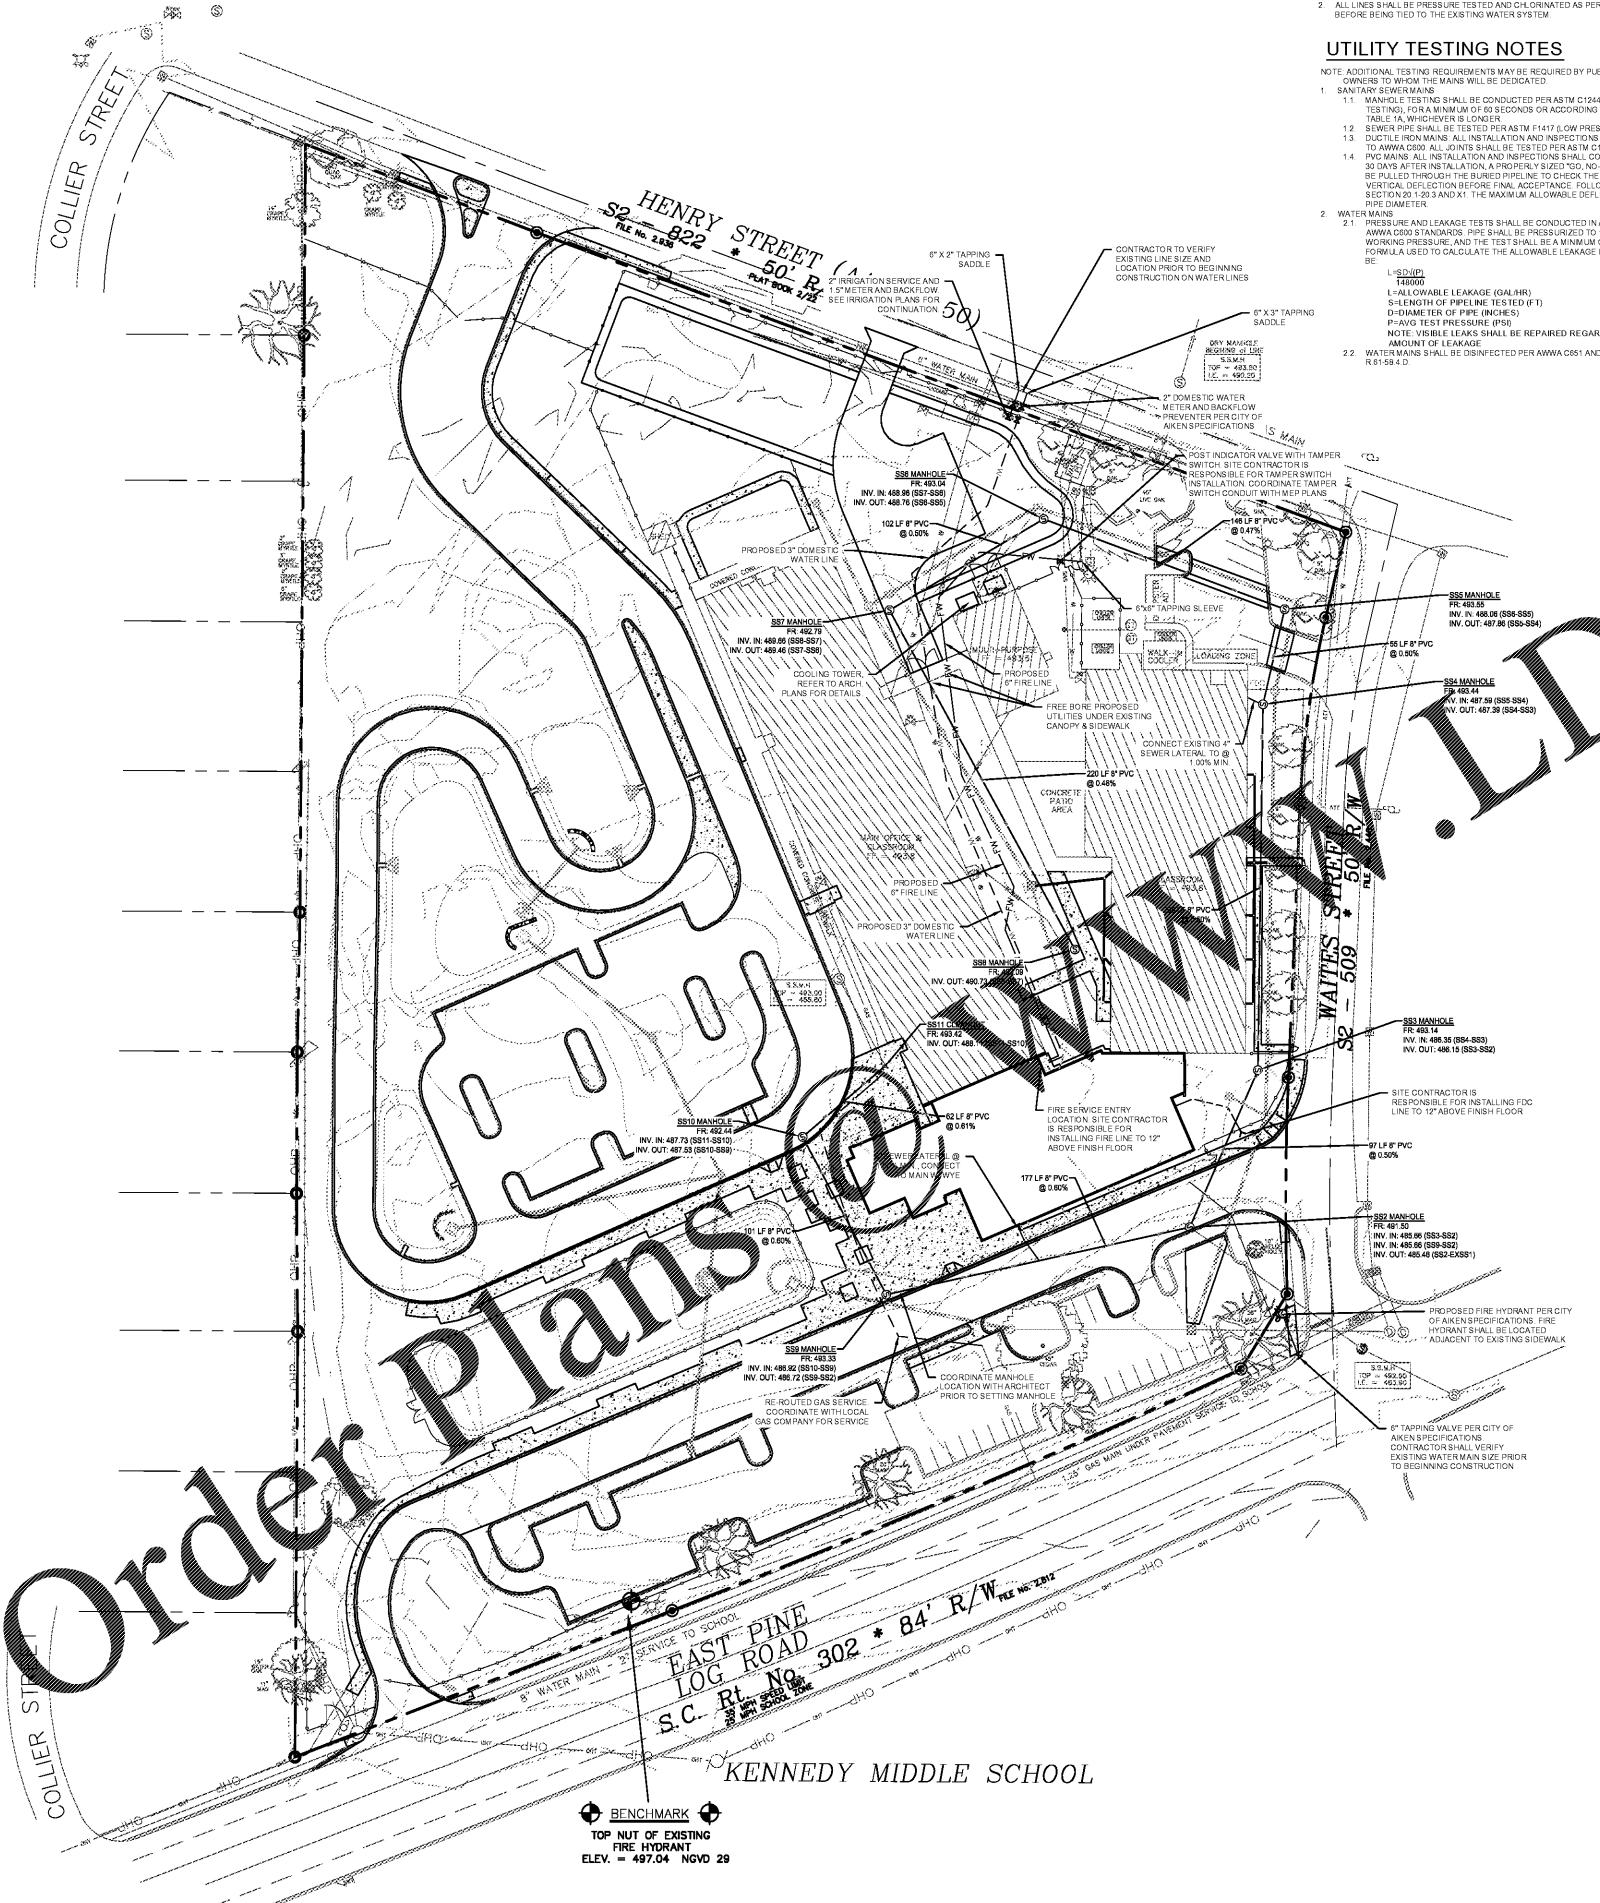

GMC logo and contact information: 617 East McBee Ave, Suite 200, Greenville, SC 29601. Includes project title 'UTILITY PLAN' and drawing number 'C-301'.