




BOILER ROOM PIPING SCHEMATIC - RENOVATION (BASE BID)
NOT TO SCALE

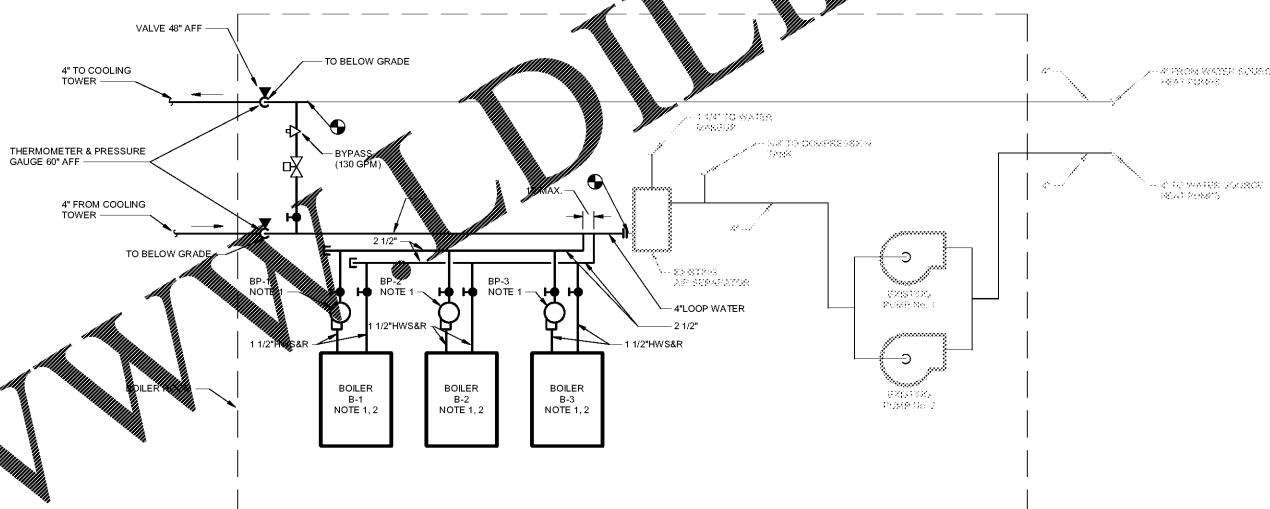

BOILER ROOM PIPING SCHEMATIC - RENOVATION (ALTERNATE No. 2)
NOT TO SCALE

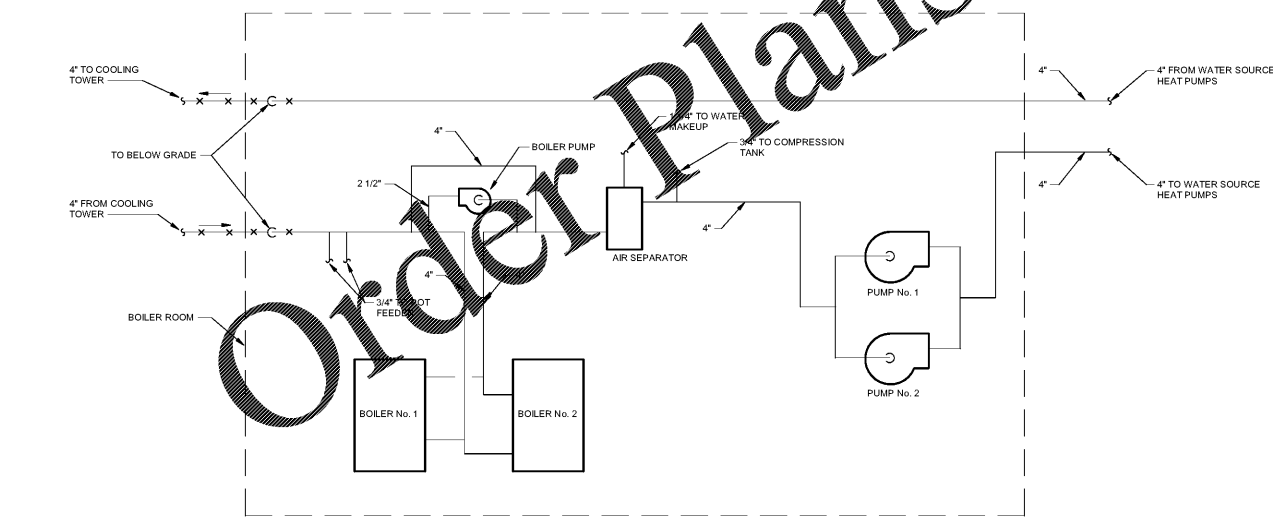

EXISTING BOILER PIPING SCHEMATIC - DEMOLITION (BASE BID)
NOT TO SCALE

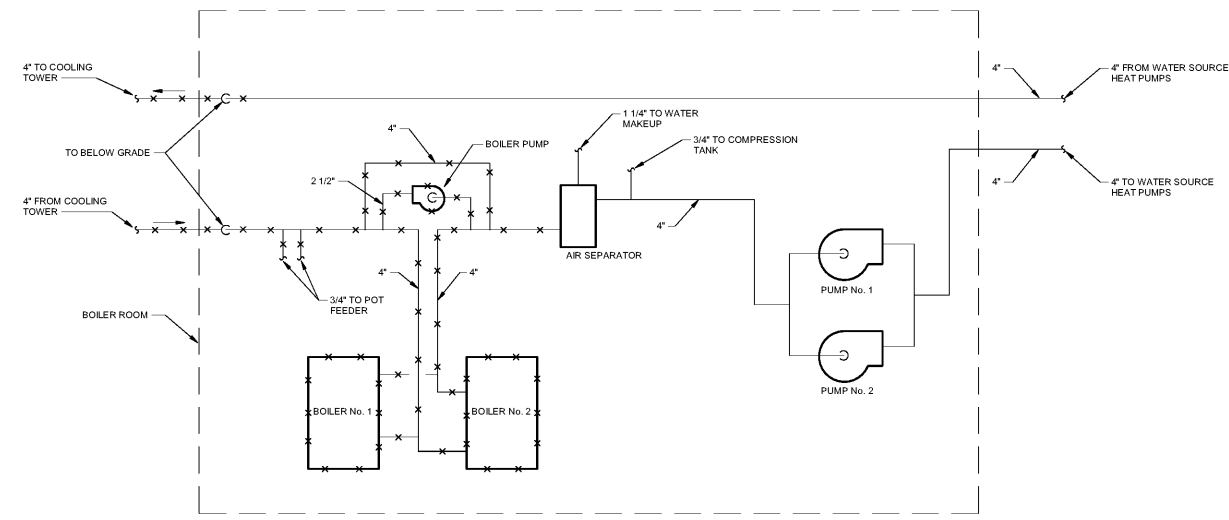

BOILER ROOM PIPING SCHEMATIC - DEMOLITION (ALTERNATE No. 2)
NOT TO SCALE

NOTES
1. SEE LIST FOR ADDITIONAL EQUIPMENT REQUIREMENTS.
PIPE TO BOILER MAY BE TO TOP OF BOILER OR TO BOTTOM OF BOILER DEPENDING UPON MANUFACTURER SELECTED.
ROUTING PIPING MAINTAINING REQUIRED SERVICE CLEARANCE.

WWW.DILine.com



ISSUE	DATE
BID DOCUMENTS	10.24.19

DRAWN BY: JSS
CHECKED BY: DER