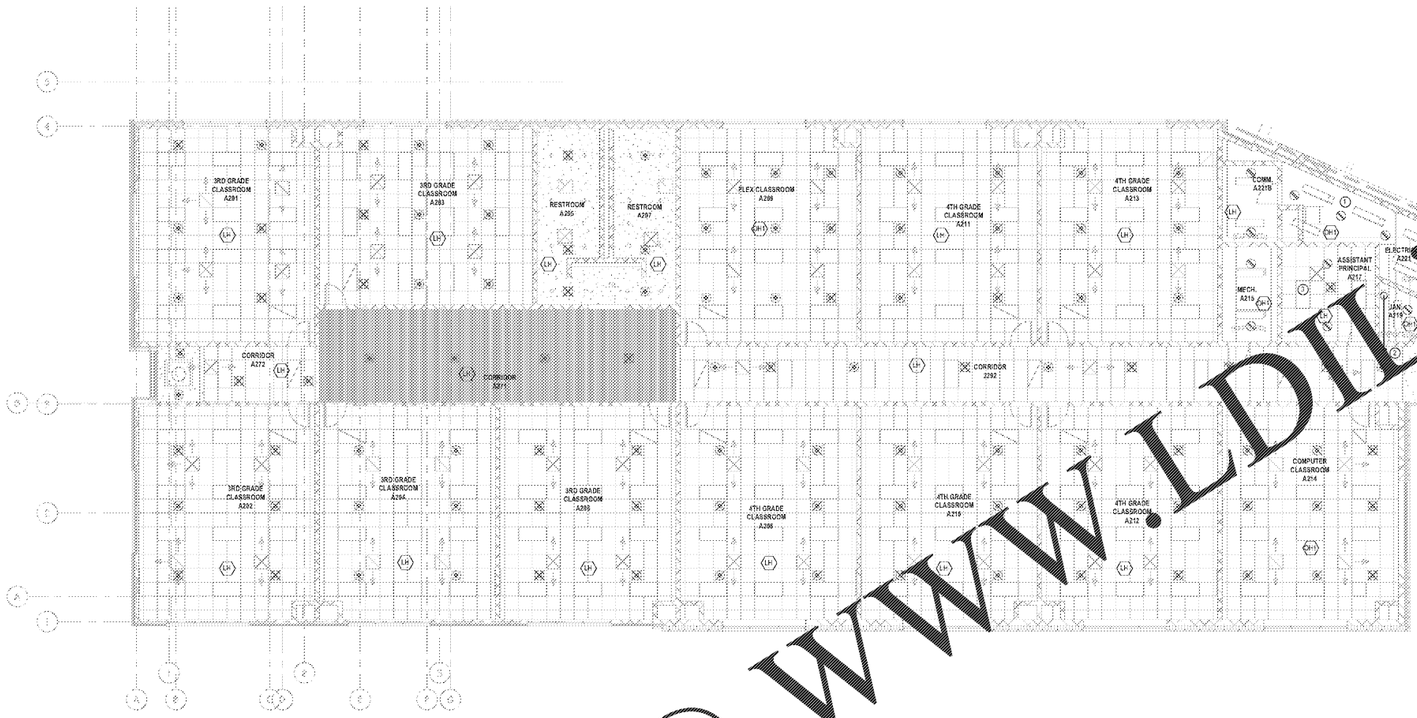

1 SECOND LEVEL - CLASSROOM ADDITION
1/8" = 1'-0"

NOTES:

1. ONLY PIPING SERVING THIS ROOM SHALL ENTER THIS ROOM. PIPING SHALL NOT BE ROUTED ABOVE ELECTRICAL PANELS. REFER TO ELECTRICAL DRAWINGS FOR PANEL LOCATIONS.
2. SPRINKLER LINE UP FROM FIRST FLOOR. CONNECT TO SECOND FLOOR SPRINKLER SYSTEM.
3. WALL BETWEEN MECH 2293A AND ASSISTANT PRINCIPAL 2214 DOES NOT EXTEND TO STRUCTURE. SPRINKLER COVERAGE SHALL EXTEND FROM MECH 2293A TO ABOVE ASSISTANT PRINCIPAL 2214 PER NFPA 13 2013 8.15.23.3.1.
4. SPRINKLER PIPING SHALL BE ROUTED TO AVOID ROOF HATCH.

Order Plans @ WWW.LDLine.com

0' 4' 8' 16' 32'
SCALE 1/8" = 1'-0"

KEY PLAN



GMC

1219 Wayne
Columbia, SC
T
GMCNETWORK.CO

SOUTH CAROLINA
BUFORD GOFF & ASSOCIATES, INC.
No. 000022
CERTIFICATE OF AUTHORIZATION

SOUTH CAROLINA
No. 12514
MARK L. WATTS

Buford Goff & Associates, Inc.
Engineers & Planners
650 Dearmond Ave
Columbia, SC 29205
Phone: 803.254.4552

ISSUE	DATE
BID DOCUMENTS	10.24.19

DRAWN BY: BKT
CHECKED BY: MLW

MILLBROOK ELEMENTARY
SCHOOL - ADDITIONS AND
RENOVATIONS

255 E PINE LOG RD, AIKEN, SC
29803
GMC # ACOL180004

SECOND LEVEL -
CLASSROOM
ADDITION

F1.12

10/17/2019 9:47:06 AM