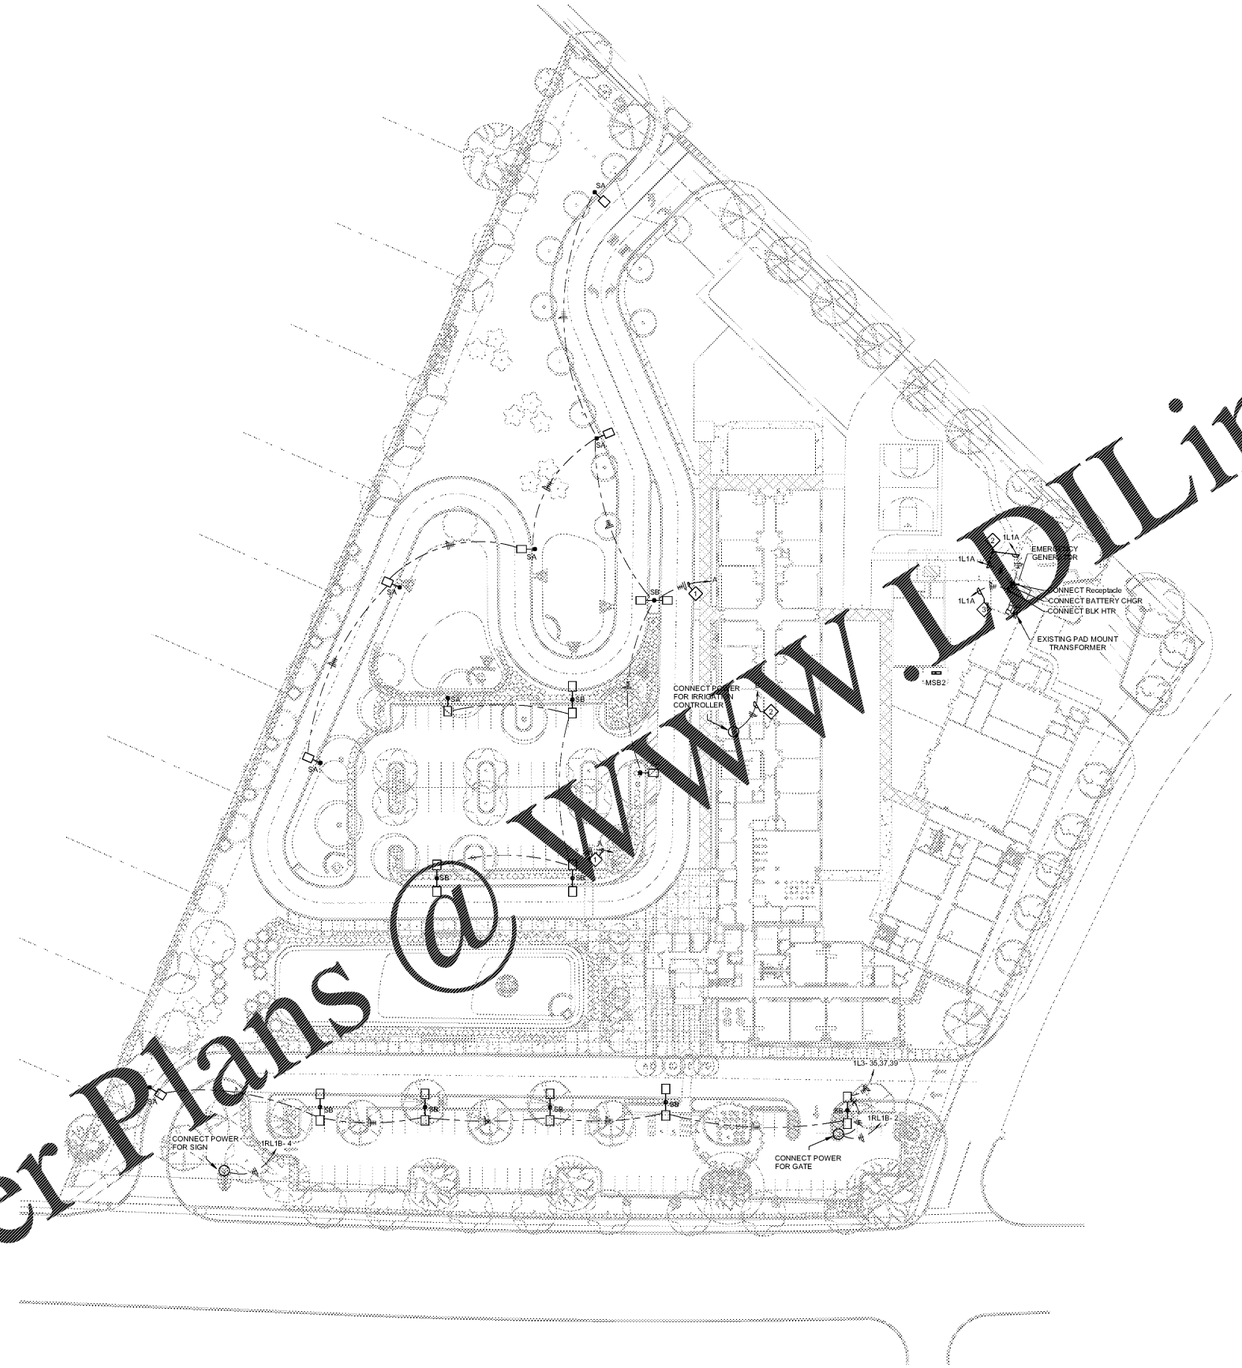

A2 E0.01 **SITE PLAN - ELECTRICAL**
1" = 40'-0"

NORTH

KEYNOTES

1. PROVIDE (4) #10 + #10 GROUND IN 1-1/2" CONDUIT TO NEW 20A 3P BREAKER IN PANEL INDICATED BY HOME RUN.
2. PROVIDE 3/4"C., (2) #12 + #12 GROUND TO SPARE 20A 1P CIRCUIT BREAKER IN PANEL INDICATED BY HOME RUN.
3. PROVIDE 3/4"C., (2) #10 + #10 GROUND TO NEW 30A 2P CIRCUIT BREAKER IN PANEL INDICATED BY HOME RUN.

Order Plans @ WWW.LDILine.com

GMC

1219 Wayne Street
Columbia, SC 29201
T 803.766.1235
GMCNETWORK.COM

SOUTH CAROLINA BUFORD GOFF & ASSOCIATES, INC. No. 000022 CERTIFICATE OF AUTHORIZATION

SOUTH CAROLINA PROFESSIONAL ENGINEER 10/24/2019 BRIAN CURTIS MELSON

Buford Goff & Associates, Inc. Engineers & Planners

ISSUE	DATE
BID DOCUMENTS	10.24.19

DRAWN BY: MTFH
CHECKED BY: BCM

MILLBROOK ELEMENTARY SCHOOL - ADDITIONS AND RENOVATIONS

255 E PINE LOG RD,
AIKEN, SC 29803
GMC # ACOL180004

SITE PLAN - ELECTRICAL

E0.01

10/17/2019 11:52:27 AM