KEYNOTES

1. ABOVE CEILING JUNCTION BOX FOR CONNECTION OF AREA EMERGENCY LIGHTING CIRCUITS.
2. PROVIDE CIRCUITING, LIGHT SWITCHES, OCCUPANCY SENSORS, POWER SUPPLIES, AND RELATED EQUIPMENT SIMILAR TO ROOM 2115 FOR A COMPLETE AND OPERATIONAL LIGHTING SYSTEM.
3. CONNECT THROUGH BODINE GTD20A (BCELTS). NORMAL FEED TO BCELTS SHALL BE CIRCUITED TO PANEL INDICATED AND CONNECTED THROUGH BUILDING PERIMETER LIGHTING CONTACTOR. CONTACTOR SHALL CONTROL ON/OFF FUNCTION OF EXTERIOR BUILDING MOUNTED LIGHTING. EXTEND UNSWITCHED CONDUCTOR FROM CIRCUIT TO BCELTS FOR NORMAL POWER SENSE. EMERGENCY FEED TO BCELTS SHALL BE PROVIDED FROM CIRCUIT INDICATED.
4. RELOCATE EXISTING FIXTURES AS SHOWN.

GENERAL NOTES

1. COORDINATE INSTALLATION OF LIGHTING FIXTURES IN MECHANICAL ROMS WITH DUCTWORK, PIPING AND EQUIPMENT INSTALLATIONS.
2. SEE EMERGENCY LIGHTING NOTES, E1.00.
3. TYPICAL SPACES ARE FOR REFERENCE ONLY. CONTRACTOR SHALL PROVIDE CIRCUITING AND SHALL LOCATE OCCUPANCY SENSORS AND SWITCH STATIONS REQUIRED FOR SPACE. CORRECT AREA COVERAGE SHALL BE PROVIDED AS REQUIRED WHERE OCCUPANCY SENSORS ARE INDICATED.
4. SEE ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS OF WALL AND PENDANT MOUNTED LIGHTING FIXTURES
5. ALL CIRCUITING (CONTROL AND LINE VOLTAGE) SHALL BE IN STALLED IN 3/4" CONDUIT.

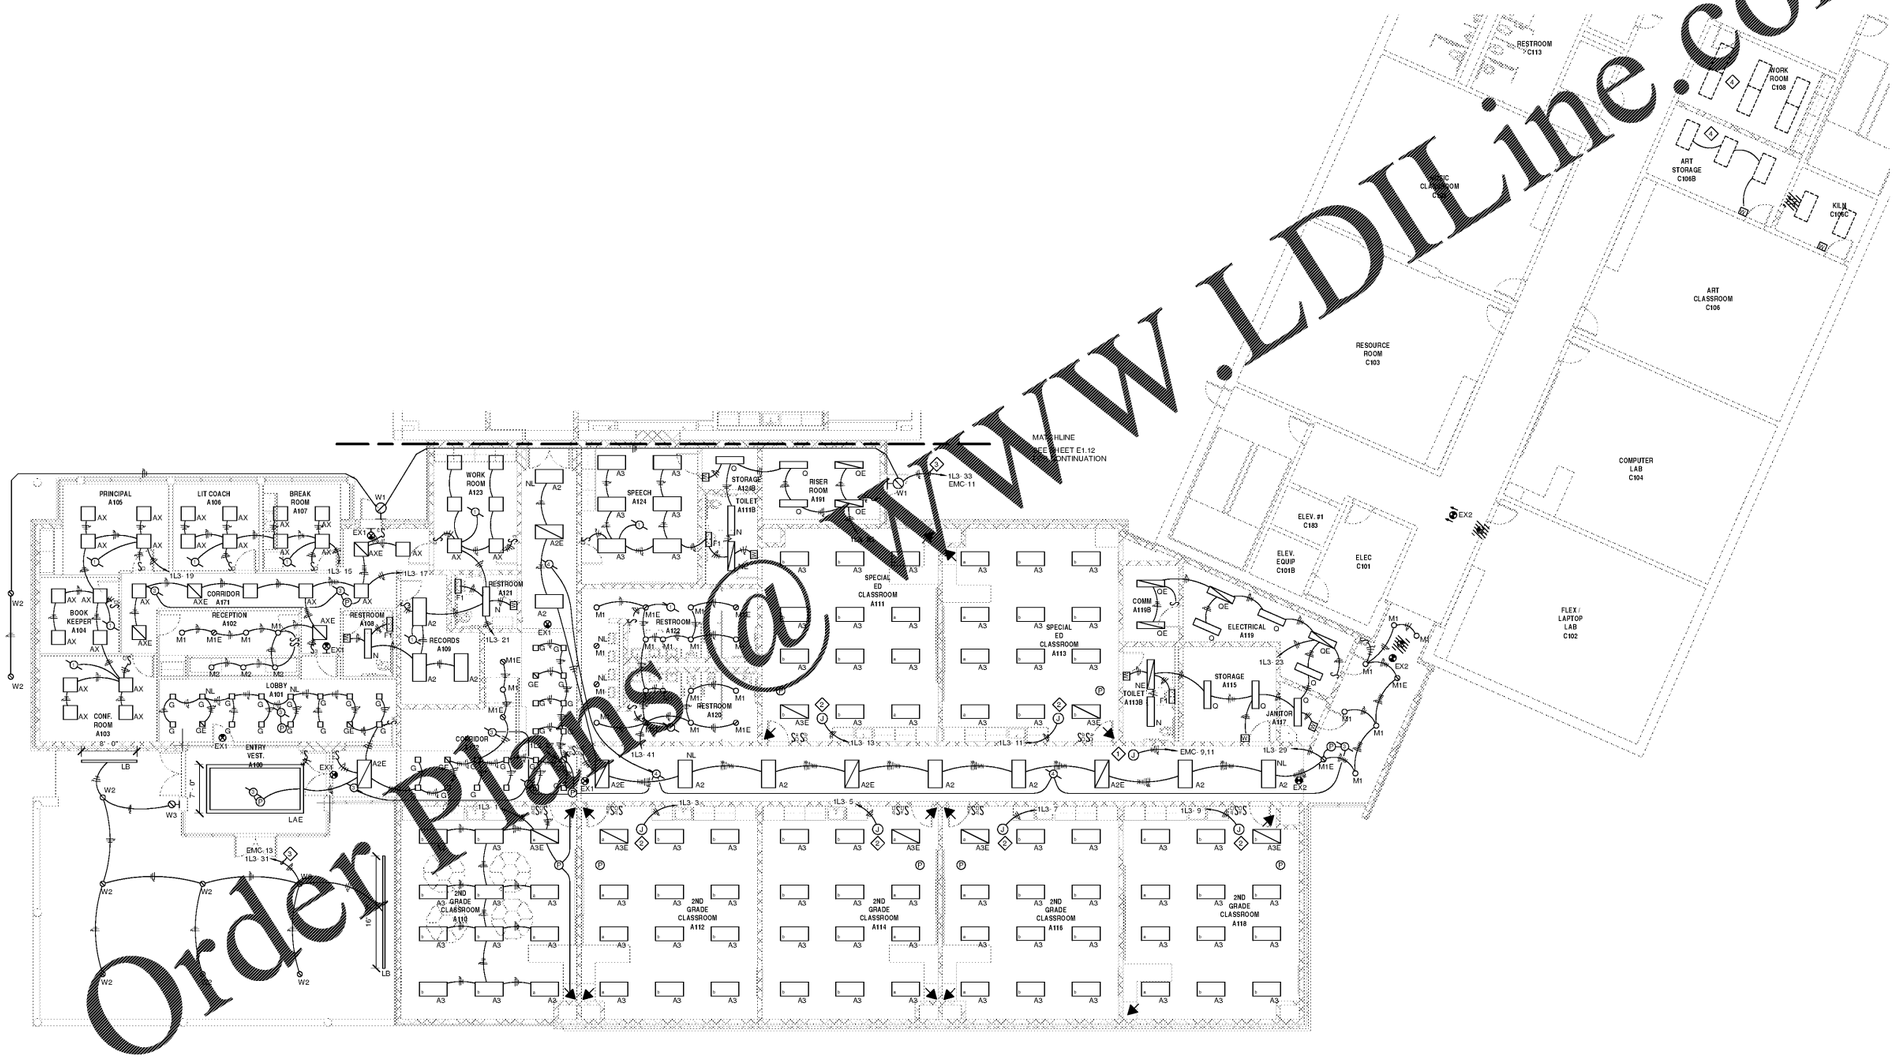

A1 / E1.11 FIRST LEVEL FLOOR PLAN - CLASSROOM ADDITION - LIGHTING
1/8" = 1'-0"

KEY PLAN



Order Plans @ www.LDILine.com

GMC
1219 Wayne Street
Columbia, SC 29201
T 803.766.1235
GMCNETWORK.COM

SOUTH CAROLINA BUFORD GOFF & ASSOCIATES, INC. No. 000022 CERTIFICATE OF AUTHORIZATION

SOUTH CAROLINA PROFESSIONAL ENGINEER BRIAN CURTIS MELSON 10/24/2019

Buford Goff & Associates, Inc. Engineers & Planners
1331 Pleasant Ave. Suite 200 Columbia, SC 29201 Phone: (803) 214-6000

ISSUE	DATE
BID DOCUMENTS	10.24.19

DRAWN BY: MTFH
CHECKED BY: BCM

MILLBROOK ELEMENTARY SCHOOL - ADDITIONS AND RENOVATIONS

255 E PINE LOG RD,
AIKEN, SC 29803
GMC # ACOL180004

FIRST LEVEL FLOOR PLAN - CLASSROOM ADDITION- LIGHTING

E1.11

10/28/2019 2:57:24 PM