GENERAL NOTES

1. COORDINATE INSTALLATION OF LIGHTING FIXTURES IN MECHANICAL ROMS WITH DUCTWORK, PIPING AND EQUIPMENT INSTALLATIONS.
2. SEE EMERGENCY LIGHTING NOTES, E1.00.
3. TYPICAL SPACES ARE FOR REFERENCE ONLY. CONTRACTOR SHALL PROVIDE CIRCUITING AND SHALL LOCATE OCCUPANCY SENSORS AND SWITCH STATIONS REQUIRED FOR SPACE. CORRECT AREA COVERAGE SHALL BE PROVIDED AS REQUIRED WHERE OCCUPANCY SENSORS ARE INDICATED..
4. SEE ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS OF WALL AND PENDANT MOUNTED LIGHTING FIXTURES
5. ALL CIRCUITING (CONTROL AND LINE VOLTAGE) SHALL BE IN STALLED IN 3/4" CONDUIT.

KEYNOTES

1. IN DSE CEILING JUNCTION BOX FOR CONNECTION OF AREA EMERGENCY LIGHTING CIRCUITS.
2. PROVIDE CIRCUITING, LIGHT SWITCHES, OCCUPANCY SENSORS, POWER SUPPLIES, AND RELATED EQUIPMENT SIMILAR TO ROOM A212 FOR A COMPLETE AND OPERATIONAL LIGHTING SYSTEM.

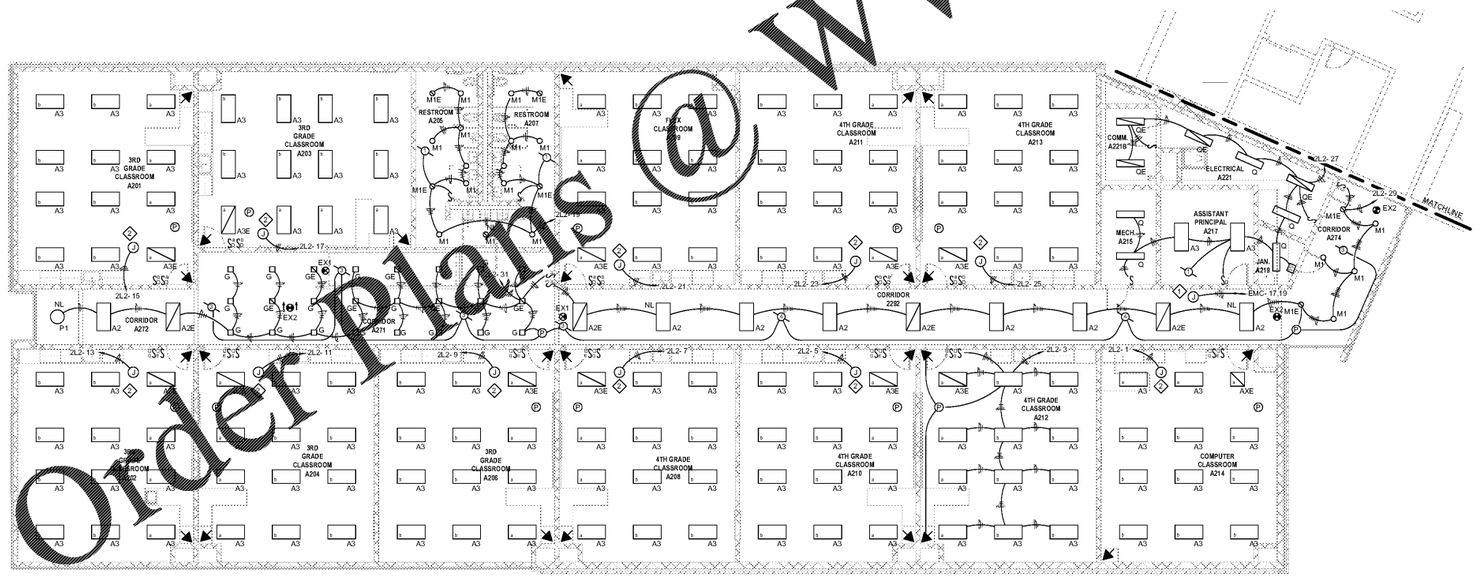

1 / E1.21 **SECOND LEVEL FLOOR PLAN - CLASSROOM ADDITION - LIGHTING**
1/8" = 1'-0"

KEY PLAN

Order Plans @ WWW.LDILine.com

GMC
1219 Wayne Street
Columbia, SC 29201
T 803.766.1235
GMCNETWORK.COM

SOUTH CAROLINA BUFORD GOFF & ASSOCIATES, INC. No. 000022 CERTIFICATE OF AUTHORIZATION

SOUTH CAROLINA PROFESSIONAL ENGINEER 10/24/2019 JOHN CURTIS MELSON

ISSUE	DATE
BID DOCUMENTS	10.24.19

DRAWN BY: MTFH
CHECKED BY: BOM

Buford Goff & Associates, Inc.
Engineers & Planners
131 Sherwood Ave.
Columbia, SC 29201
Phone: (803) 254-4262

MILLBROOK ELEMENTARY
SCHOOL - ADDITIONS AND RENOVATIONS

255 E PINE LOG RD.
AIKEN, SC 29803
GMC # ACOL180004

SECOND LEVEL FLOOR PLAN - LIGHTING

E1.21

10/17/2019 11:53:34 AM