## KEYNOTES

1. CONNECT TO EXISTING 120V 20A 1P CIRCUIT CAPTURED DURING DEMOLITION.
2. 3/4"C., (2) #12 AWG + #12 GROUND TO NEW 20A 1P CIRCUIT BREAKER IN PANEL INDICATED BY HOMERUN.

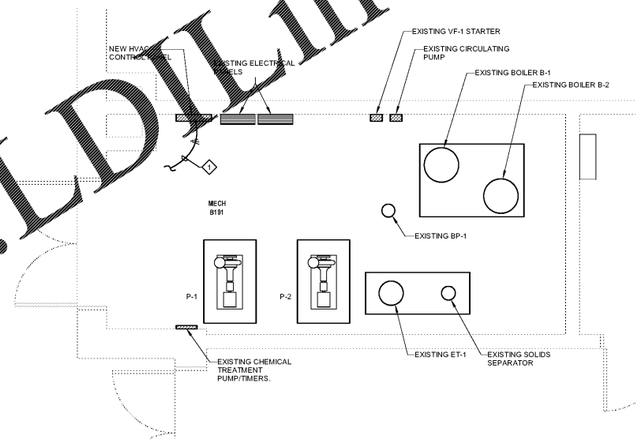


E0 / E2.13 **FIRST LEVEL RENOVATION PLAN - ENLARGED BOILER ROOM (BASE BID) - ELECTRICAL**
3/8" = 1'-0"

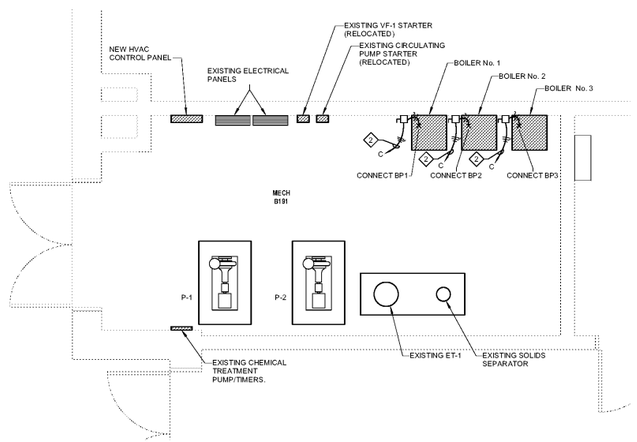


A6 / E2.13 **FIRST LEVEL RENOVATION PLAN - ENLARGED BOILER ROOM (ALTERNATE No. 2) - ELECTRICAL**
3/8" = 1'-0"

Order Plans @ www.LDLine.com

GMC
1219 Wayne Street
Columbia, SC 29201
T 803.766.1235
GMCNETWORK.COM

SOUTH CAROLINA BUFORD GOFF & ASSOCIATES, INC. No. 000022 CERTIFICATE OF AUTHORIZATION

SOUTH CAROLINA PROFESSIONAL ENGINEER CURTIS MELSON 10/24/2019

Buford Goff & Associates, Inc. Engineers & Planners
1331 Elmwood Ave.
Columbia, SC 29201
Phone: (803) 254-4262

| ISSUE | DATE |
|---|---|
| BID DOCUMENTS | 10.24.19 |

DRAWN BY: Author
CHECKED BY: BGM

MILLBROOK ELEMENTARY
SCHOOL - ADDITIONS AND
RENOVATIONS

255 E PINE LOG RD,
AIKEN, SC 29803
**GMC # ACOL180004**

FIRST FLOOR RENOVATION
PLAN - ENLARGED BOILER
ROOM

# E2.13

10/17/2019 11:54:03 AM