

If this document is sealed and signed in a digital or electronic format and is received from someone other than the sealing professional identified in the document, you must contact the sealing professional in writing to validate the authenticity of the document. The sealing professional declares the seal and signature and shall not be liable for any liability associated with it where the authenticity of any digital or electronic seal or signature has not been validated in this manner.

ISSUANCE
 ISSUED FOR CONSTRUCTION
 2019/11/13

REVISIONS
 NO. DATE DESCRIPTION

FILE NUMBER 19199
 PROJECT MANAGER CAD
 PROFESSIONAL CAD
 DRAWN BY CLE
 CHECKED BY BOW

MINI SPLIT SYSTEM SCHEDULE (DUCTED/DUCTLESS)									
TAG	AREA SERVED	EVAPORATOR SECTION			CONDENSING SECTION			ELECTRICAL CONNECTION	DISCONNECT
		MCA	MOCP	VOLTAGE	MCA	MOCP	VOLTAGE		
AC-1/CU-1	111 ELEC/DATA	1	15	208V-1Ø	12.2	15	208V-1Ø	¾"C., 2#12, & 1#12 GND	SPST MOTOR TOGGLE SWITCH

FAN SCHEDULE							
TAG	AREA SERVED	FAN TYPE	ELECTRICAL DATA			ELECTRICAL CONNECTION	DISCONNECT
			H.P.	WATTS	VOLTAGE		
EF-1	10B WOMEN	CEILING EXHAUST	-	17.6	115V-1Ø	¾"C., 2#12, & 1#12 GND	SPST MOTOR TOGGLE SWITCH
EF-2	109 MEN	CEILING EXHAUST	-	17.6	115V-1Ø	¾"C., 2#12, & 1#12 GND	SPST MOTOR TOGGLE SWITCH


GAS FURNACE SCHEDULE					
TAG	ELECTRICAL DATA			ELECTRICAL CONNECTION	DISCONNECT
	MCA	MOCP	VOLTAGE		
EGF-1,2	11.3	15	115V-1Ø	¾"C., 2#12, & 1#12 GND	SPST MOTOR TOGGLE SWITCH

CONDENSING UNIT SCHEDULE					
TAG	ELECTRICAL DATA			ELECTRICAL CONNECTION	DISCONNECT
	MCA	MOCP	VOLTAGE		
CU-1,2	18.6	30	208V-1Ø	¾"C., 2#10, & 1#12 GND	2P/30A/240V/3R/FPN

ELECTRIC WATER HEATER SCHEDULE										
TAG	DESCRIPTION	ELECTRICAL DATA						ELECTRICAL CONNECTION	DISCONNECT	
		GALLONS STORAGE	NO ELEMENTS	KW	TOTAL KW	VOLTAGE	PHASE			HERTZ
WH-1	BUILDING	20	1	3.0	3.0	208	1	60	¾"C., 2#12, & 1#12 GND	2P/30A/240V/1/NF

NOTE:
 ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE MECHANICAL CONTRACTOR FOR EXACT EQUIPMENT BEING FURNISHED UNDER THIS CONTRACT. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL DISCONNECTS, FUSES, REDUCERS, CONTROL CIRCUITS AND CONNECTIONS REQUIRED FOR THE INSTALLATION OF MECHANICAL EQUIPMENT. ALL FUSES SHALL BE PER THE NAME PLATE LABEL.

- NOTES THIS SHEET**
- ① CONNECT TO LOCAL LIGHTING CIRCUIT SERVING THIS AREA. FAN SHALL BE SWITCHED WITH LIGHTING.
 - ② EQUIPMENT LOCATED ON THE GROUND AT THE BACK OF THE BUILDING. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR.
 - ③ EQUIPMENT LOCATED ABOVE THE ACT CEILING.

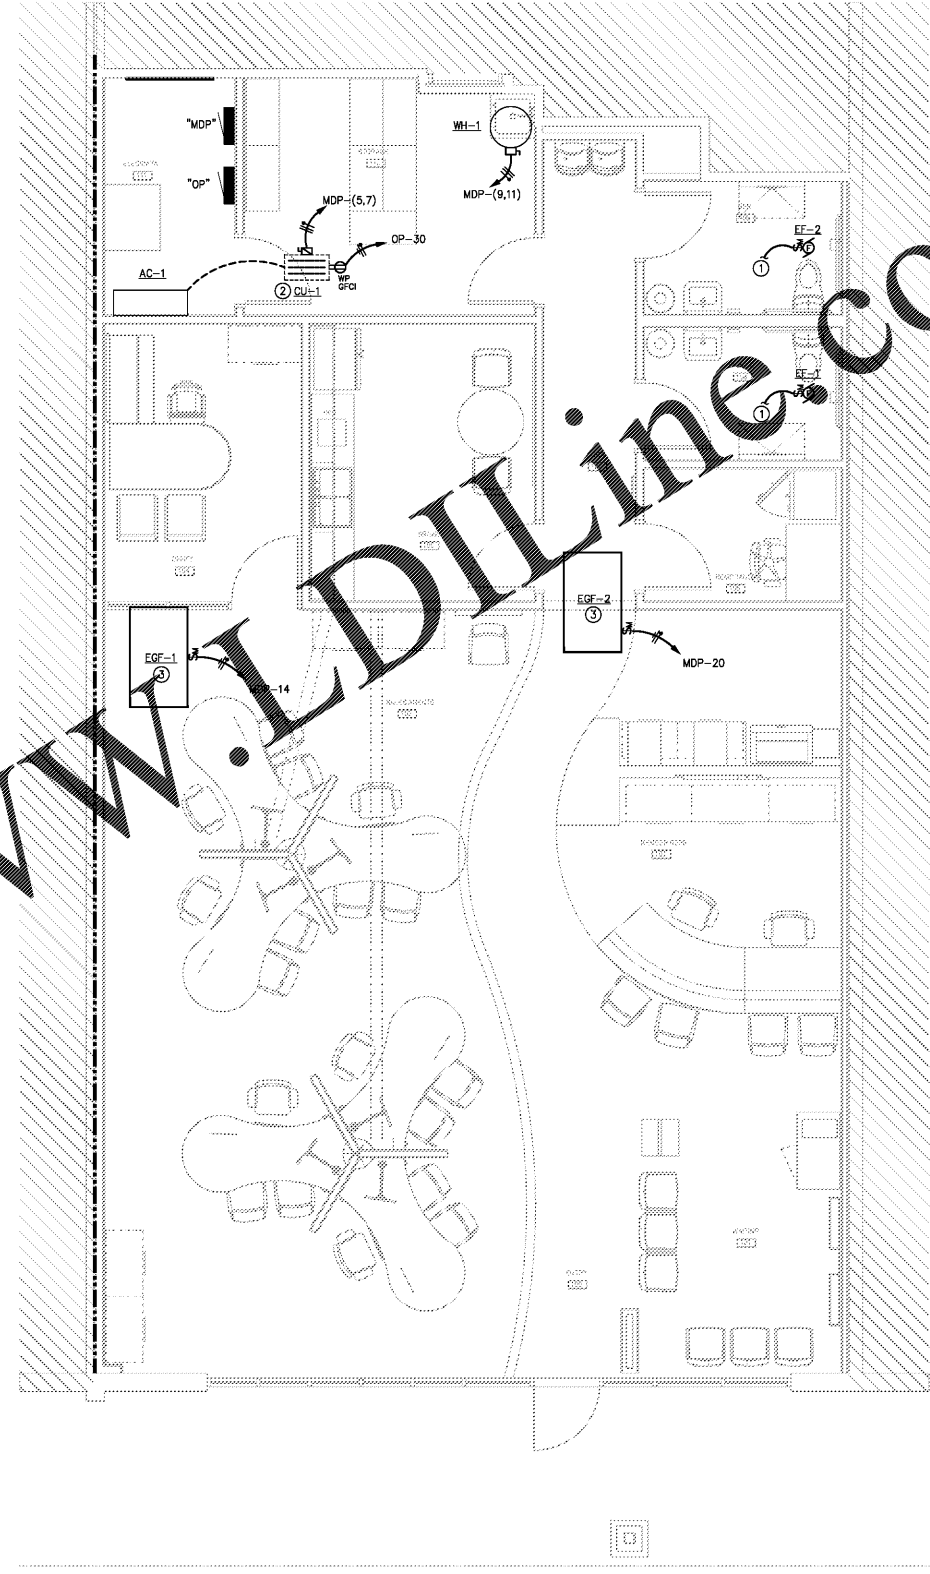

Order Plans @ WWW.DIline.com

1 FLOOR PLAN - HVAC & PLUMBING CONNECTIONS
 SCALE: 1/4" = 1'-0"

D

C

B

A