


Order Plans @ WWW.LDILLING.com

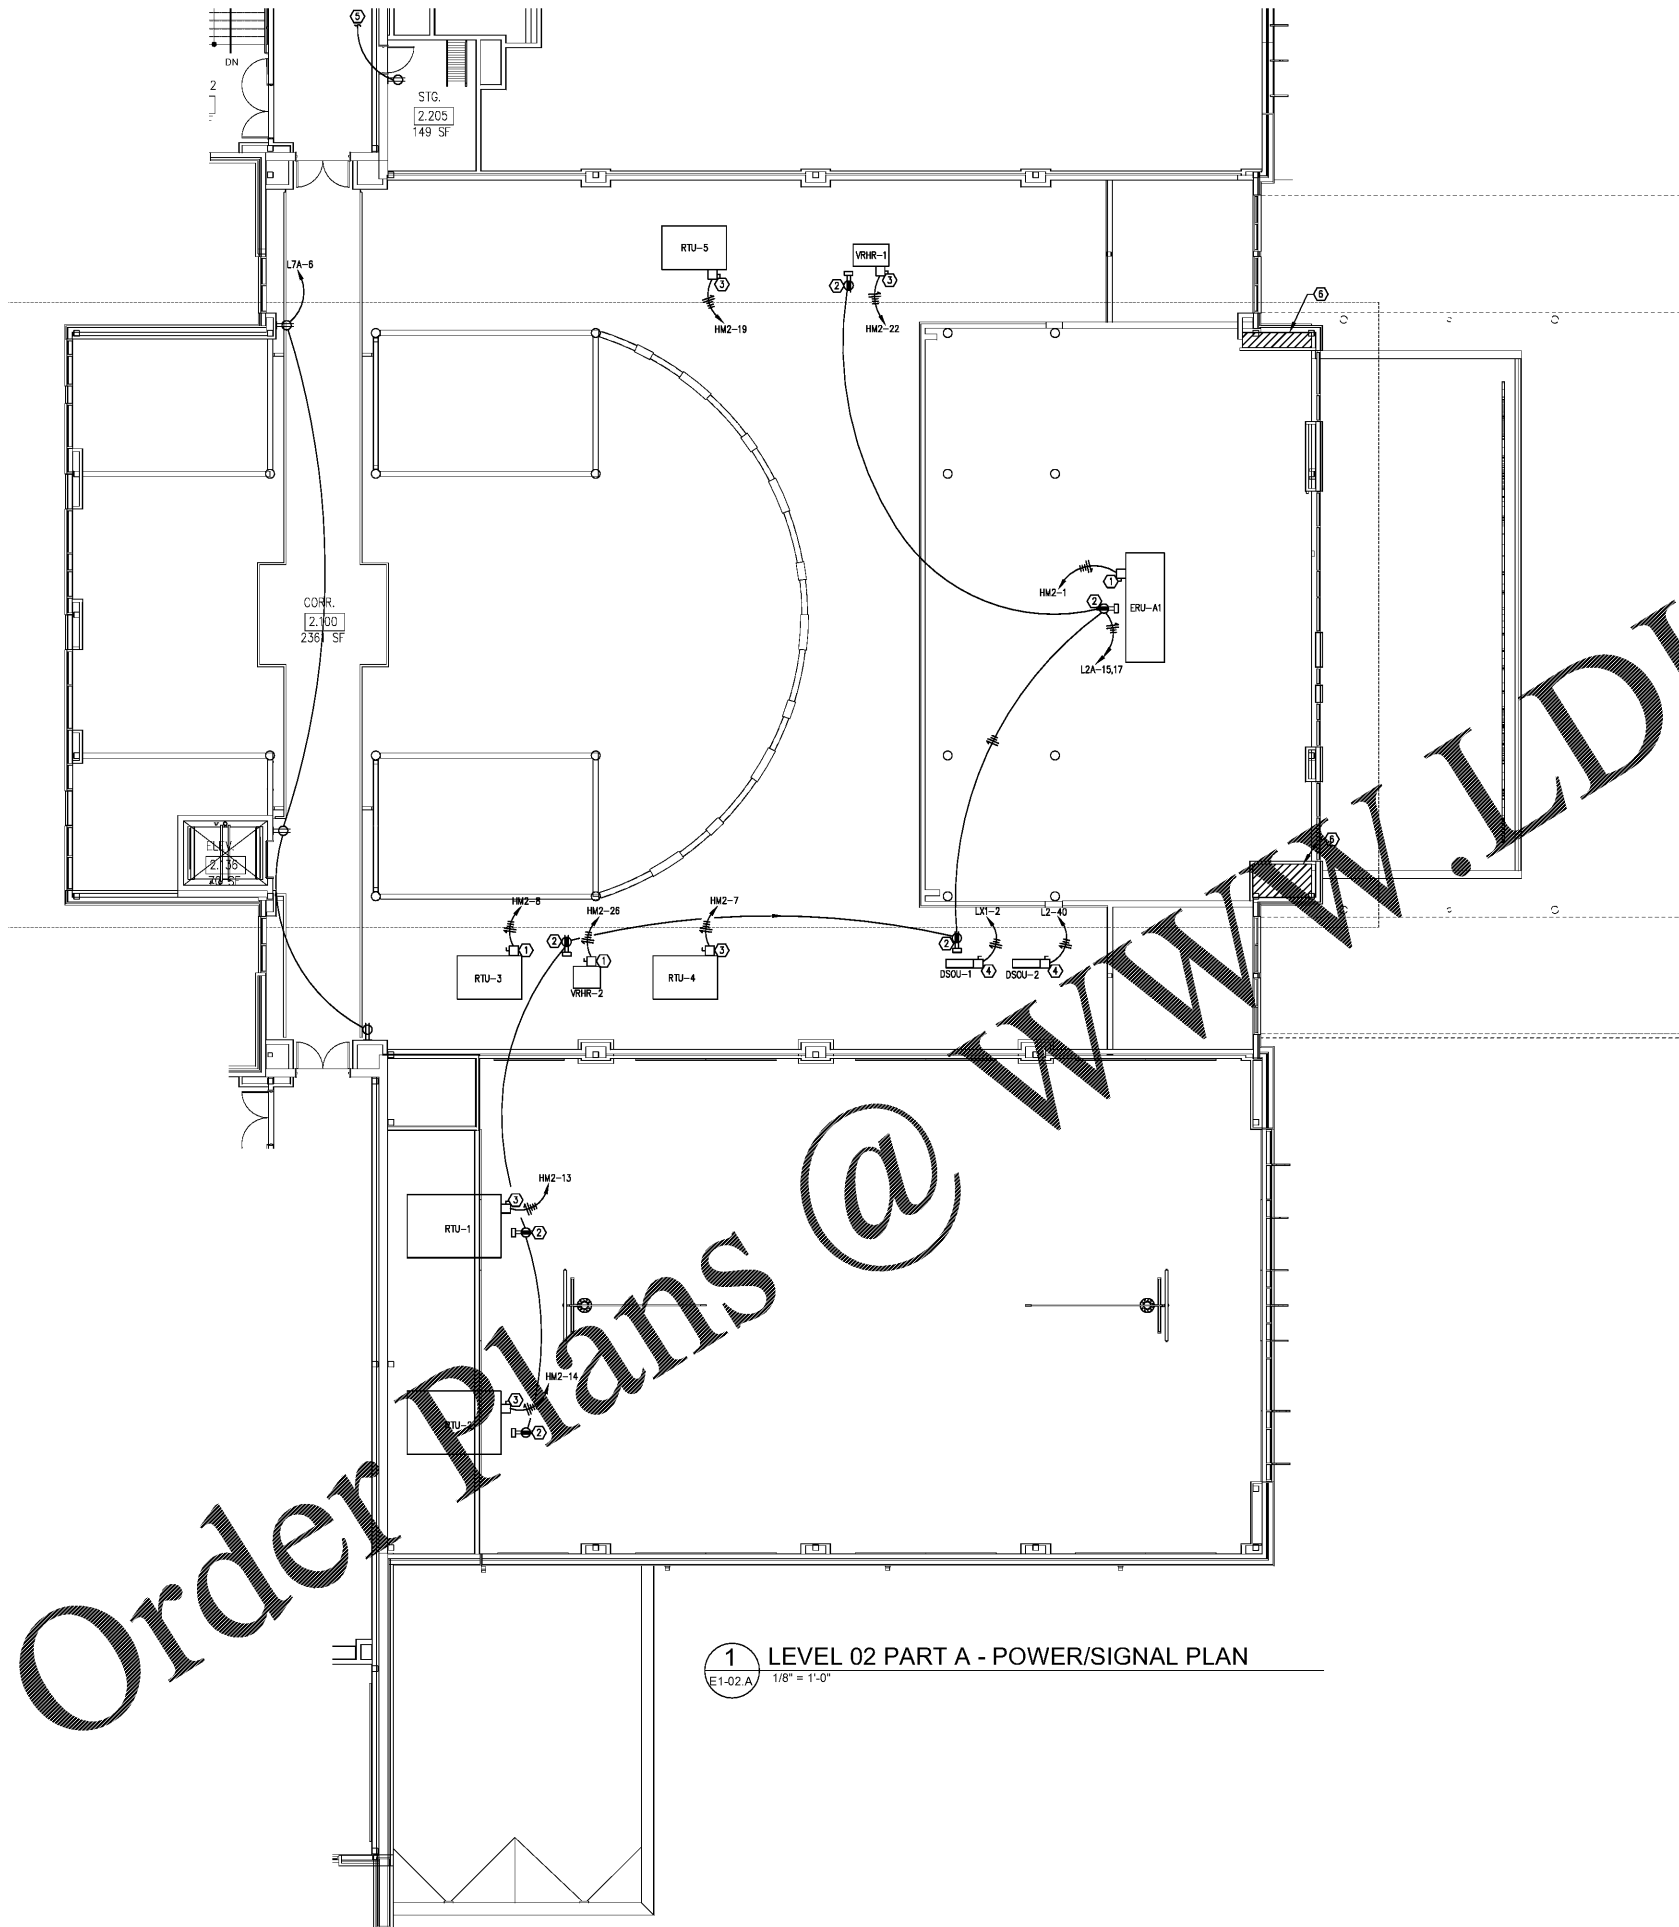

1 LEVEL 02 PART A - POWER/SIGNAL PLAN
E1-02.A 1/8" = 1'-0"


- NOTES:
1. PROVIDE FUSES IN ALL DISCONNECT SWITCHES SERVING MECHANICAL EQUIPMENT AND INDICATED AS "FUSE". FUSES SHALL BE SIZED PER THE MAXIMUM FUSE SIZE RATING IN THE NAMEPLATE DATA.
 2. COORDINATE EXACT LOCATIONS OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.
 3. OVERHEAD CONDUITS IN PART "A" SHALL BE ROUTED TIGHT TO STRUCTURE. WHERE CONDUITS ARE ROUTED DOWN TO THE ADMINISTRATION AREA, THEY SHALL BE ROUTED IN THE CHASES INDICATED KEYNOTE 6.

- KEYNOTES:
1. 30A/3P/FUSE/RTI DISCONNECT SWITCH.
 2. PROVIDE DUPLEX GFCI OUTLET WITH WEATHER-PROOF COVER PERMANENTLY MOUNTED ADJACENT TO THE ROOF TOP EQUIPMENT.
 3. 60A/3P/FUSE/RTI DISCONNECT SWITCH.
 4. 60A/2P/FUSE/RTI DISCONNECT SWITCH.
 5. TIE TO CIRCUIT SERVING OUTLETS IN THE CORRIDOR. SEE SHEET E1-02.C.
 6. CHASE FOR ROUGH-IN CONDUIT INTO AND OUT OF THE ADMINISTRATION AREA. CHASES SHALL BE USED FOR CONDUIT, PLENUM PIPING, AND DUCTWORK. COORDINATE INSTALLATION WITH OTHER TRADES PRIOR TO ROUGH-IN.

Smallwood, Reynolds, Stewart, Stewart & Associates, Inc. Architects

LEVEL 02 PART A - POWER/SIGNAL PLAN
J.H. HOUSE ELEMENTARY SCHOOL
3100 Zingara Road NE, Conyers, GA 30012

DATE: 10-01-2019
JOB NO: 218036.00
SHEET NO: E1-02.A



PROJECT SUMMARY
NAME: J.H. HOUSE ELEMENTARY SCHOOL
GRADES: PREK THRU 5TH
G.D.C.E. # TO BE ASSIGNED

BUILDING AREA	7.1.1.62 SF
LEVEL 01	108,337 SF
TOTAL	108,337 SF
COVERED AREAS (LE CHASES)	5,180 SF
CHASE (1" x 12")	2,336 SF
TOTAL	7,516 SF

INSTRUCTIONAL UNITS	45
REGULAR CLASSROOMS	2
PAIRED FLEX AREAS	1
MUSICAL EDUCATION	1
MEDIA CENTER	1
ART	1
TOTAL	51

REV. NO.	DATE	REMARKS
06/16/19	GDCE Check Set	
10/01/19	ISSUED FOR PERMIT/ADDC	

One Piedmont Center, Suite 303 3565 Piedmont Road Atlanta, Georgia 30305

ISSUED FOR CONSTRUCTION