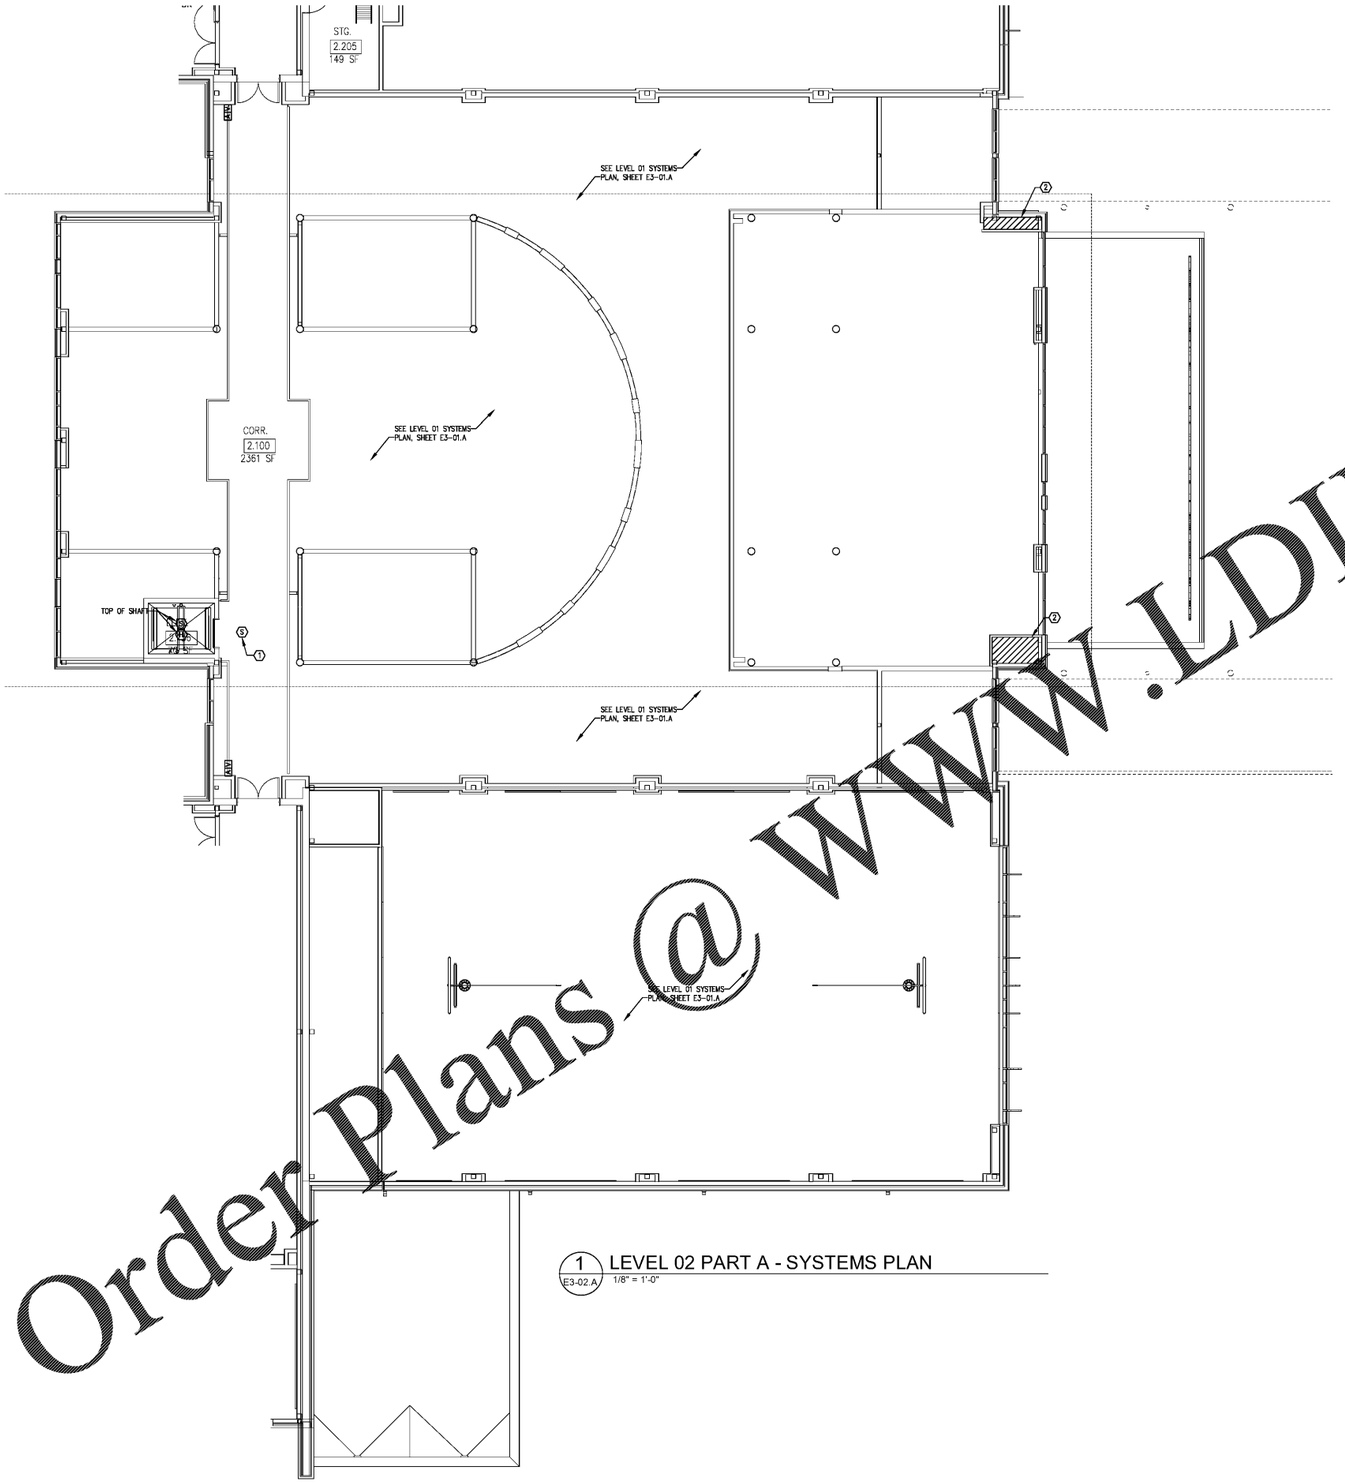

1 LEVEL 02 PART A - SYSTEMS PLAN
E3-02.A 1/8" = 1'-0"

NOTES:

1. EXCEPT WHERE OTHERWISE NOTED, SYSTEMS CABLING SHALL BE PLENUM RATED. REFER TO SPECIFICATIONS FOR ADDITIONAL CABLING REQUIREMENTS.
2. FIRE ALARM CABLING SERVING DEVICES ON THE BRIDGE (CORRIDOR 2.100) SHALL BE INSTALLED IN CONDUIT. ROUTE CONDUIT IN A FULL HEIGHT WALL DOWN TO THE FIRST FLOOR SLAB, AND EXTEND IN THE SLAB TO THE FACP IN RECEPTION 1.103.
3. FIRE ALARM CABLING INSTALLED IN CONDUIT IN THE SLAB SHALL BE AQUASEAL OR EQUAL.
4. OVERHEAD CONDUITS IN PART "A" SHALL BE ROUTED TIGHT TO STRUCTURE. WHERE CONDUITS ARE ROUTED DOWN TO THE ADMINISTRATION AREA, THEY SHALL BE ROUTED IN THE CHASES INDICATED IN KEYNOTE 2.

KEYNOTES:

1. PROVIDE AUXILIARY CONTACTS AND INTERLOCK WITH ELEVATOR RECALL SYSTEM.
2. CHASE FOR ROUTING CONDUIT INTO ADMINISTRATION AREA. CHASES SHALL BE USED FOR CONDUIT, SPRINKLING PIPING AND DUCTWORK. COORDINATE INSTALLATION WITH OTHER TRADES PRIOR TO ROUGH-IN.

INTERCOM NOTES:

1. PRIOR TO ORDERING INTERCOM SPEAKERS, CONFIRM CEILING TYPE (GRID, GYP BOARD, OPEN STRUCTURE) WITH THE ARCHITECT'S REFLECTED CEILING PLAN. ORDER THE CORRECT TYPE OF SPEAKER FOR THE CEILING IN/ON WHICH IT WILL BE INSTALLED IN EACH SPACE.

Order Plans @ WWW.LDILine.com

One Piedmont Center, Suite 303 3565 Piedmont Road Atlanta, Georgia 30305

Smallwood, Reynolds, Stewart & Associates, Inc. Architects

REVISIONS / PRINTED

REV. NO.	DATE	REMARKS
	08/16/19	GDOE Check Set
	10/01/19	ISSUED FOR BID/ PERMIT/GDOE

PROJECT SUMMARY
NAME: JH HOUSE ELEMENTARY SCHOOL
GRADES: PRE-K THRU 5TH
FACILITY #: 4
G.D.O.E.# TO BE ASSIGNED

BUILDING AREA
LEVEL 01 71,152 SF
LEVEL 02 32,370 SF
TOTAL 106,057 SF

COVERED AREAS (I.E. CANOPIES)
COVERED AREAS 5,186 SF
CANOPIES 0 & 2 2,202 SF
TOTAL 7,388 SF

INSTRUCTIONAL UNITS

REGULAR CLASSROOMS	45	
PAIRED FLEX AREAS	2	
MUSIC	1	
PHYSICAL EDUCATION	1	
MEDIA CENTER	1	
ART	1	
TOTAL		51

RCPS

GEORGIA REGISTERED ARCHITECT No. 022118

© COPYRIGHT 2019
SMALLWOOD, REYNOLDS, STEWART & ASSOCIATES, INC.
THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF THE ARCHITECT AND MAY NOT BE REPRODUCED WITHOUT THE WRITTEN PERMISSION

LEVEL 02 PART A - SYSTEMS PLAN

J.H. HOUSE ELEMENTARY SCHOOL
3100 Zingara Road NE, Conyers, GA 30012

DATE: 10-01-2019
JOB NO.: 218036.00
SHEET NO.: E3-02.A

ISSUED FOR CONSTRUCTION