


Luminaire Schedule							
Symbol	Qty	Label	Arrangement	LMF	Lum. Lumens	Lum. Watts	Part Number
	8	C	WALL MOUNT	1.000	2490	19	XSPW-B-WM-2ME-2L-40K-UL-xx (Sign Light)
	8	N	WALL MOUNT	1.000	2490	19	XSPW-B-WM-3ME-2L-57K-UL-xx (Wall Light)
	7	PL	SINGLE	1.000	11648	86	OSQ-A-NM-4ME-B-57K-UL-BK (Area)
	1	PL2	BACK-BACK	1.000	11648	86	OSQ-A-NM-4ME-B-57K-UL-BK (Area)

POLE SCHEDULE
 (7) CL-SSP-4011-25-D1-BK/AB (25' x 4"sq STEEL POLE, SINGLE MOUNT)
 (1) CL-SSP-4011-25-D2-BK/AB (25' x 4"sq STEEL POLE, 2@180°)
 (9) OSQ-DABK (Direct Arm Mount)
 PROPOSED POLES MEET 120MPH SUSTAINED WINDS
 *** CUSTOMER TO VERIFY ORDERING INFORMATION AND CATALOGUE NUMBER PRIOR TO PLACING ORDER ***

Calculation Summary (Footcandles calculated using initial lumens @25 °C)						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts	Fc	3.06	9.2	0.5	6.12	18.40

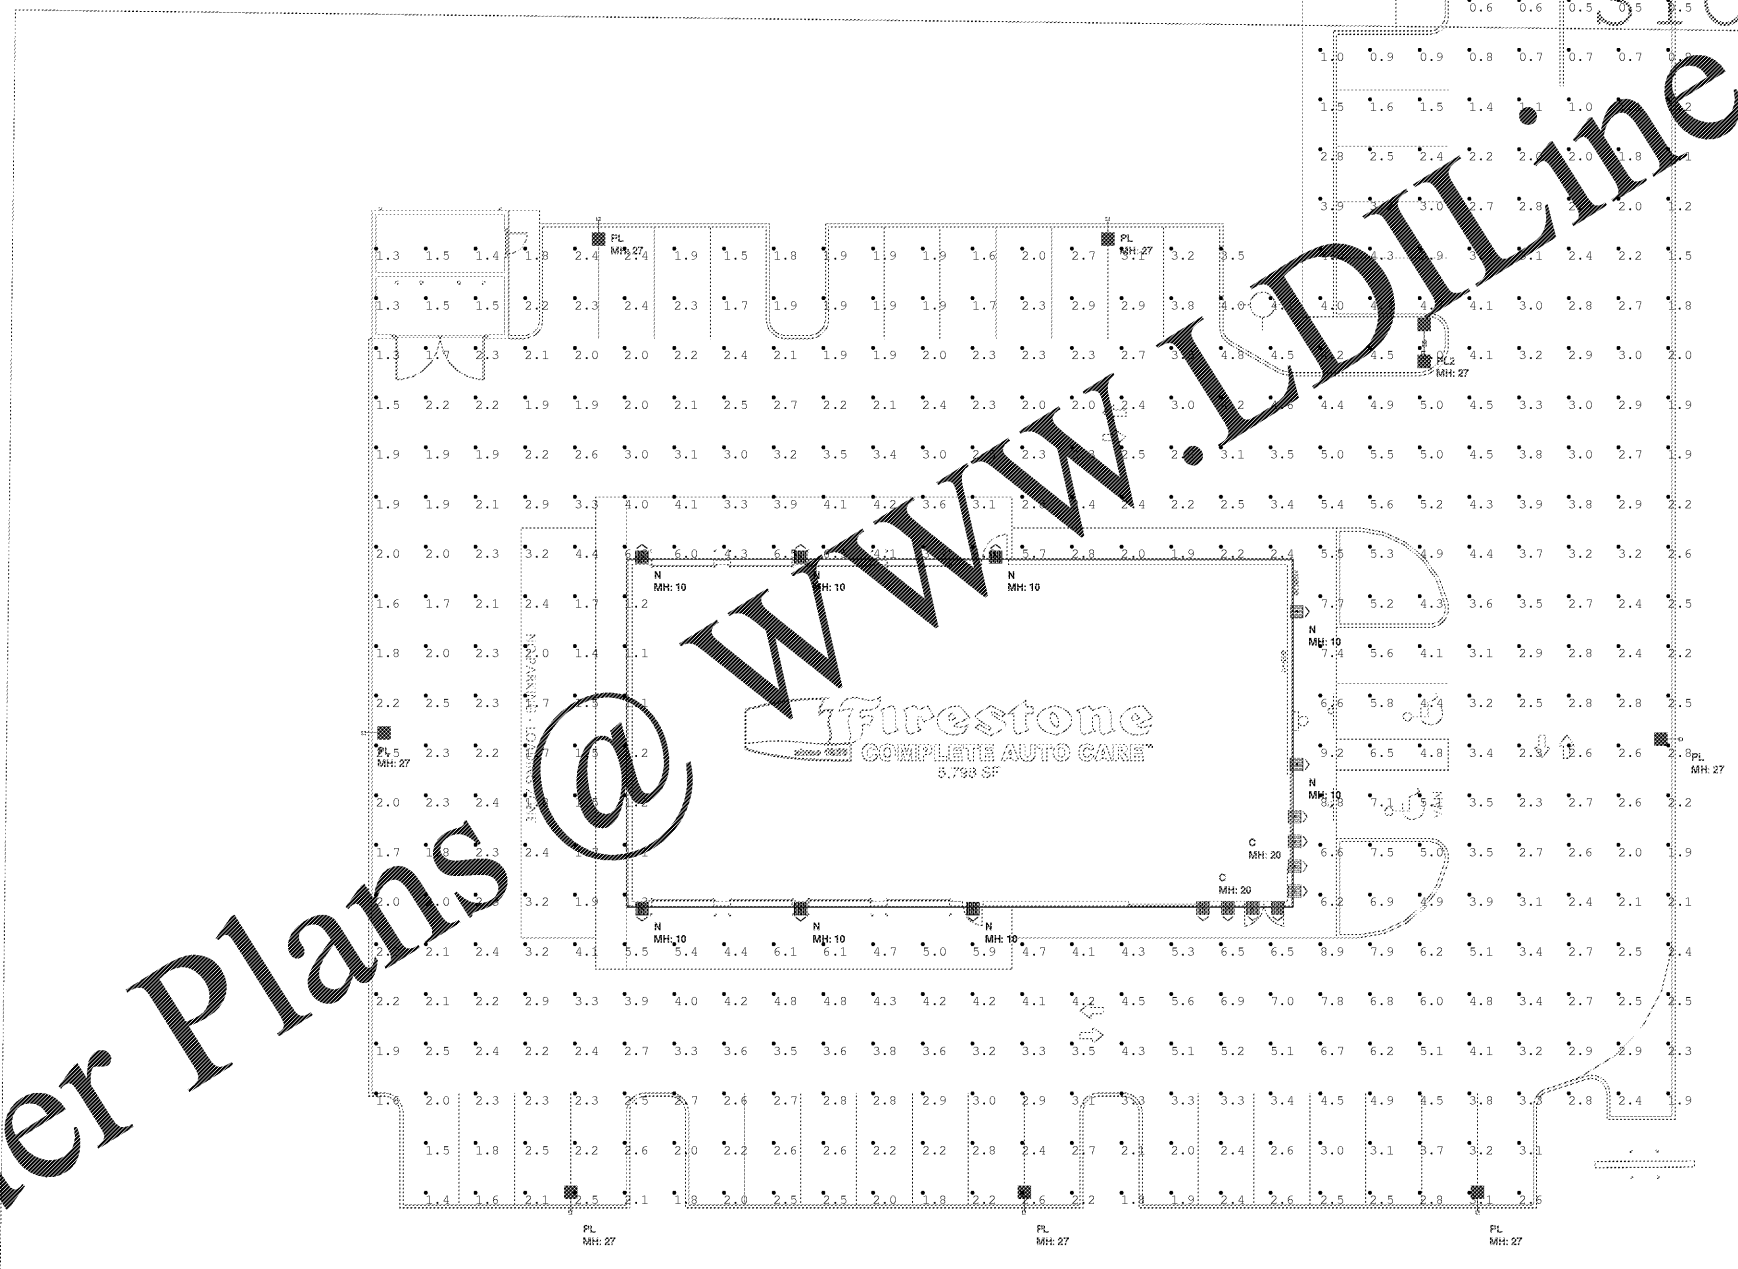

Order Plans @

BID SET
 11.18.19
 TRCI

CREE LIGHTING
 A COMPANY OF IDEAL INDUSTRIES, INC.
 9201 Washington Ave, Racine, WI 53406 <https://creelighting.com> - (800) 236-6800

Illumination results shown on this lighting design are based on project parameters provided to Cree Lighting used in conjunction with luminaire test procedures conducted under laboratory conditions. Actual project conditions differing from these design parameters may affect field results. The customer is responsible for verifying dimensional accuracy along with compliance with any applicable electrical, lighting or energy code.

FIRESTONE HWY 61 GONZALES, LA
 SR-37318 || Footcandles calculated at grade || FRS-190617GZLAJEE.AGI

Layout By:
JACOB EDLER
 Date: 6/17/2019

Scale 1" = 20'

 0 40 80