


- FIRE ALARM CONTROL PANEL LAYOUT NOTES**
- THE FIRE ALARM CONTROL PANEL SHALL BE LOCATED IN A RED FIRE ENCLOSURE CABINET.
 - PROVIDE THE SERVICE PHONE NUMBER STICKER ON THE SURFACE OF THE FACP.
 - COORDINATE CONNECTIONS TO DEDICATED 120 VAC POWER CIRCUITS WITH THE ELECTRICAL CONTRACTOR. THE DEDICATED CIRCUIT DISCONNECT SHALL BE RED IN COLOR, LABELED "FIRE ALARM CIRCUIT", AND HAVE A LOCKABLE TAB. ALL FIRE ALARM CIRCUIT BREAKERS SHALL BE CLEARLY MARKED AND MECHANICALLY SECURED TO PREVENT ANY UNAUTHORIZED TAMPERING. IDENTIFY THE LOCATION OF THE CIRCUIT DISCONNECT AT THE FACP. COORDINATE EXACT MOUNTING LOCATION OF CONTROL PANEL WITH THE OWNER'S REPRESENTATIVE AND ELECTRICAL CONTRACTOR PRIOR TO INSTALLATION.
 - PROVIDE TWO (2) 12V 7 AH BATTERIES WIRED IN SERIES FOR THE FIRE ALARM CONTROL PANEL (FACP). THE BATTERIES SHALL BE INSTALLED IN THE FACP ENCLOSURE.
 - COORDINATE INSTALLATION OF A GROUNDED OR ACCEPTABLE BUILDING GROUND FOR PROPER GROUNDING OF THE FACP WITH THE ELECTRICAL CONTRACTOR.
 - PROVIDE TWO (2) MEANS OF ORIGINAL TRANSMISSION TO THE OFF-SITE MONITORING FACILITY. PROVIDE A DEDICATED PHONE LINE FOR THE PRIMARY MEANS OF TRANSMISSION. THE SECONDARY MEANS SHALL UTILIZE A CELLULAR COMMUNICATOR CONNECTION TO A WIRELESS NETWORK. PROVIDE THE SERVICE PHONE NUMBER STICKER ON THE SURFACE OF THE FACP AND THE ASSOCIATED PHONE NUMBER USING DIRECTLY ON THE RJ-31X BOXES. COORDINATE ALL PROGRAMMING AND TRANSMISSION AND CONNECTIONS WITH THE OFF-SITE MONITORING COMPANY.
 - THE ASSOCIATED PHONE NUMBER USING PRINTED LABEL DIRECTLY ON THE RJ-31X BOXES.

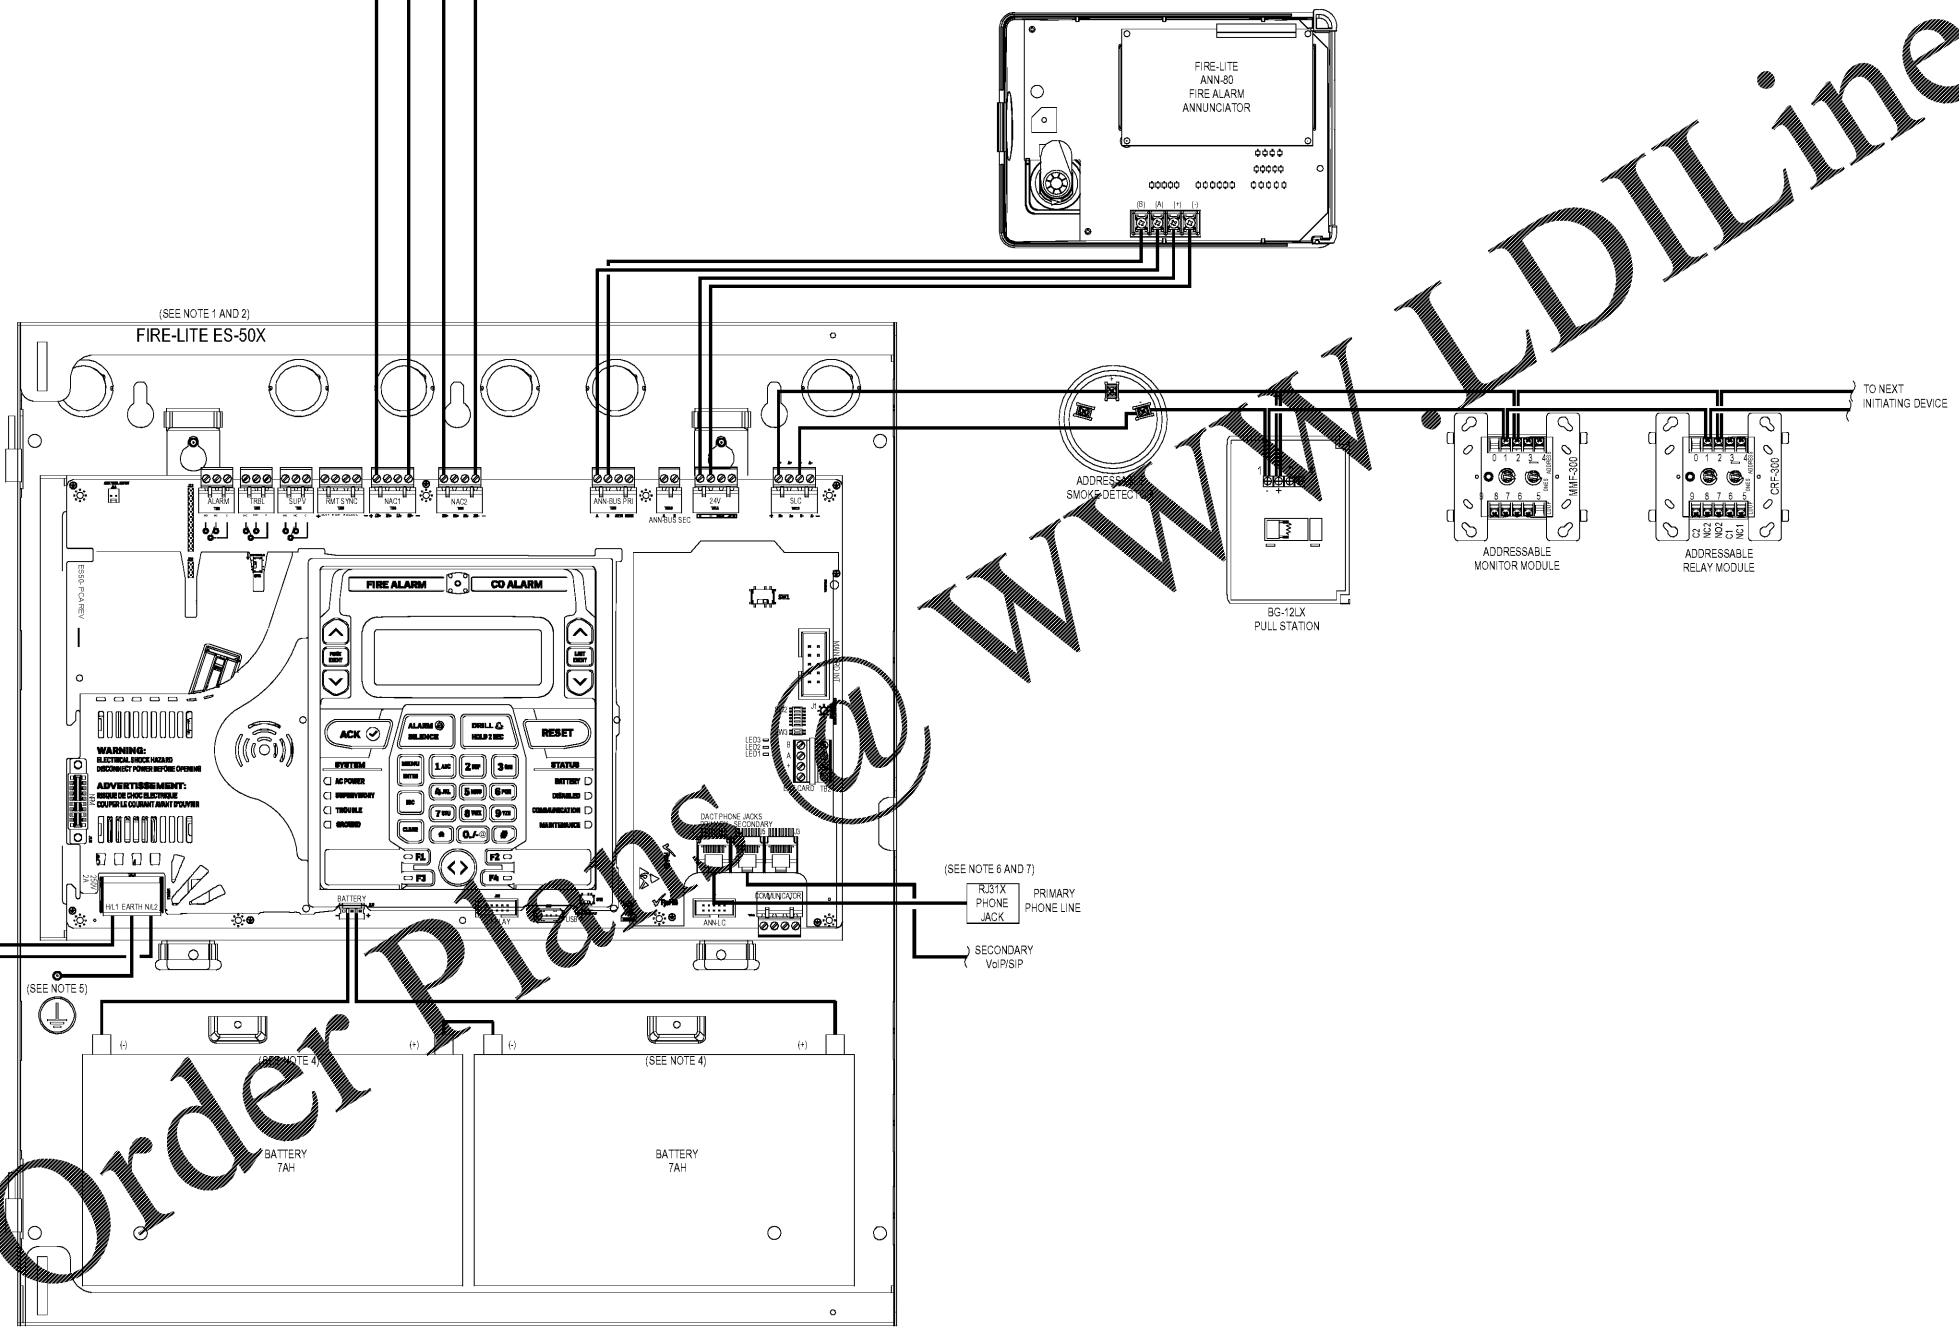

FIRE ALARM CONTROL PANEL LAYOUT
NOT TO SCALE

CODE CONSULTANTS, INC.
2043 WOODLAND PKWY, SUITE 300
ST. LOUIS, MISSOURI 63146-4235
314-991-2633
www.codeconsultants.com

Firestone COMPLETE AUTO CARE

THIS DRAWING IS THE PROPERTY OF BRIDGESTONE RETAIL OPERATIONS, LLC AND IS LOANED ON THE EXPRESS CONDITION THAT IT IS NOT TO BE USED IN ANY WAY DEPRECIATED TO THE INTERESTS OF BRIDGESTONE RETAIL OPERATIONS, LLC. IT IS TO BE RETURNED TO THE DRAWING ENGINEER OR TO THE DRAWING OWNER'S REPRESENTATIVE UPON COMPLETION OF THE PROJECT. THE EXCLUSIVE OWNERSHIP REMAINS TO BRIDGESTONE RETAIL OPERATIONS, LLC.

NEW FCAC STORE
2019 - JANUARY - SMALL ER
S. AIRLINE HWY NEAR E. CORVIEW ST
GONZALES, LA

BID SET
1/2019
DAVID J. BURKHART, PE
LICENSE NO. 25842
PROFESSIONAL ENGINEER
CORPORATE CERTIFICATE OF AUTHORITY NO. EP2987
07/26/19
FIRE PROTECTION ENGINEER OF RECORD:
DAVID J. BURKHART, PE
LICENSE NO. 25842
CODE CONSULTANTS, INC.
2043 WOODLAND PKWY, SUITE 300
ST. LOUIS, MO 63146-4235
PHONE: 314-991-2633

ISSUE BLOCK

PROPERTY NO.: 160013
6 DIGIT NO.: 905226
4 DIGIT NO.: 014W

AOR PROJECT NUMBER: 1955827
TO PERMIT: DATE: 7-30-2019
TO BID: DATE: ##-##-##

SHEET TITLE:
FIRE ALARM CONTROL PANEL LAYOUT

SHEET NUMBER:
FA4