



ARCHITECTS
WM2A.COM
348 COTTON AVENUE
SUITE 500, PO BOX 110
MACON, GEORGIA 31201



CENTER PARK RESTROOMS
FACILITIES AND SHADE
PAVILION

City of Centerville
103 E CHURCH ST
CENTERVILLE, GA
31028

REVISIONS

DATE DESCRIPTION

© 2018, WMAA Architects/Planners, Inc.
All WMAA Architects These drawings, as
instruments of service, remain the property
of the Architect. Unauthorized use or
reproduction is forbidden.

Date: 11/04/19

Drawn By: FHG

Checked By: JHM


Project Number: 2018-077

Drawing Name:


FLOOR PLAN -
LIGHTING

Drawing Number:


E-2

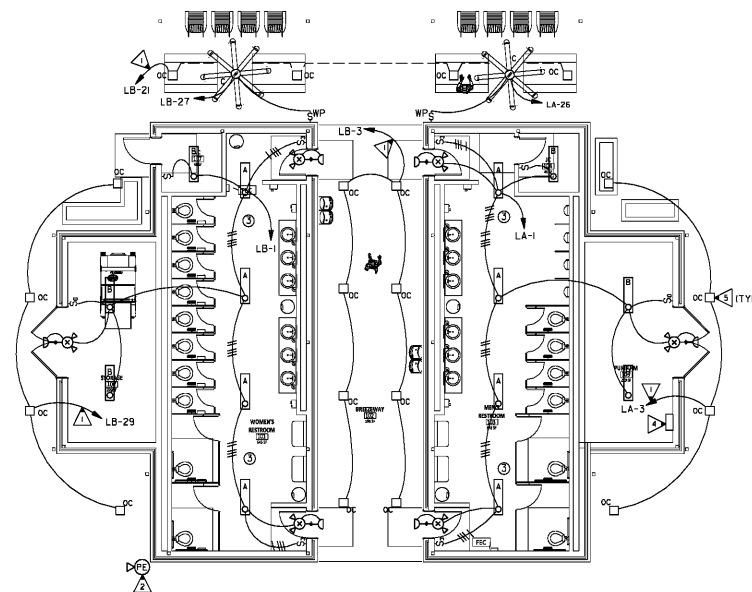

1 RESTROOM FACILITY - LIGHTING
E-2 SCALE: 1/8"=1'-0"

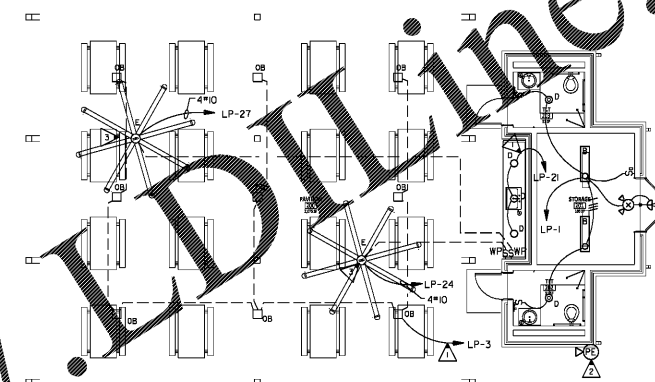

2 SHADED PAVILION FACILITY - LIGHTING
E-2 SCALE: 1/8"=1'-0"

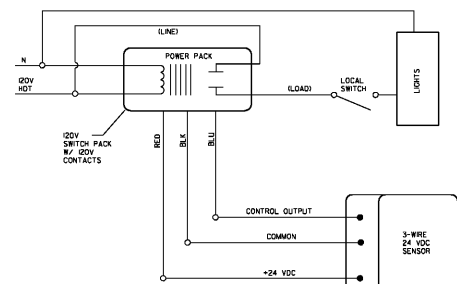

3 SCHEMATIC WIRING DIAGRAM -
E-2 SENSOR CONTROL - LIGHTING
NOT TO SCALE (SEE MANUFACTURER'S RECOMMENDATION FOR SCHEMATIC WHERE MULTIPLE SENSORS OCCUR IN SAME SPACE.)

GENERAL NOTES:

- A. THIS PLAN INDICATES AREAS TO BE CONTROLLED BY MOTION SENSORS. SINCE COVERAGES AND DEVICES VARY BETWEEN MANUFACTURERS IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE PROPER DEVICE LOCATION, ORIENTATION AND QUANTITIES WITH THE MANUFACTURER OF THE SYSTEM BEING INSTALLED TO MEET THE SPECIFIED CRITERIA.
- B. ALL AREAS OF THIS PLAN REQUIRE OCCUPANCY SENSOR COVERAGE EXCEPT FOR AREAS INDICATED. SEE LIGHTING SENSOR LEGEND E000J (TYPICAL).
- C. THERE ARE NO SWITCHPACKS SHOWN ON THIS PLAN. PROVIDE SWITCHPACKS AS REQUIRED WITH SENSORS. SWITCHPACKS ARE TO BE RATED AT 20A. PROVIDE ONE SWITCHPACK PER 20A LIGHTING CIRCUIT OR PER INDIVIDUAL AREA BEING CONTROLLED.
- D. CEILING SENSORS ARE TO BE MOUNTED AWAY FROM ANY STRONG AIRFLOW. COORDINATE LOCATION OF SENSOR WITH MECHANICAL AND LIGHTING PLANS.
- E. ALL SENSORS SHALL BE CEILING MOUNTED EXCEPT WHERE CEILING HEIGHTS EXCEED 15 FT.-0 IN. PROVIDE SENSOR WITH ADAPTOR PLATE FOR JUNCTION BOX MOUNTING. JUNCTION BOX SHALL BE CONCEALED ABOVE ACCESSIBLE CEILING. JUNCTION BOX SHALL BE SUPPORTED FROM STRUCTURE UTILIZING A 1/2 IN. THREADED ROD. WHERE CEILING HEIGHTS EXCEED 15 FT.-0 IN. WALL MOUNT SENSORS AT 12 FT.-0 IN.
- F. PROVIDE UNSWITCHED HOT CONDUCTOR TO ALL EMERGENCY AND EXIT LIGHTS.

KEYED NOTES: (THIS SHEET ONLY)

- ▷ ROUTE VIA 4 POLE EXTERIOR LIGHTING CONTACTOR/TIMECLOCK LOCATED ADJACENT PANEL. PHOTO CELL SHALL CONTROL DUSK TILL DAWN OPERATION. TIMECLOCK SHALL INTERRUPT CIRCUIT DURING MIDDAY HOURS. TIMECLOCK SHALL BE 365 DAY DIGITAL PROGRAMMABLE WITH 20A RATED CONTACTS. PROVIDE OVERRIDE SWITCH ADJACENT TIMECLOCK.
- ▷ LOCATE P.E. CELL FACING NORTH, CLEAR OF MAN MADE LIGHT SOURCES. J-BOX TO HOUSE P.E. CELL SHALL BE RECESSED MOUNTED WITH STAINLESS STEEL COVER.
- ▷ COORDINATE EXACT LOCATION OF FANS WITH OWNER/ARCHITECT PRIOR TO ROUGH-IN.
- ▷ VAK-FAK CLED-15-W20832 LIGHTING CONTROL PANEL FOR SPLASH PAD LIGHTING. SEE WATER ODYSSEY BY FOUNTAIN PEOPLE DRAWINGS FOR EXACT REQUIREMENTS. VERIFY EXACT LOCATION WITH OWNER/ARCHITECT PRIOR TO ROUGH-IN.
- ▷ COORDINATE EXACT LOCATIONS AND MOUNTING HEIGHT WITH ARCHITECTURAL.

Order Plans @

WWW.LDLINE.COM