


AREA	DESIGNATION PER FBC	SQ FT PER OCC		AREA(SF)	TOTAL OCCUPANTS
SERVICE/ORDER	ASSEMBLY	7	NET	100	15
SEATING	ASSEMBLY W/ TABLES & CHAIRS	15	GROSS	325	22
HALLWAY	-	0	GROSS	41	0
MENS ROOM	-	0	GROSS	51	0
WOMENS ROOM	-	0	GROSS	64	0
SALES	COMMERCIAL KITCHEN	100	GROSS	69	1
COOKING	COMMERCIAL KITCHEN	100	GROSS	262	3
PREP	COMMERCIAL KITCHEN	100	GROSS	127	2
JANITOR/STORAGE	COMMERCIAL KITCHEN	300	GROSS	139	1
COOLER/FREEZER	COMMERCIAL KITCHEN	300	GROSS	90	1
TOTAL OCCUPANTS					45

OCCUPANCY CLASSIF.	AREA (SQ. FT.)	SQ. FT./ OCCUPANT	OCC. LOAD	EXIT COMPONENT	EXIT WIDTH/ PERSON (IN.)	REQ'D. OCCUP. LOAD EXIT WIDTH (IN.)	PROVIDED CLEAR EXIT WIDTH (IN.)	PROVIDED EXIT CAPACITY
RESTAURANT UNDER 49 OCC BUSINESS GROUP B	1,500 SF GROSS TOTAL	VARIES	45	HORIZ.	0.20	9.0	114	570 PPL

POSTING OF OCCUPANT LOAD:

EVERY ROOM CONSTITUTING AN ASSEMBLY OCCUPANCY AND NOT HAVING FIXED SEATS SHALL HAVE THE OCCUPANT LOAD OF THE ROOM POSTED IN A CONSPICUOUS PLACE NEAR THE MAIN EXIT FROM THE ROOM PER NFPA 101 2012, 12.7.9.3.1. APPROVED SIGNS SHALL BE MAINTAINED IN A LEGIBLE MANNER BY THE OWNER OR AUTHORIZED AGENT PER NFPA 101 2012- 12.7.9.3.2. SIGNS SHALL BE DURABLE AND SHALL INDICATED THE NUMBER OF OCCUPANTS FOR EACH ROOM USE. (NFPA 101, 2012-12.7.9.3.3)

ALL DOCUMENTS ARE TO BE BUILT AND BID BASED ON THE MOST STRINGENT CODES. G.C. TO VERIFY THAT ALL CONSTRUCTION IS BUILT TO CODE AND THAT BIDS PROVIDED INCLUDE THE MOST RECENT CODE PER THE MUNICIPALITY. FAILURE TO DO SO WILL RESULT IN THE RELIEF OF LIABILITY OF THE OWNER, ARCHITECT, ENGINEER, AND DESIGNER. DRAWINGS ARE PROVIDED AS REFERENCE AND NOT ALL CONDITIONS ARE DETAILED. IF THERE ARE ANY DISCREPANCIES IN THE PLANS AND THE FIELD CONDITIONS THE CONTRACTOR MUST NOTIFY THE ARCHITECT OR ENGINEER OF RECORD. FAILURE TO DO SO WILL RESULT IN A DENIAL OF CHANGE ORDER REQUEST.

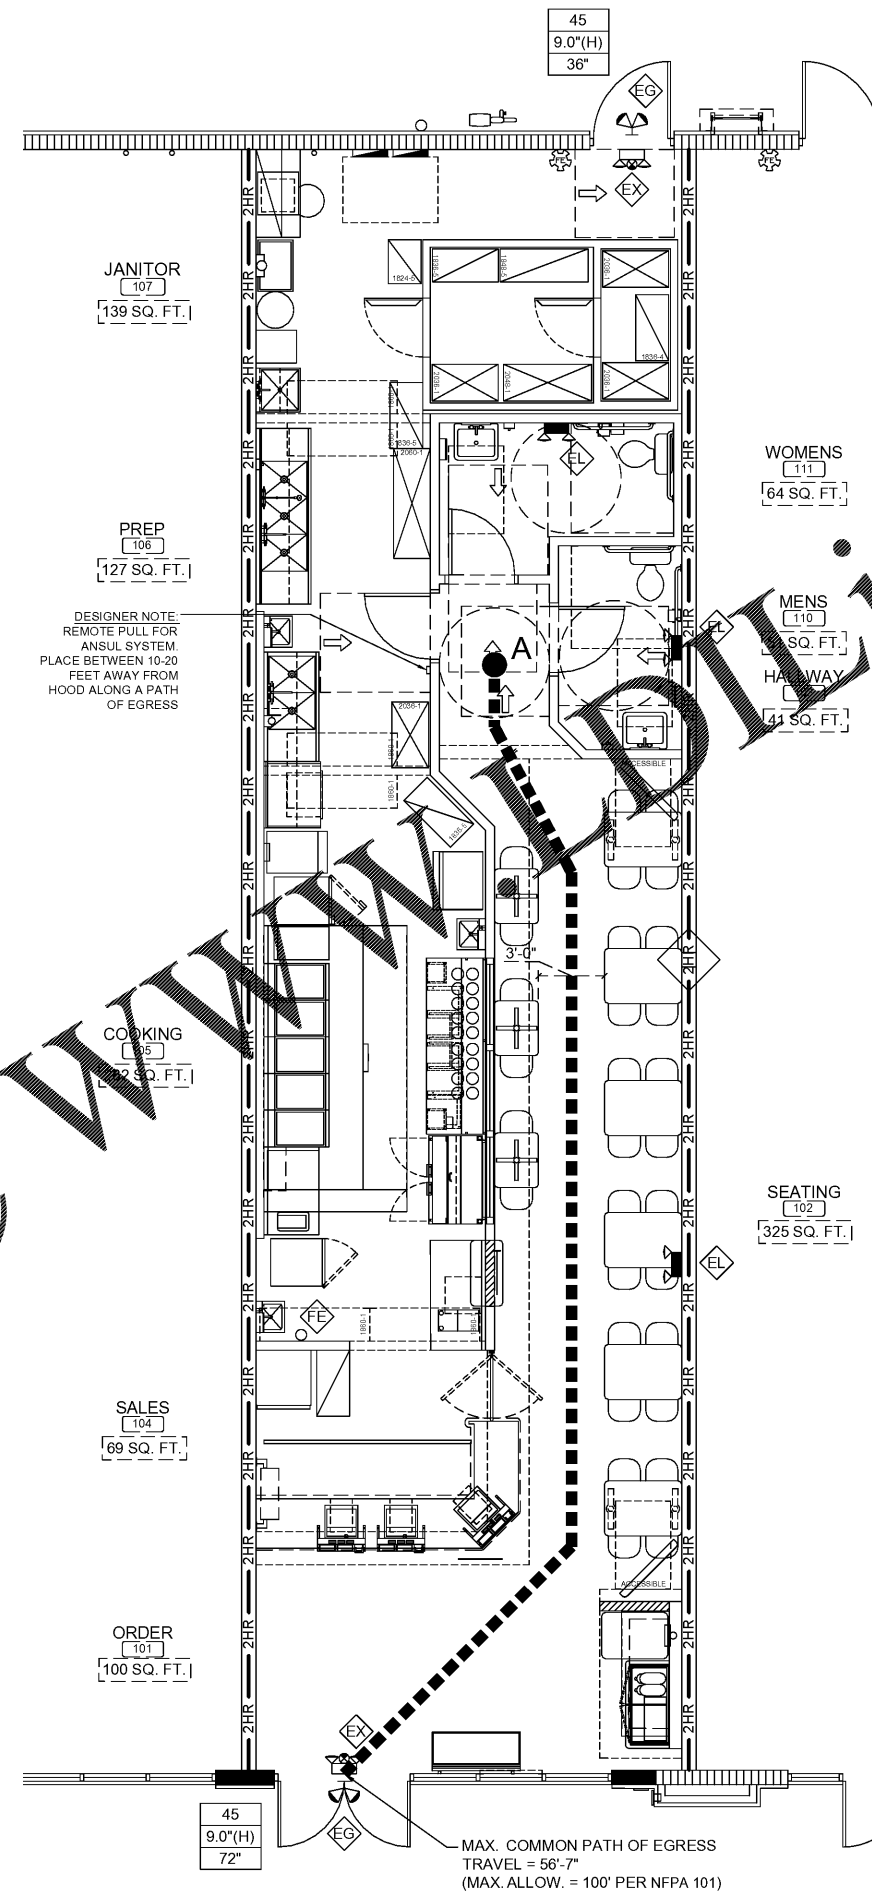

1 LIFE SAFETY PLAN
LSP SCALE: 1/4" = 1'-0"

DIVISION ONE - GENERAL REQUIREMENTS

FIRE BARRIER IDENTIFICATION (NFPA 101 SECTION 8.3.2.4)

- EACH NEW FIREWALL, FIRE BARRIER OR ANY OTHER NEW WALL REQUIRED TO HAVE PROTECTED OPENINGS SHALL BE PERMANENTLY IDENTIFIED WITH SIGNS OR STENCILING ABOVE ANY DECORATIVE CEILING AND IN CONCEALED SPACES WITH THE WORDING: "FIRE AND SMOKE BARRIER-PROTECT ALL OPENINGS."
- SUCH SIGNS OR STENCILING SHALL BE IN 4 INCH HIGH LETTERS, 1/2 INCH STROKE AND NOT MORE THAN 15 FEET ON-CENTER.

FIRE BARRIER PENETRATIONS (NFPA 101 SECTION 8.3.5.1)

- PENETRATIONS FOR CABLES, CABLE TRAYS, CONDUITS, PIPES, TUBES, COMBUSTION VENTS AND EXHAUST VENTS, WIRES, AND SIMILAR ITEMS TO ACCOMMODATE ELECTRICAL, MECHANICAL, PLUMBING, AND COMMUNICATIONS SYSTEM THAT PASS THROUGH A MEMBRANE OF A WALL, FLOOR, OR FLOOR / CEILING ASSEMBLY CONSTRUCTED AS A FIRE BARRIER SHALL BE PROTECTED BY A FIRESTOP SYSTEM OR DEVICE TESTED IN ACCORDANCE WITH ASTM E814 OR UL 1479.
- WHERE DEVICES ARE INDICATED IN A FIRE OR FIRE/SMOKE BARRIERS ON THE DRAWINGS, THE MAXIMUM ALLOWABLE AREA OF INDIVIDUAL U.L. LISTED BACKBOXES PERMITTED IN THE WALL IS 16 SQ. IN. WITH A MAXIMUM AGGREGATE OF 100 SQ. IN. PER 100 SQ. FEET OF WALL AREA.
- BACKBOXES ON OPPOSITE FACES OF SUCH BARRIERS SHALL BE OFFSET A MINIMUM HORIZONTAL DISTANCE OF 24 INCHES WHEN PENETRATIONS EXCEED THE ALLOWABLE AREAS, THE DEVICES SHALL BE SET IN A FURRED SPACE IN FRONT OF THE SMOKE OR FIRE/SMOKE BARRIER OR PROVIDED WITH A FIVE-SIDED ENCLOSURE CONSTRUCTED OF LAYERS OF 5/8" THICK TYPE "X" GYPSUM WALLBOARD EQUAL IN NUMBER TO THAT REQUIRED FOR THE RATING OF THE BARRIER, INSTALLED WITH APPROVED FASTENERS SCREWED TO STUDS AND HEADERS.
- WHERE FIRE RATED ASSEMBLIES OCCUR IN PROXIMITY TO STEEL BEAMS OR JOISTS WITH INADEQUATE DIMENSION TO INSTALL SCREWS, CONTRACTOR SHALL PROVIDE STUD FRAMING AROUND THE BEAM OR JOIST IN ACCORDANCE WITH U.L. DESIGN N-501 WITH LAYERS OF GYPSUM WALLBOARD EQUAL TO THAT REQUIRED BY THE RATING OF THE BARRIER

EXIT DOOR TACTILE SIGNAGE (LSC 101 CH 7.10.1.3)

- TACTILE SIGNAGE SHALL BE LOCATED AT EACH EXIT DOOR REQUIRING AN EXIT SIGN.
- TACTILE SIGNAGE SHALL READ AS FOLLOWS: EXIT.
- TACTILE SIGNAGE SHALL COMPLY WITH ICC/ANSI A117.1 AMERICANNATIONAL STANDARD FOR ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES.
- THESE REQUIREMENTS SHALL NOT APPLY TO EXISTING BUILDINGS, PROVIDED THAT THE OCCUPANCY CLASSIFICATION DOES NOT CHANGE.

LIFE SAFETY LEGEND

A	56'-7"
FE	FIRE EXTINGUISHER
EL	EMERGENCY LIGHT
EX	EXIT COMBO LIGHT
TRAVEL DISTANCE PER NFPA 101 (39.2.6)	


xxx	= OCCUPANT LOAD
xx"(H)	= REQUIRED EGRESS WIDTH (H = HORIZONTAL)
xx"	= PROVIDED WIDTH

DESIGN CRITERIA

OCCUPANCY:	BUSINESS
COMPLIANCE METHOD:	6TH EDITION FLORIDA FIRE PREVENTION CODE (FFPC), BASED ON NFPA, 1 FIRE CODE 2015 EDITION
WORK CLASSIFICATION:	NFPA 101 LIFE SAFETY CODE 2015 EDITION. RECONSTRUCTION (NFPA 101: 43.2.2.1.4)

THIS DOCUMENT, THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF WARNER ARCHITECTURAL ASSOCIATES AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF WARNER ARCHITECTURAL ASSOCIATES, INC.

WARNER ARCHITECTURAL ASSOCIATES
109 ANDERSON STREET SE, SUITE 105
MARIETTA, GA 30060
PH: 678.290.9200
EMAIL: INFO@WARNERARCHASSOC.COM



WING-STOP
10125 ULMERTON RD.
LARGO, FL 33771
STORE # V050

DRAWN BY: RDL
CHECKED BY: WLW
DATE:
PROJECT: WS1813
REVISION:
REVISION:

INTERIOR ACCESSIBILITY
DRAWING NUMBER
LSP

Order Plans @ WING-STOP