




DOOR TYPES

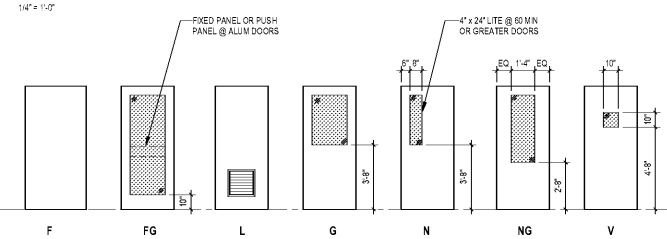


DOOR FRAME TYPES



STOREFRONT TYPES

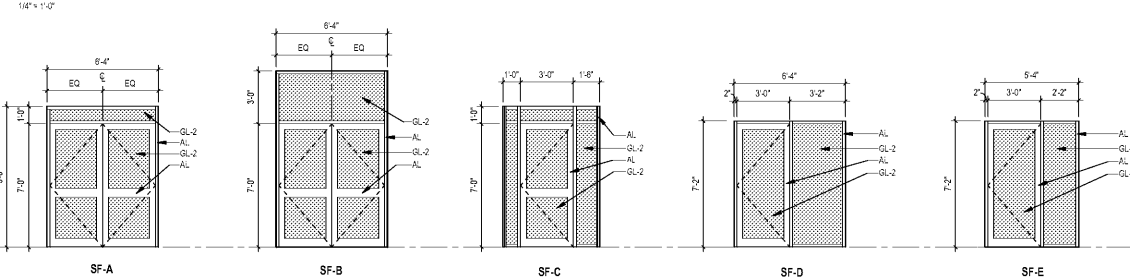

WINDOW TYPES

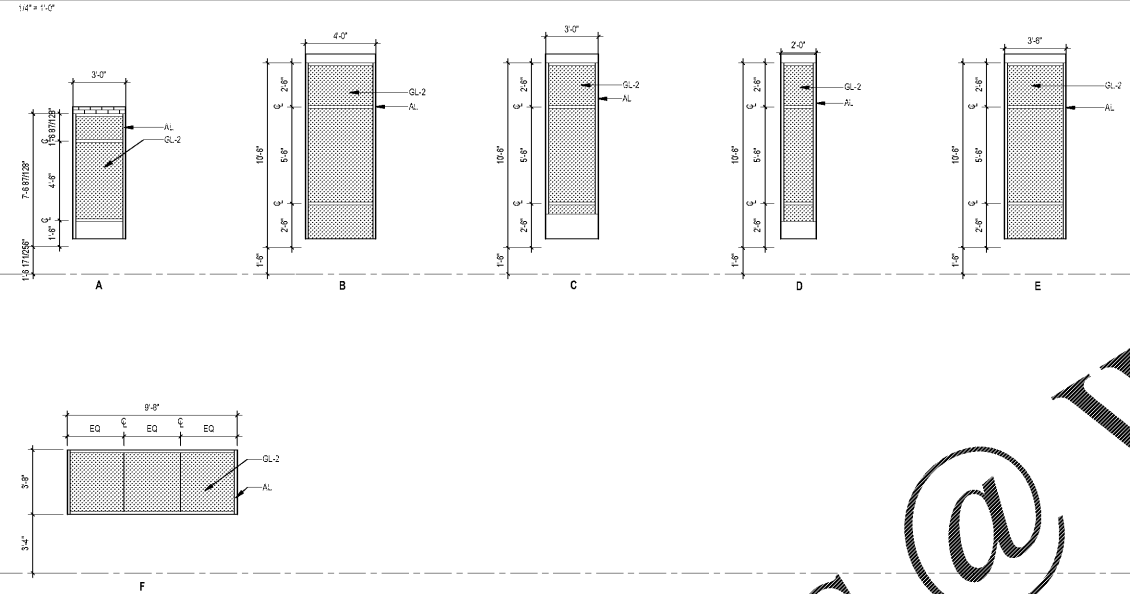

DOOR SCHEDULE

| SCHEDULE KEY: | | DOOR MATERIAL: | | FRAME MATERIAL: | | DOOR / FRAME FINISH: | | GLAZING TYPE: | | DETAIL: | | FIRE RATING: | | HARDWARE SET: | |
|-----------------------------|--------------------------------|----------------|--------------------|-----------------|--------------------|----------------------|------------------|---------------|--------------------|---------|-------------------------------|--------------|-------------------|---|--|
| MARK | TYPE | AL | CLAD WOOD | AL | ALUMINUM CLAD WOOD | EXT | EXTING TO REMAIN | GL-1 | GL-2 | GL-3 | REFER TO DETAILS AS INDICATED | N | MINUTES | REFER TO PROJECT MANUAL DIVISION 08 FOR HARDWARE SCHEDULE | |
| AS SPECIFIED ON FLOOR PLANS | REFER TO LEGENDS ON THIS SHEET | AL | EXISTING TO REMAIN | AL | EXISTING TO REMAIN | EXT | PRE-FINISHED | GL-1 | DOUBLE PANE, CLEAR | GL-2 | DOUBLE PANE, CLEAR | GL-3 | DOUBLE PANE, GRAY | | |
| 101A | 6'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 101B | 3'-0" | 7'-0" | S2 | AL | FF | F1 | HM | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 101C | 6'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 102A | 3'-0" | 7'-0" | S | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 102B | 3'-0" | 7'-0" | S | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 102C | 3'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 103 | 3'-0" | 7'-0" | S | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 104 | 3'-0" | 7'-0" | F | HM | FF | F1 | HM | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 105 | 3'-0" | 7'-0" | F | HM | FF | F1 | HM | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 106 | 3'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 107 | 3'-0" | 7'-0" | S | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 108 | 3'-0" | 7'-0" | S | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 109 | 3'-0" | 7'-0" | F | HM | FF | F1 | HM | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 110 | 3'-0" | 7'-0" | F | HM | FF | F1 | HM | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 111A | 3'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |
| 111B | 3'-0" | 7'-0" | S2 | AL | FF | - | AL | FF | - | XIA-601 | XIA-601 | XIA-601 | - | - | |

WINDOW SCHEDULE KEY

- WINDOW MARK AS SHOWN ON FLOOR PLANS
- WINDOW TYPE REFER TO WINDOW TYPES ON SHEET A-401
- WINDOW CONSTRUCTION AL ALUMINUM WD WOOD VL VINYL
- WINDOW FINISH S2 PRE-FINISHED PTD. PAINTED
- FRAME TYPE REFER TO WINDOW FRAME TYPES ON SHEET A-401
- GLAZING TYPES GL-1 SINGLE PANE, CLEAR GL-2 DOUBLE PANE, CLEAR GL-3 DOUBLE PANE, GRAY
- FIRE RATING IN MINUTES
- DETAILS REFER TO DETAILS AS INDICATED IN SCHEDULE

GENERAL NOTES

- DOOR THICKNESS SHALL BE 1-3/4" U.N.D.
- UNDERCUTTING OF FIRE DOORS TO BE AS SPECIFIED IN NFPA 80 TABLE 1-11.4
- ALL DOORS IN SMOKE BARRIERS AND FIRE RATED ASSEMBLIES SHALL BE SELF CLOSING OR PROVIDE WITH FALL-SAFE HOLD-OPEN DEVICES.
- WHEN DOORS ARE AUTOMATIC CLOSING BY SMOKE DETECTION, THE MAXIMUM DELAY FOR THE DOOR TO BEGIN CLOSING IS 10 SECONDS.
- FOR 30 MINUTE AND 60 MINUTE DOORS IN STAIRWAYS, THE AVERAGE TEMPERATURE RISE DEVELOPED ON THE UNEXPOSED SIDE SHALL NOT EXCEED 450 DEGREES (F).
- GLASS IN FIRE DOORS SHALL BE EMBEDDED IN PUTTY, AND ALL EXPOSED JOINTS BETWEEN METAL AND GLASS SHALL BE STRUCK AND POINTED.
- ALL VIEW PANELS IN FIRE DOORS SHALL BE LABELED AND SHALL HAVE A MINIMUM RATING OF 45 MINUTES PER NFPA 267.
- IN STAIRWAYS, IF SMOKE ACTIVATED CLOSERS CLOSE ONE DOOR, ALL DOORS SERVING THAT STAIRWAY SHALL BE CLOSED.
- FIRE RATED DOORS AND THE ACCOMPANYING HARDWARE FINISHES, INCLUDING DEVICES, ANCHORAGE AND SLLS SHALL BE APPROVED LISTED AND LABELED IN ACCORDANCE WITH THE REQUIREMENTS OF NFPA 80.
- COMBUSTIBLE FLOOR FINISHES HAVING A COMBUSTION INDEX OF 0.22 OR GREATER SHALL NOT EXTEND UNDER FIRE RATED DOORS. SUCH FINISHES SHALL BE METAL JOLTS A MINIMUM WIDTH EQUAL TO THE LAMB DEPTH OR 4 INCHES, WHICHEVER IS GREATER.
- IF A DOOR IS EQUIPPED WITH A CLOSURE SCHEDULE LOCK, IT SHALL BE SET SO THAT FROM AN OPEN POSITION, IT WILL REQUIRE THE DOOR TO BE AT LEAST 15 SECONDS TO MOVE TO A POINT 3 INCHES FROM THE LATCH MECHANISM FROM THE LEADING EDGE OF THE DOOR.
- THE MAXIMUM DOOR OPENING SHALL BE 15 LBF (68N) TO PUSH OR PULLING OPEN AN INTERIOR HINGED DOOR OR SLIGHTLY FOLDING DOORS SHALL BE 22 ZN.
- MOUNT OPENING DEVICES AT 30 INCHES ABOVE FINISH FLOOR IN ELEMENTARY SCHOOLS OR OTHER STRUCTURES WHERE USED PRIMARILY FOR YOUNG CHILDREN. DO NOT OVERLAP HARDWARE OVER GLASS AREAS.
- DO NOT OPENING DEVICES BETWEEN 30 AND 42 INCHES ABOVE FINISH FLOOR FOR ALL BUILDINGS USED PRIMARILY BY ADULTS. DO NOT OVERLAP HARDWARE OVER GLASS AREAS.
- AUTOMATIC DOORS AND POWER ASSISTED DOORS SHALL NOT OPEN TO BACK CHECK FASTER THAN 3 SECONDS AND SHALL REQUIRE NO MORE THAN 15 LBF (68N) TO STOP DOOR MOVEMENT.
- SURFACE APPLIED HARDWARE SHALL BE APPLIED TO THE FACE OF DOORS WITHOUT REMOVING MATERIAL FROM THE DOOR OTHER THAN A MAXIMUM OF 1/8" DIAMETER HOLES TO ACCOMMODATE OPERATIONAL ELEMENTS. WITH THE EXCEPTION OF CYLINDER HOLES WHICH SHALL BE MADE AS SMALL AS POSSIBLE.
- SIGNAGE ON RATED DOORS SHALL NOT EXCEED 8% OF THE AREA OF THE FACE OF THE DOOR. THEY SHALL BE ATTACHED USING ADHESIVE, SCREWS, NAILS ARE NOT PERMITTED.
- SIGNAGE SHALL NOT BE APPLIED TO GLASS AREAS OR ON THE OPERATING HARDWARE.
- KNURL, ALL KNOBS OR LEVERS TO MECHANICAL ROOMS, ELECTRICAL ROOMS OR CLOSETS AND OTHER HAZARDOUS AREAS THAT MAY PROVIDE DANGEROUS TO THE VISUALLY IMPAIRED. FIRE EXIT STAR DOOR HARDWARE SHALL NOT BE KNURLED.
- ALL DOORS TO BE POSITIVE LATCHING.
- MANUFACTURER'S INSTALLATION INSTRUCTIONS SHALL BE AVAILABLE AT THE JOB SITE FOR ALL RATED DOOR ASSEMBLIES.

Order Plans @ www.LDILine.com

1925 Prospect Ave.
Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.l.d.i.com



SITE KEY:

CLIENT NAME
HUTTON DEVELOPMENT
756 Cherry Street
Chattanooga, TN 37402

PROJECT NAME
ROCKLEDGE FLATS - BUILDING C
220 Barton Boulevard
Rockledge, FL 32955

SHEET TITLE
DOOR AND WINDOW SCHEDULES AND DETAILS

| Revision Schedule | |
|-------------------|-------------|
| No. | Description |
| | |
| | |
| | |

PROJECT NO. 21002
DATE 2/25/10
DRAWN
CHECKED
DATE NOV 03, 2015

GMP PRICING SET 15 NOVEMBER 2019