



DOOR TYPES

1/4" = 1'-0"

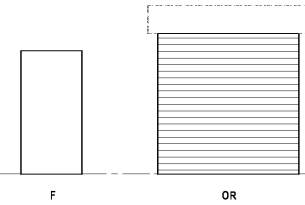

DOOR FRAME TYPES


1/4" = 1'-0"



WINDOW TYPES

1/4" = 1'-0"

(WINDOW NUMBERS BASED ON PELLA)

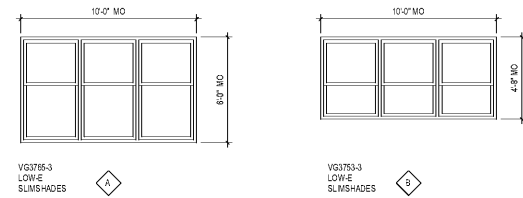

- 0 WINDOW MARK: AS SHOWN ON FLOOR PLANS
- 1 WINDOW TYPE: REFER TO WINDOW TYPES ON SHEET A-01
- 2 WINDOW CONSTRUCTION: AL ALUMINUM, WD WOOD, VL VINYL
- 3 WINDOW & FINISH: P.F. PRE-FINISHED, PTD. PAINTED
- 4 FRAME TYPE: REFER TO WINDOW FRAME TYPES ON SHEET A-01
- 5 GLAZING TYPES: GL-1 SINGLE PANE CLEAR, GL-2 DOUBLE PANE CLEAR, GL-3 DOUBLE PANE GRAY
- 6 FIRE RATING: IN MINUTES
- 7 DETAILS: REFER TO DETAILS AS INDICATED IN SCHEDULE

DOOR SCHEDULE

MARK	TYPE	DOOR MATERIAL	FRAME MATERIAL	DOOR / FRAME FINISH	GLAZING TYPE	DETAIL	FIRE RATING	HARDWARE SET
AS SPECIFIED ON FLOOR PLANS	REFER TO LEGENDS ON THIS SHEET	AL ALUMINUM CW CLAD WOOD EXT EXISTING TO REMAIN FG FIBERGLASS PVC POLYVINYL CHLORIDE ST STEEL VL VINYL WD WOOD	AL ALUMINUM CW CLAD WOOD EXT EXISTING TO REMAIN FG FIBERGLASS HM HOLLOW METAL PVC POLYVINYL CHLORIDE ST STEEL VL VINYL WD WOOD	PF PRE-FINISHED PTD PAINTED STN STAINED	GL-1 SINGLE PANE CLEAR GL-2 DOUBLE PANE CLEAR GL-3 DOUBLE PANE GRAY	REFER TO DETAILS AS INDICATED	IN MINUTES	REFER TO PROJECT MANUAL DIVISION 08 FOR HARDWARE SCHEDULE

SCHEDULE NOTES:
1 CONTRACTOR SHALL VERIFY ALL PROVIDED QUANTITIES

MARK	SIZE			GLAZING TYPE	FRAME			DETAIL			FIRE RATING		NOTES		
	WIDTH	HEIGHT	THICK.		TYPE	MAT'L	FINISH	DEPTH	HEAD	JAMB	THRSH	WALL		LBL.	
101	8'-0"	7'-0"	1-3/4"	-	F	HM	PF	F3	HM	PF	3-3/4"	-	-	-	-
102A	3'-0"	7'-0"	1-3/4"	-	F	HM	PF	F2	HM	PF	3-3/4"	-	-	-	-
102B	8'-0"	9'-0"	1-3/4"	-	F	ST	GR	MFR	ST	-	-	-	-	-	-
105	4'-0"	7'-0"	1-3/4"	-	F	HM	PF	F2	HM	PF	3-3/4"	-	-	-	-
108	3'-0"	7'-0"	1-3/4"	-	F	HM	PF	F2	HM	PF	3-3/4"	-	-	-	-

WINDOW SCHEDULE

MARK	TYPE	FRAME MATERIAL	FRAME FINISH	GLAZING TYPES	DETAILS	FIRE RATING
AS SPECIFIED ON FLOOR PLANS	REFER TO LEGENDS ON THIS SHEET	AL ALUMINUM CW CLAD WOOD FG FIBERGLASS PVC POLYVINYL CHLORIDE ST STEEL VL VINYL WD WOOD	PF PRE-FINISHED PTD PAINTED STN STAINED	GL-1 SINGLE PANE CLEAR GL-2 DOUBLE PANE CLEAR GL-3 DOUBLE PANE GRAY	REFER TO DETAILS AS INDICATED	IN MINUTES

SCHEDULE NOTES:
1 CONTRACTOR SHALL VERIFY ALL PROVIDED QUANTITIES



REV.	DATE	DESCRIPTION	FRAME			DETAIL			FIRE RATING		NOTES
			TYPE	MAT'L	FINISH	HEAD	JAMB	SILL	WALL	WINDW	

GENERAL NOTES

- DOOR THICKNESS SHALL BE 1-3/4" UNLESS OTHERWISE NOTED.
- UNDERCUTTING OF FIRE DOORS TO BE AS SPECIFIED IN NFPA 80 TABLE 1-11.4.
- ALL DOORS IN SMOKE BARRIERS AND FIRE RATED ASSEMBLIES SHALL BE SELF-CLOSING OR PROVIDE WITH FALL-SAFE HOLD-OPEN DEVICES.
- WHEN DOORS ARE AUTOMATIC CLOSING BY SMOKE DETECTION, THE MAXIMUM DELAY FOR THE DOOR TO BEGIN CLOSING IS 15 SECONDS.
- FOR 90 MINUTE AND 60 MINUTE DOORS IN STAIRWAYS, THE AVERAGE TEMPERATURE RISE DEVELOPED ON THE UNEXPOSED SIDE SHALL NOT EXCEED 450 DEGREES (F).
- GLASS IN FIRE DOORS SHALL BE EMBEDDED IN PUTTY, AND ALL EXPOSED JOINTS BETWEEN METAL AND GLASS SHALL BE STRUCK AND POINTED.
- ALL VENEER PANELS IN FIRE DOORS SHALL BE LABELED AND SHALL HAVE A MINIMUM RATING OF 45 MINUTES PER NFPA 267.
- IN STAIRWAYS, IF SMOKE ACTIVATED CLOSERS CLOSE ONE DOOR, ALL DOORS SERVING THAT STAIRWAY SHALL BE CLOSED.
- FIRE RATED DOORS AND THE ACCOMPANYING HARDWARE, FRAME, CLOSING DEVICES, ANCHORAGE AND SILLS SHALL BE APPROVED LISTED AND LABELED IN ACCORDANCE WITH THE REQUIREMENTS OF NFPA 80.
- COMBUSTIBLE FLOOR FINISHES HAVING A CRITICAL FLAME SPREAD RATING SHALL NOT EXTEND UNDER FIRE RATED DOORS. SUCH DOORS SHALL HAVE METAL SILLS WITH A MINIMUM WIDTH EQUAL TO THE LAMB DEPTH OR 4 INCHES, WHICHEVER IS LESS.
- IF A DOOR IS EQUIPPED WITH A CLOSER, THE STOP PERCENT SHALL BE SET SO THAT FROM AN OPEN POSITION OF 70 DEGREES THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3 INCHES FROM THE LATCH AND UNLATCHED FROM THE LEADING EDGE OF THE DOOR.
- THE MAXIMUM DOOR OPENING SPEED DURING OR PULLING OPEN AN INTERIOR HINGED DOOR OR SLIDING GLAZING DOORS SHALL BE 20 INCHES PER SECOND (20 IPS).
- MOUNT DOOR AND WINDOW CLOSERS AT 30 INCHES ABOVE FINISH FLOOR IN ELEMENTARY SCHOOLS OR OTHER STRUCTURES WHERE CHILDREN USE PRIMARILY FOR YOUNG CHILDREN. DO NOT OVERLAP HARDWARE OVER GLASS AREAS.
- MOUNT CLOSING DEVICES BETWEEN 30 AND 42 INCHES ABOVE FINISH FLOOR FOR ALL BUILDINGS USED PRIMARILY BY ADULTS. DO NOT OVERLAP HARDWARE OVER GLASS AREAS.
- AUTOMATIC DOORS AND POWER ASSISTED DOORS SHALL NOT OPEN TO BACK CHECK FASTER THAN 3 SECONDS AND SHALL REQUIRE NO MORE THAN 15 LBF (68N) TO STOP DOOR MOVEMENT.
- SURFACE APPLIED HARDWARE SHALL BE APPLIED TO THE FACE OF DOORS WITHOUT REMOVING MATERIAL FROM THE DOOR OTHER THAN A MAXIMUM OF 1/4 INCH DIAMETER HOLES TO ACCOMMODATE OPERATIONAL ELEMENTS, WITH THE EXCEPTION OF CYLINDER HOLES WHICH SHALL BE MADE AS SMALL AS POSSIBLE.
- SIGNAGE ON RATED DOORS SHALL NOT EXCEED 8% OF THE AREA OF THE FACE OF THE DOOR. THEY SHALL BE ATTACHED USING ADHESIVE. SCREWS, NAILS ARE NOT PERMITTED.
- SIGNAGE SHALL NOT BE APPLIED TO GLASS AREAS OR ON THE OPERATING HARDWARE.
- KNURL ALL KNOBS OR LEVERS TO MECHANICAL ROOMS, ELECTRICAL ROOMS OR CLOSETS AND OTHER HAZARDOUS AREAS THAT MAY PROVIDE DANGEROUS TO THE VISUALLY IMPAIRED. FIRE EXIT STAR DOOR HARDWARE SHALL NOT BE KNURLED.
- ALL DOORS TO BE POSITIVE LATCHING.
- MANUFACTURER'S INSTALLATION INSTRUCTIONS SHALL BE AVAILABLE AT THE JOB SITE FOR ALL RATED DOOR ASSEMBLIES.

Order Plans @ www.LDILine.com

1925 Prospect Ave.
Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.rp.com



CLIENT NAME
HUTTON DEVELOPMENT
756 Cherry Street
Chattanooga, TN 37402

PROJECT NAME
ROCKLEDGE FLATS - BUILDING D
220 Barton Boulevard
Rockledge, FL 32955

Revision Schedule	
No.	Description

PROJECT NO. 21002
DATE 20/01/01
DRAWN [Name]
CHECKED [Name]
NOV 03, 2015

GMP PRICING SET 15 NOVEMBER 2019