- -	- -	- -
- -	- -	- -
- -	- -	- -
- -	- -	- -
A-CLNG -FIRE	A-CLNG -FIRE	RED
A-WALL -FIRE	A-WALL -FIRE	RED
LS1.0x	LS1.0x	BLACK
A-TLSP -BASE	A-TLSP -BASE	BLACK
A-PRHT -WALL	A-PRHT -WALL	GREEN
A-PART -WALL	A-PART -WALL	BLACK
A-FULL -WALL	A-FULL -WALL	GREEN
A-WALL FIRE-FW	A-WALL FIRE-FW	RED
A-WALL FIRE-SB	A-WALL FIRE-SB	RED
A-WALL FIRE-SP	A-WALL FIRE-SP	RED
A-WALL FIRE-SW	A-WALL FIRE-SW	RED
A-WALL FIRE-4F	A-WALL FIRE-4F	RED
A-WALL FIRE-3F	A-WALL FIRE-3F	RED
A-WALL FIRE-2FS	A-WALL FIRE-2FS	RED
A-WALL FIRE-2F	A-WALL FIRE-2F	RED
A-WALL FIRE-1FS	A-WALL FIRE-1FS	RED
A-WALL FIRE-1F	A-WALL FIRE-1F	RED
A-WALL -EXST	A-WALL -EXST	SCR/ BLK
A-STRS -BASE	A-STRS -BASE	GREEN
A-ROOM -BASE	A-ROOM -BASE	BLACK
A-PATT -BASE	A-PATT -BASE	GREEN
A-OVHD -BASE	A-OVHD -BASE	GREEN
A-GRID -BASE	A-GRID -BASE	BLACK
A-GLAZ -BASE	A-GLAZ -BASE	GREEN
A-FUTR -CASE	A-FUTR -CASE	GREEN
A-FLOR -CASE	A-FLOR -CASE	GREEN
A-FIXT -CASE	A-FIXT -CASE	GREEN
A-EQPM -BASE	A-EQPM -BASE	BLUE
A-DOOR -BASE	A-DOOR -BASE	GREEN
- -	- -	- -
A-COLS -BASE	A-COLS -BASE	BLACK
A-UPPR -CASE	A-CASE -UPPR	GOLD
A-LOWR -CASE	A-CASE -LOWR	GOLD
A-BLDG -BASE	A-BLDG -BASE	SCR/ GREEN

DRAWING CREATED: - 6/5/2019 9:22 AM
LAST DRAWING UPDATE: - 11/4/2019 10:04 AM
PLOT DATE: - 5/29/2008 11:03 AM
FILE NAME: - 19020_LS103.dwg
SCALE FACTOR: - 1:96

DRAWING CREATED: - 10/14/2019 8:48 AM
LAST DRAWING UPDATE: - 11/8/2019 8:58 AM
PLOT DATE: - 3/16/2010 3:52 PM
FILE NAME: - _19020_ab03.dwg
SCALE FACTOR: - 1:96

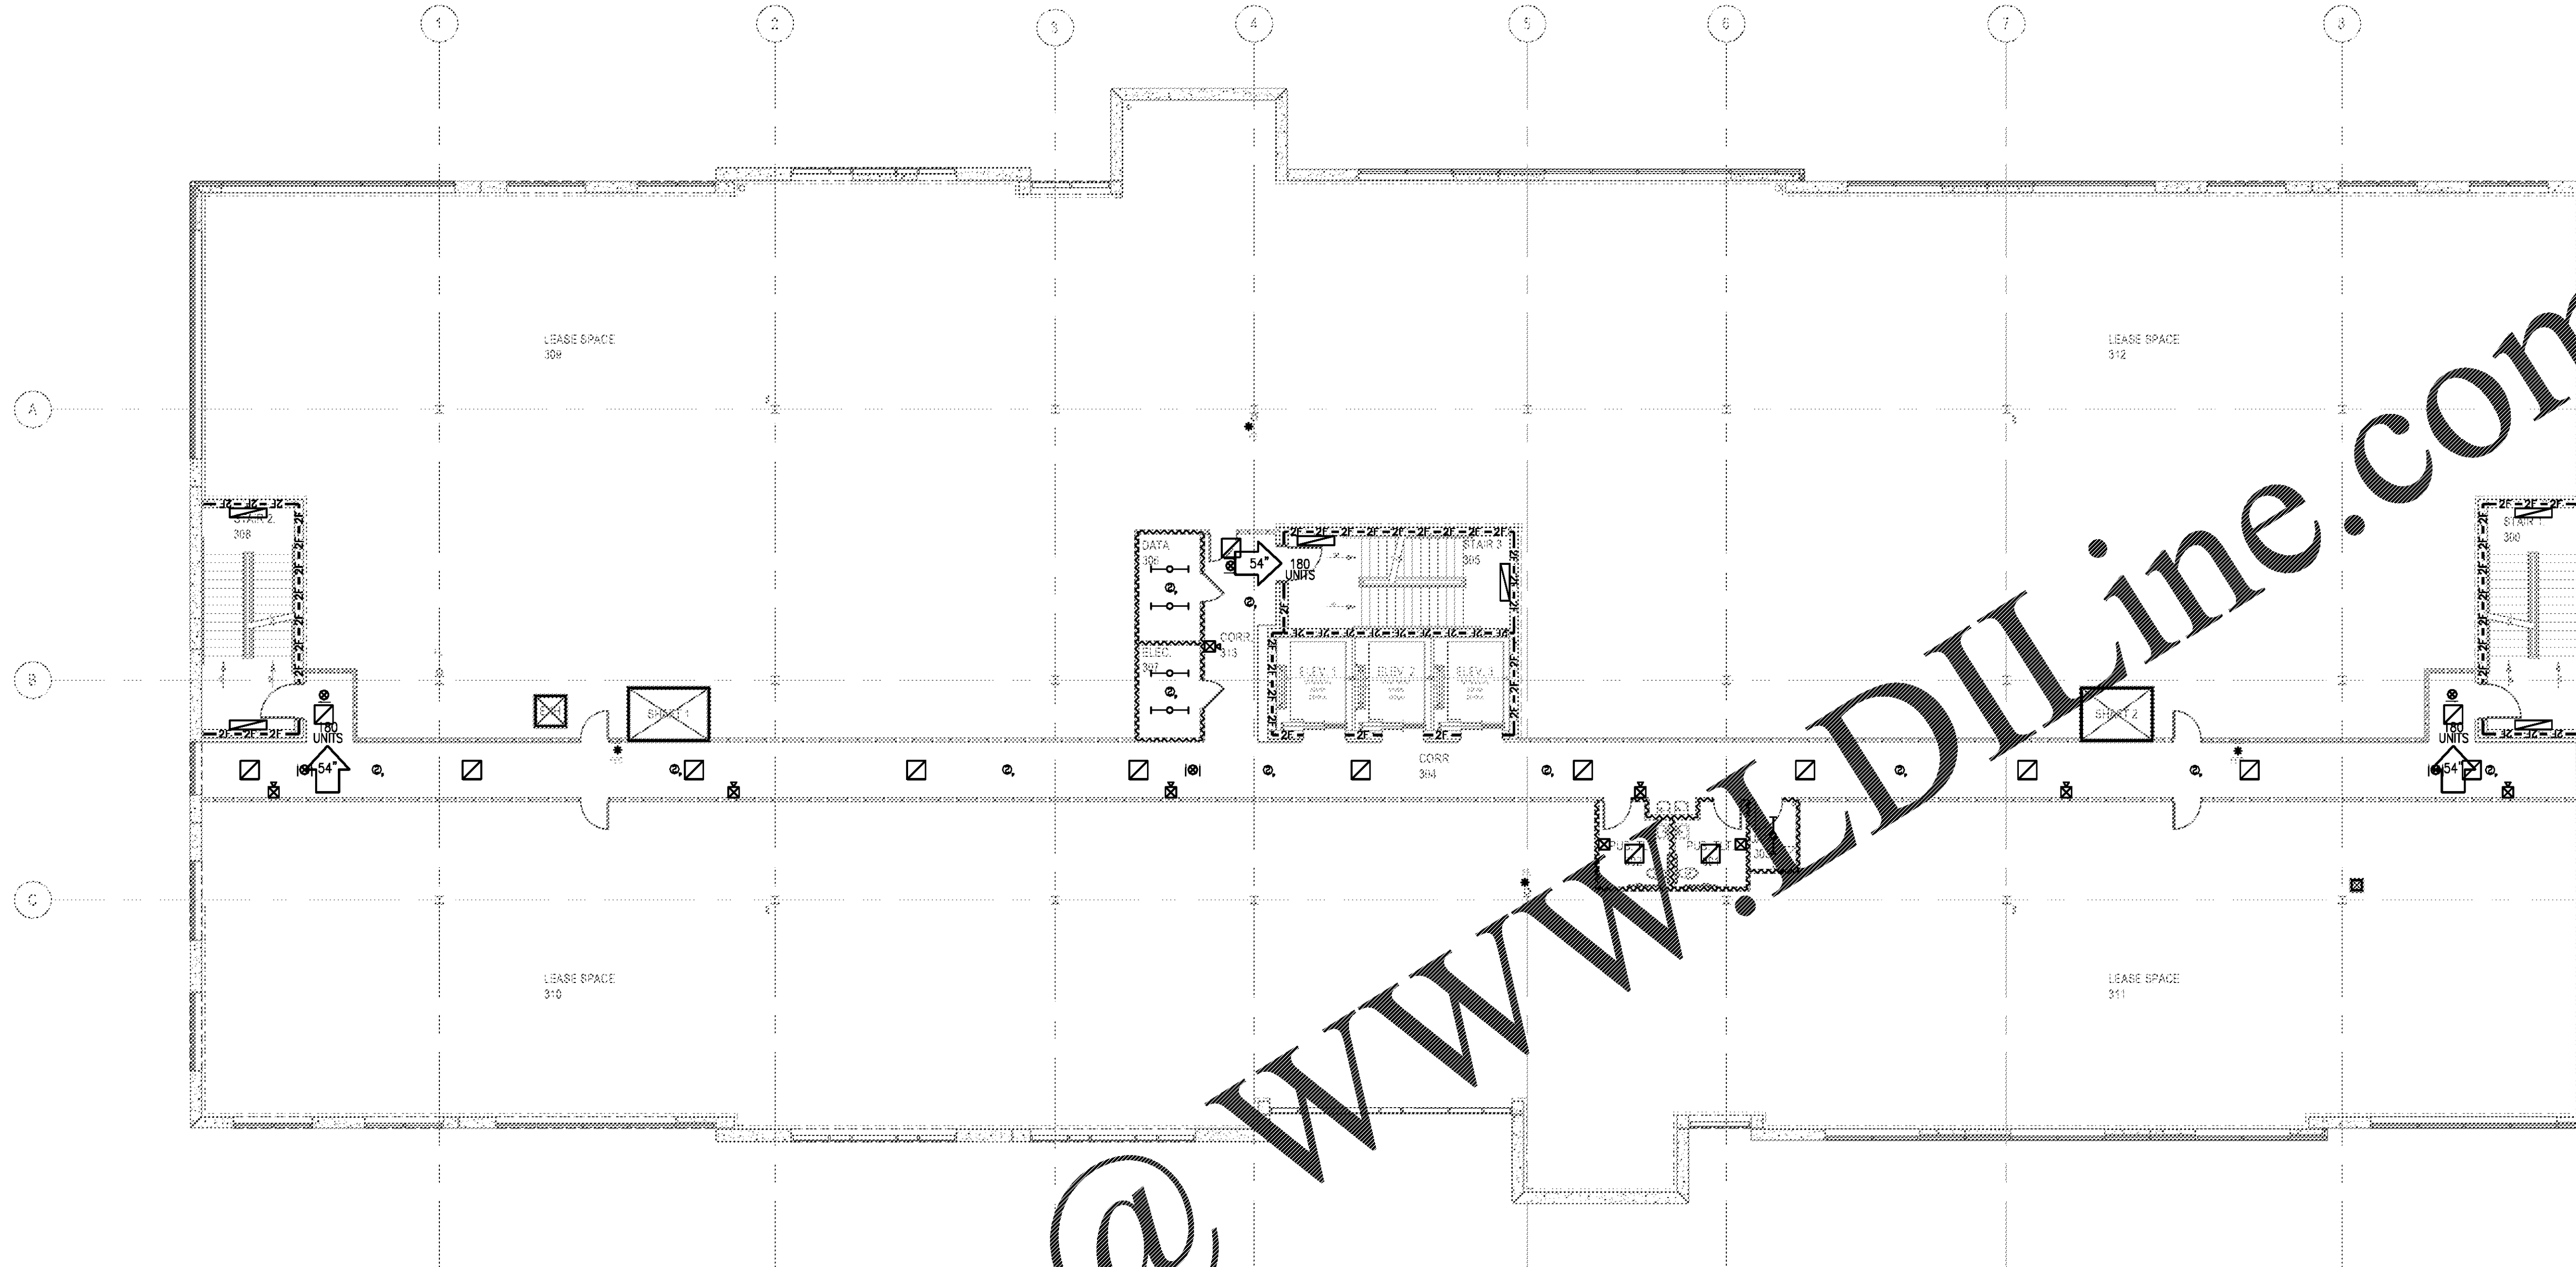

EXIT UNIT LEGEND

TOTAL OCCUPANCY LOAD = 269
TOTAL EXIT UNITS PROVIDED:

3 @ 54" = 162 / .3 = 540

TOTAL EXIT CAPACITY = 540 PEOPLE

0 2 4 8 16

LIFE SAFETY LEGEND

- EMERGENCY 2X4 LIGHTING
- EMERGENCY 2X2 LIGHTING
- EMERGENCY 1X4 LIGHTING
- EMERGENCY STRIP LIGHTING
- EMERGENCY INCANDESCENT LIGHTING
- EMERGENCY WALL MOUNTED LIGHTING
- EMERGENCY WALL PACK LIGHTING
- EXIT LIGHTS
- WALL MOUNTED EXIT LIGHTS
- SMOKE DETECTOR
- FIRE EXTINGUISHERS / CABINETS
- FIRE PULL STATION
- FIRE ALARM STROBE
- FIRE ALARM CHIME / STROBE

NOTE: ALL SYMBOLS MAY NOT BE USED.

EQUIPMENT LEGEND

- OWNER FURNISHED / CONTRACTOR INSTALLED
- CONTRACTOR FURNISHED / INSTALLED

WALL LEGEND

WALL CONSTRUCTION TYP.

- UNRATED PARTITION TO ABOVE CLG.
- LEASE SPACE PARTITION
- UNRATED PARTITION TO DECK
- X X X X X X X X SMOKE PARTITION
- SB SB SB SMOKE BARRIER
- 1F 1F 1F 1 HOUR FIRE BARRIER
- 1FS 1FS 1FS 1 HOUR FIRE – SMOKE BARRIER
- 2F 2F 2F 2 HOUR FIRE BARRIER
- 2FS 2FS 2FS 2 HOUR FIRE – SMOKE BARRIER
- 2 HOUR SHAFT BARRIER

NOTE: ALL WALL TYPES MAY NOT BE USED.

STATE OF FLORIDA WILLIE D. STOKES AR0011691 REGISTERED ARCHITECT
11/12/19

PRH MEDICAL OFFICE BUILDING

NAPLES, FLORIDA

THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO DAVIS, STOKES COLLABORATIVE, P.C. THIS DOCUMENT AND/OR IT'S CONTENTS MAY NOT BE REPRODUCED OR DISCLOSED TO OTHERS, EITHER IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF DAVIS, STOKES COLLABORATIVE, P.C. COPYRIGHT 2018, ALL RIGHTS RESERVED

DAVIS STOKES COLLABORATIVE P.C.
DSC ARCHITECTS
7121 CROSSROADS BLVD
BRENTWOOD, TN 37027
TEL (615) 726-0010
MAIL dscinfo@dscaai.com
WEB www.dscaai.com

REVISIONS

NO.	DATE	DESCRIPTION

LIFE SAFETY FLOOR PLAN
THIRD FLOOR

LS1.03

ISSUE DATE:	JOB NUMBER
11.12.19	19020

Order Plans @ WWW.LDILine.com