






PRM MEDICAL OFFICE BUILDING  
 NAPLES, FLORIDA

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION THAT IS THE PROPERTY OF DAVIS STOKES COLLABORATIVE P.C. ANY REPRODUCTION OR DISCLOSURE TO OTHERS WITHOUT THE WRITTEN CONSENT OF DAVIS STOKES COLLABORATIVE P.C. IS STRICTLY PROHIBITED. COPYRIGHT © 2019. ALL RIGHTS RESERVED.

DAVIS STOKES COLLABORATIVE P.C.  
**DSC ARCHITECTS**  
 7121 CROSSROADS BLVD.  
 BRENTWOOD, TN 37027  
 TEL: (615) 726-0010  
 MAIL: dclatiff@dscad.com  
 WWW: www.dscad.com

REVISIONS	
NO.	DESCRIPTION

TILT WALL PANEL ELEVATIONS  
**S5.02**  
 ISSUE DATE: 11/12/19 JOB NUMBER: 19020

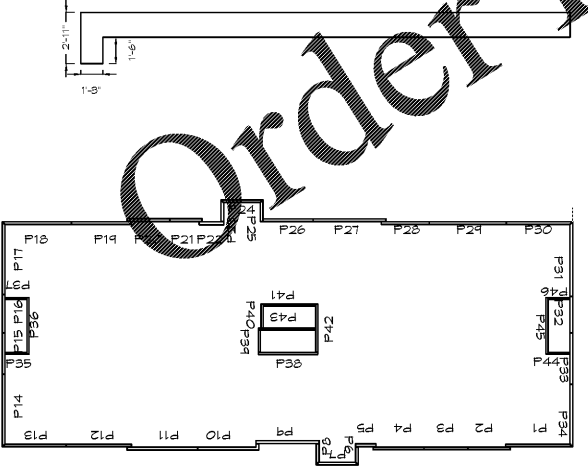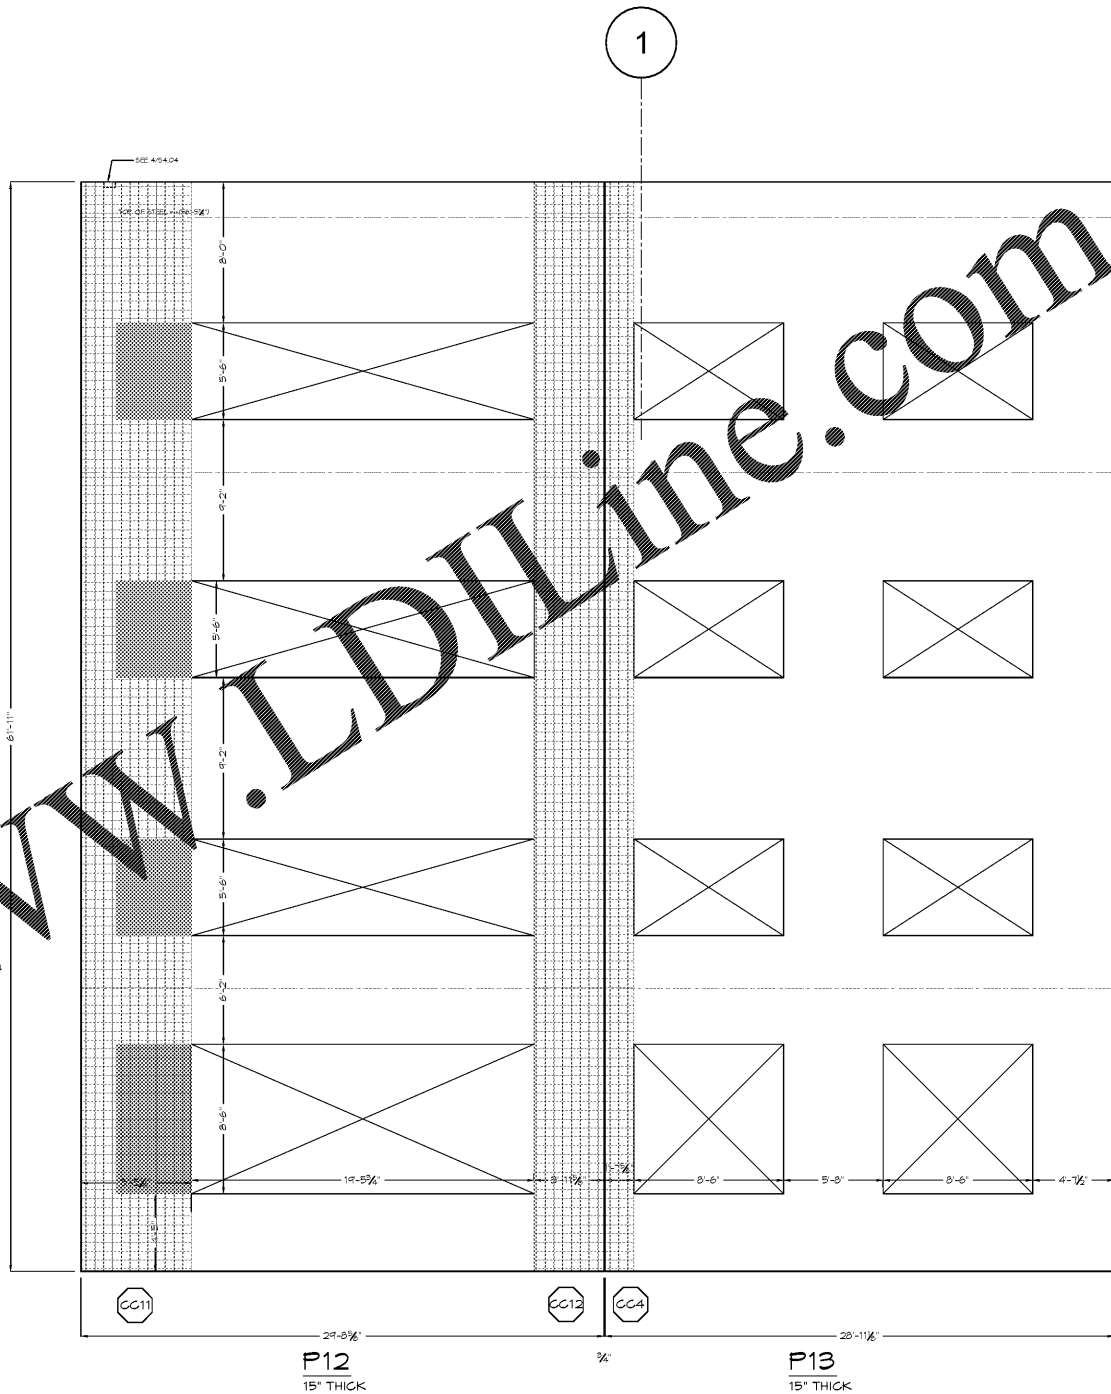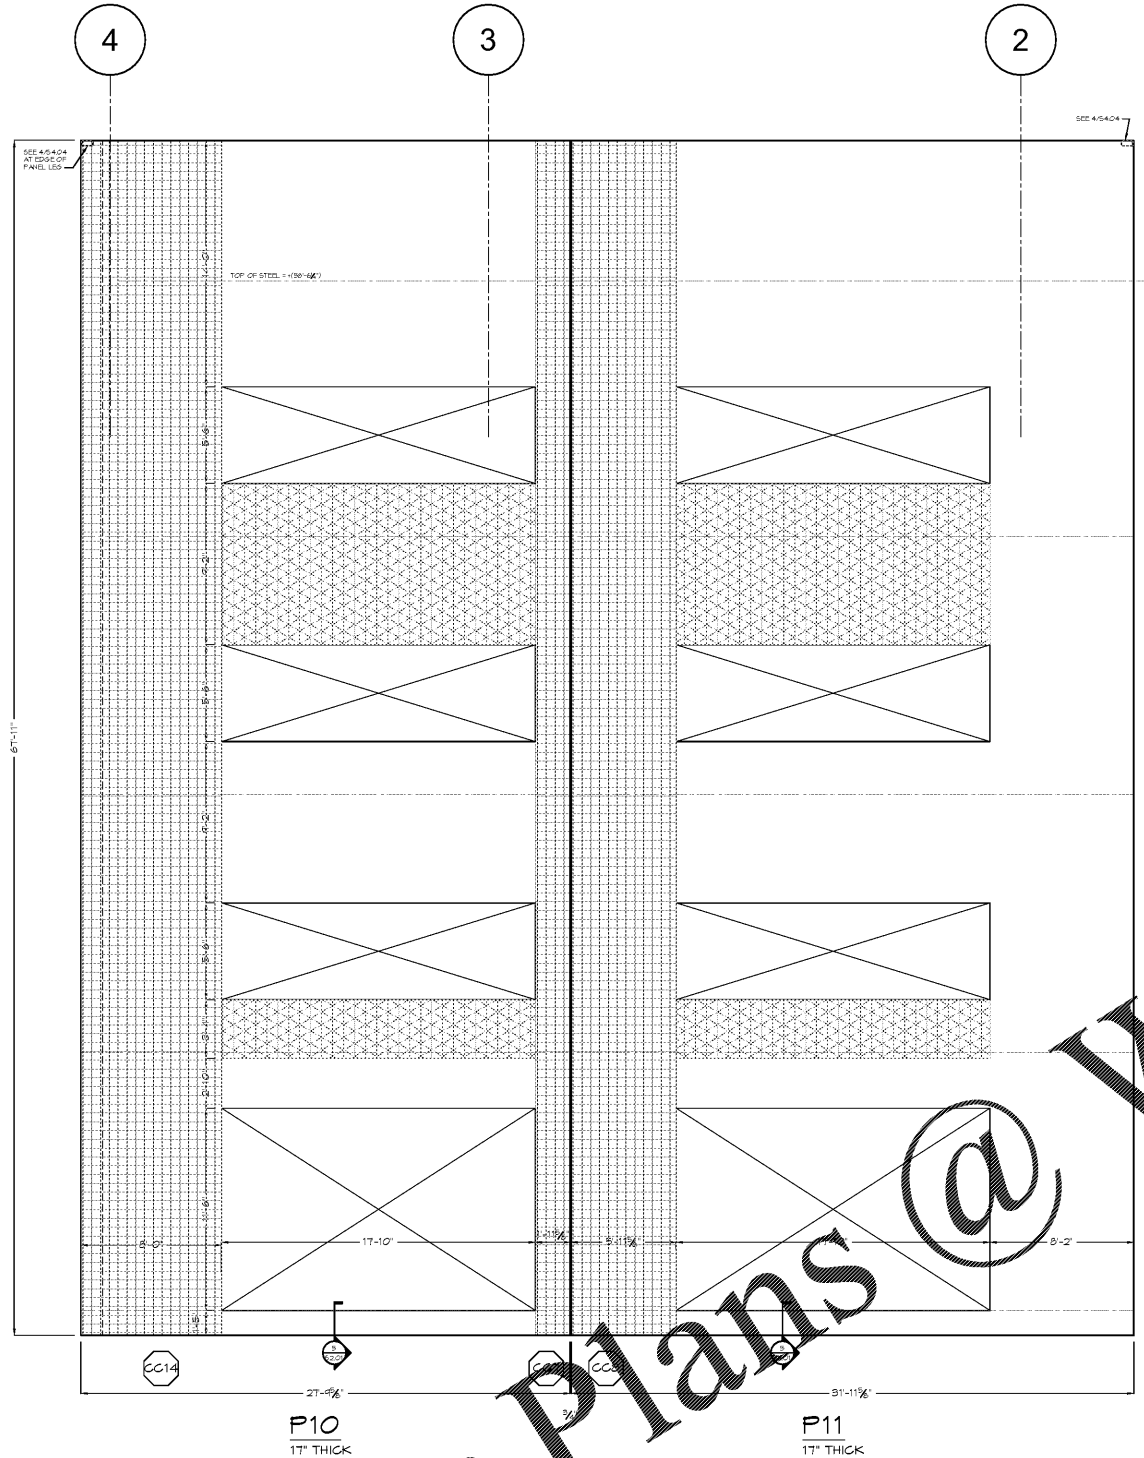

**TILT-UP PANEL ELEVATIONS**

**NOTES:**

- SEE S1.00 FOR ADDITIONAL TILT-UP NOTES.
- COORDINATE ALL DIMENSIONS WITH ARCHITECTURAL DRAWINGS.
- PROVIDE 15' TILT-UP PANELS W/ #4@12" C/C VERT EACH FACE & #4@12" C/C HORIZ EACH FACE UNO. SEE ELEVATIONS. PROVIDE 17' TILT-UP PANELS W/ #4@12" C/C VERT EACH FACE & #4@12" C/C HORIZ EACH FACE UNO. SEE ELEVATIONS.
- MAXIMUM REVEAL DEPTH ALLOWED SHALL BE 3/4".
- STAGGER LAP SPICES WITHIN WALL PIERS.
- CONTRACTOR TO COORDINATE ALL DOOR, WINDOW, & BLOCKOUT OPENING SIZES & LOCATIONS W/ ARCHITECTURAL DRAWINGS.
- DO NOT CORE THRU WALL PANELS WITHOUT PRIOR WRITTEN APPROVAL OF STRUCTURAL ENGINEER. CONTRACTOR TO COORDINATE LOCATIONS OF ANY MECHANICAL, ELECTRICAL, & PLUMBING PENETRATIONS PRIOR TO THE SHOP DRAWING PROCESS.
- ELEVATIONS DRAWN AS VIEWED FROM BUILDING INTERIOR UNO. SEE S1.01.
- ⊙ - INDICATES TIED COLUMN MARK. SEE S/56.01 FOR COLUMN SCHEDULE.
- SEE TYPICAL TILT-UP PANEL LAYOUT ON S/56.00 FOR REMAINDER OF INFORMATION.
- PROVIDE PANEL-TO-PANEL CONNECTIONS AT CORNERS AND INTERSECTING PANELS. SEE 4/56.00 & 7/56.00 FOR REMAINDER OF INFORMATION.
- SEE S/56.00 FOR HOOKED HORIZONTAL REINFORCING AT PIERS LESS THAN 2'-0" WIDE.
- SEE S/52.01 AND S/56.00 FOR HOOKED VERTICAL REINFORCING AT LGN FIRST FLOOR WINDOWS AND FIRST FLOOR DOORS.
- COORDINATE LOCATION OF EMBEDS FOR FLOOR FRAMING MEMBERS AND ROOF FRAMING MEMBERS WITH FRAMING PLANS AND DETAILS.
- ⊘ INDICATES T RECESSES IN 15' PANEL W/ #4@6" C/C EA MAY & EA FACE. SEE 1/56.01 FOR REINFORCING AT EDGES OF RECESSES.
- ⊘ INDICATES T RECESSES IN 17' PANEL W/ #4@6" C/C EA MAY & EA FACE. SEE 1/56.01 FOR REINFORCING AT EDGES OF RECESSES.

Order Plans @ WWW.LDILine.com