





**PRH  
 MEDICAL OFFICE BUILDING**  
 NAPLES, FLORIDA

THIS DOCUMENT CONTAINS  
 PROPRIETARY TO DAVIS STORES  
 INFORMATION. IT IS THE  
 PROPERTY OF DAVIS STORES  
 AND IS NOT TO BE  
 REPRODUCED, COPIED,  
 DISTRIBUTED, OR  
 OTHERWISE MADE  
 PUBLIC IN ANY MANNER  
 WITHOUT THE PRIOR  
 WRITTEN CONSENT OF  
 DAVIS STORES COLLABORATIVE, P.C.  
 COPYRIGHT 2019. ALL RIGHTS  
 RESERVED.

7121 CROSSROADS BVD  
 888-HYWOOD, IN 47027  
 TEL: (615) 776-0310  
 FAX: (615) 776-0310  
 MAIL: davisinfo@dscarch.com  
 WWW: www.dscarch.com

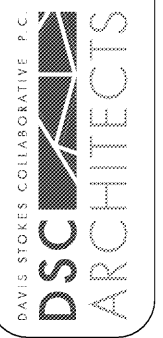

Order Plans @ [www.LDILine.com](http://www.LDILine.com)

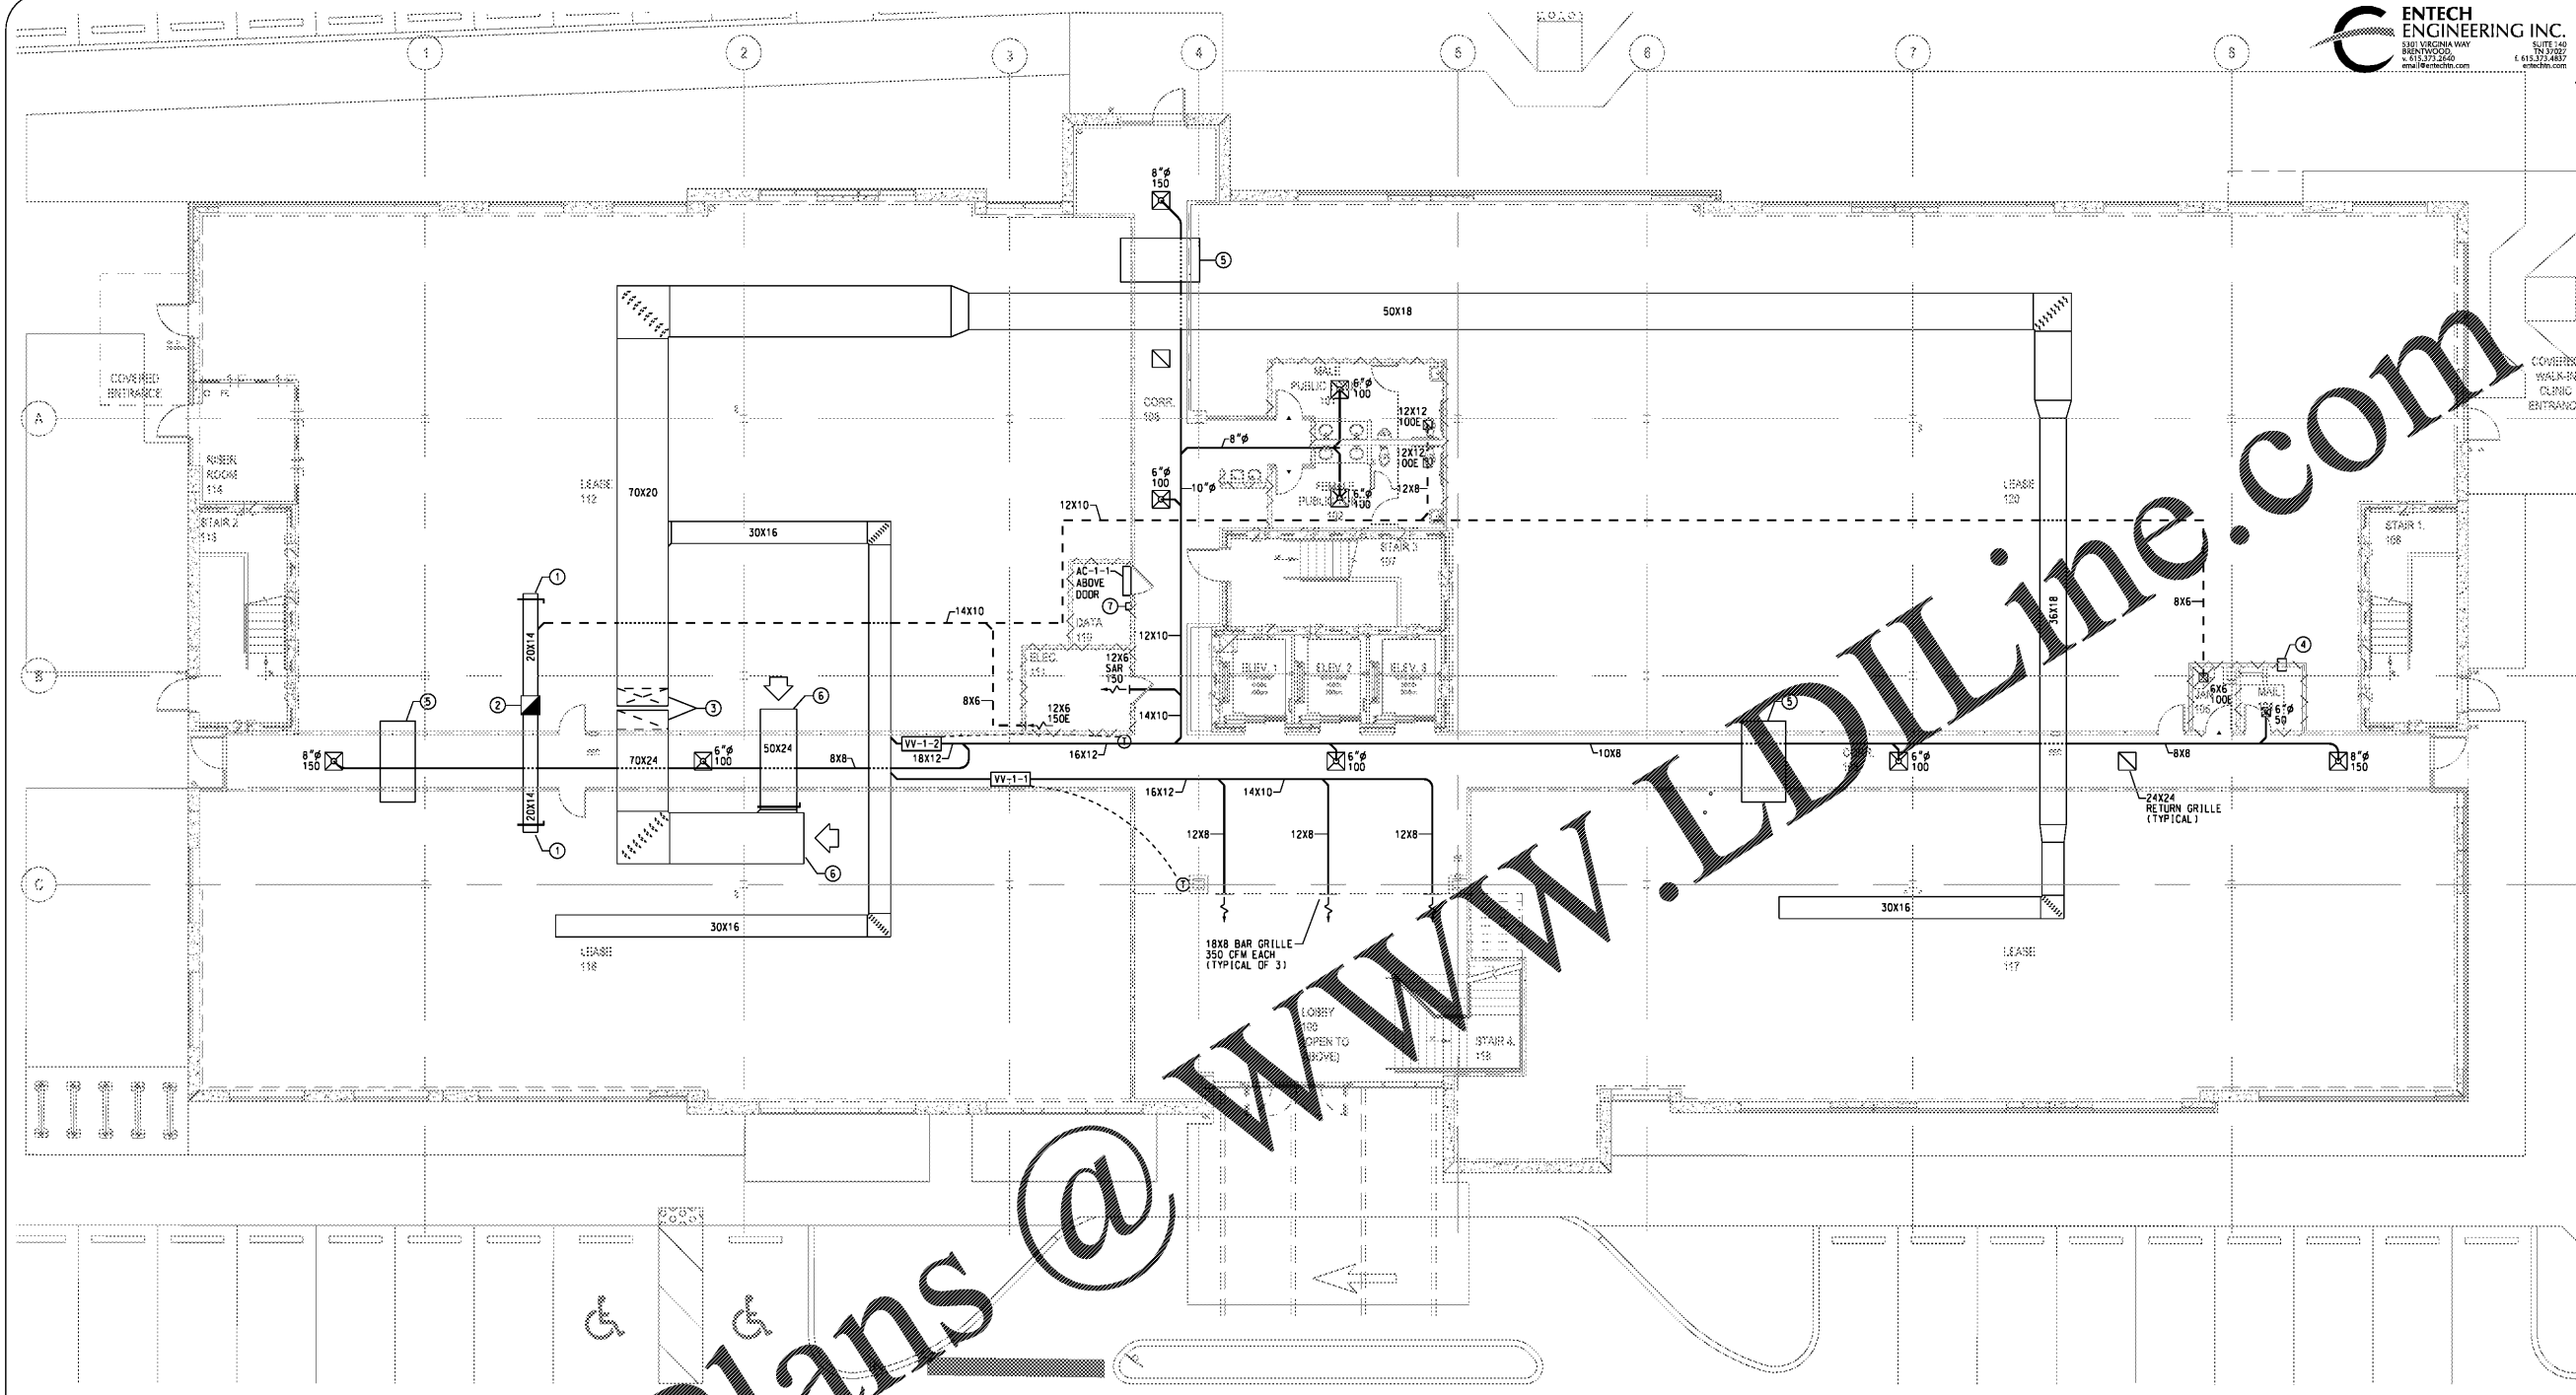

**GENERAL NOTES:**

- A. SPACE ABOVE LAY IN CEILING IS USED AS A RETURN AIR PLENUM. ALL ITEMS INSTALLED IN PLENUM SPACE MUST BE RATED FOR USE IN PLENUM AND MEET ALL SPREAD/SMOKE DEVELOPED RATINGS.

**PLAN NOTES:**

- 1. 20X14 EXHAUST DUCT STUBBED OUT FOR FUTURE USE.
- 2. 26X26 UP TO 2ND FLOOR.
- 3. PROVIDE FIRE/SMOKE DAMPERS WHERE DUCT EXITS CHASE.
- 4. 12X6 TRANSFER DUCT ABOVE CEILING.
- 5. 60X12 TRANSFER DUCT ABOVE CEILING.
- 6. OPEN END RETURN DUCT. COVER OPENING WITH HARDWARE CLOTH.
- 7. BUILDING CONTROLS COMPUTER/CONNECTION.

WALL LEGEND	
WALL CONSTRUCTION TYP.	
	UNRATED PARTITION TO ABOVE CLG.
	LEASE SPACE PARTITION
	UNRATED PARTITION TO DECK
	SMOKE PARTITION
	SMOKE BARRIER
	1 HOUR FIRE BARRIER
	1 HOUR FIRE - SMOKE BARRIER
	2 HOUR FIRE BARRIER
	2 HOUR FIRE - SMOKE BARRIER
	2 HOUR SHAFT BARRIER

NOTE: 1.) FOR SOUND WALLS SEE DIMENSIONED PLAN.  
 2.) ALL WALL TYPES MAY NOT BE USED.

HVAC  
 FIRST FLOOR PLAN



REVISIONS	
NO.	DATE

**M1.01**  
 ISSUE DATE: 11.12.19  
 JOB NUMBER: 19029