



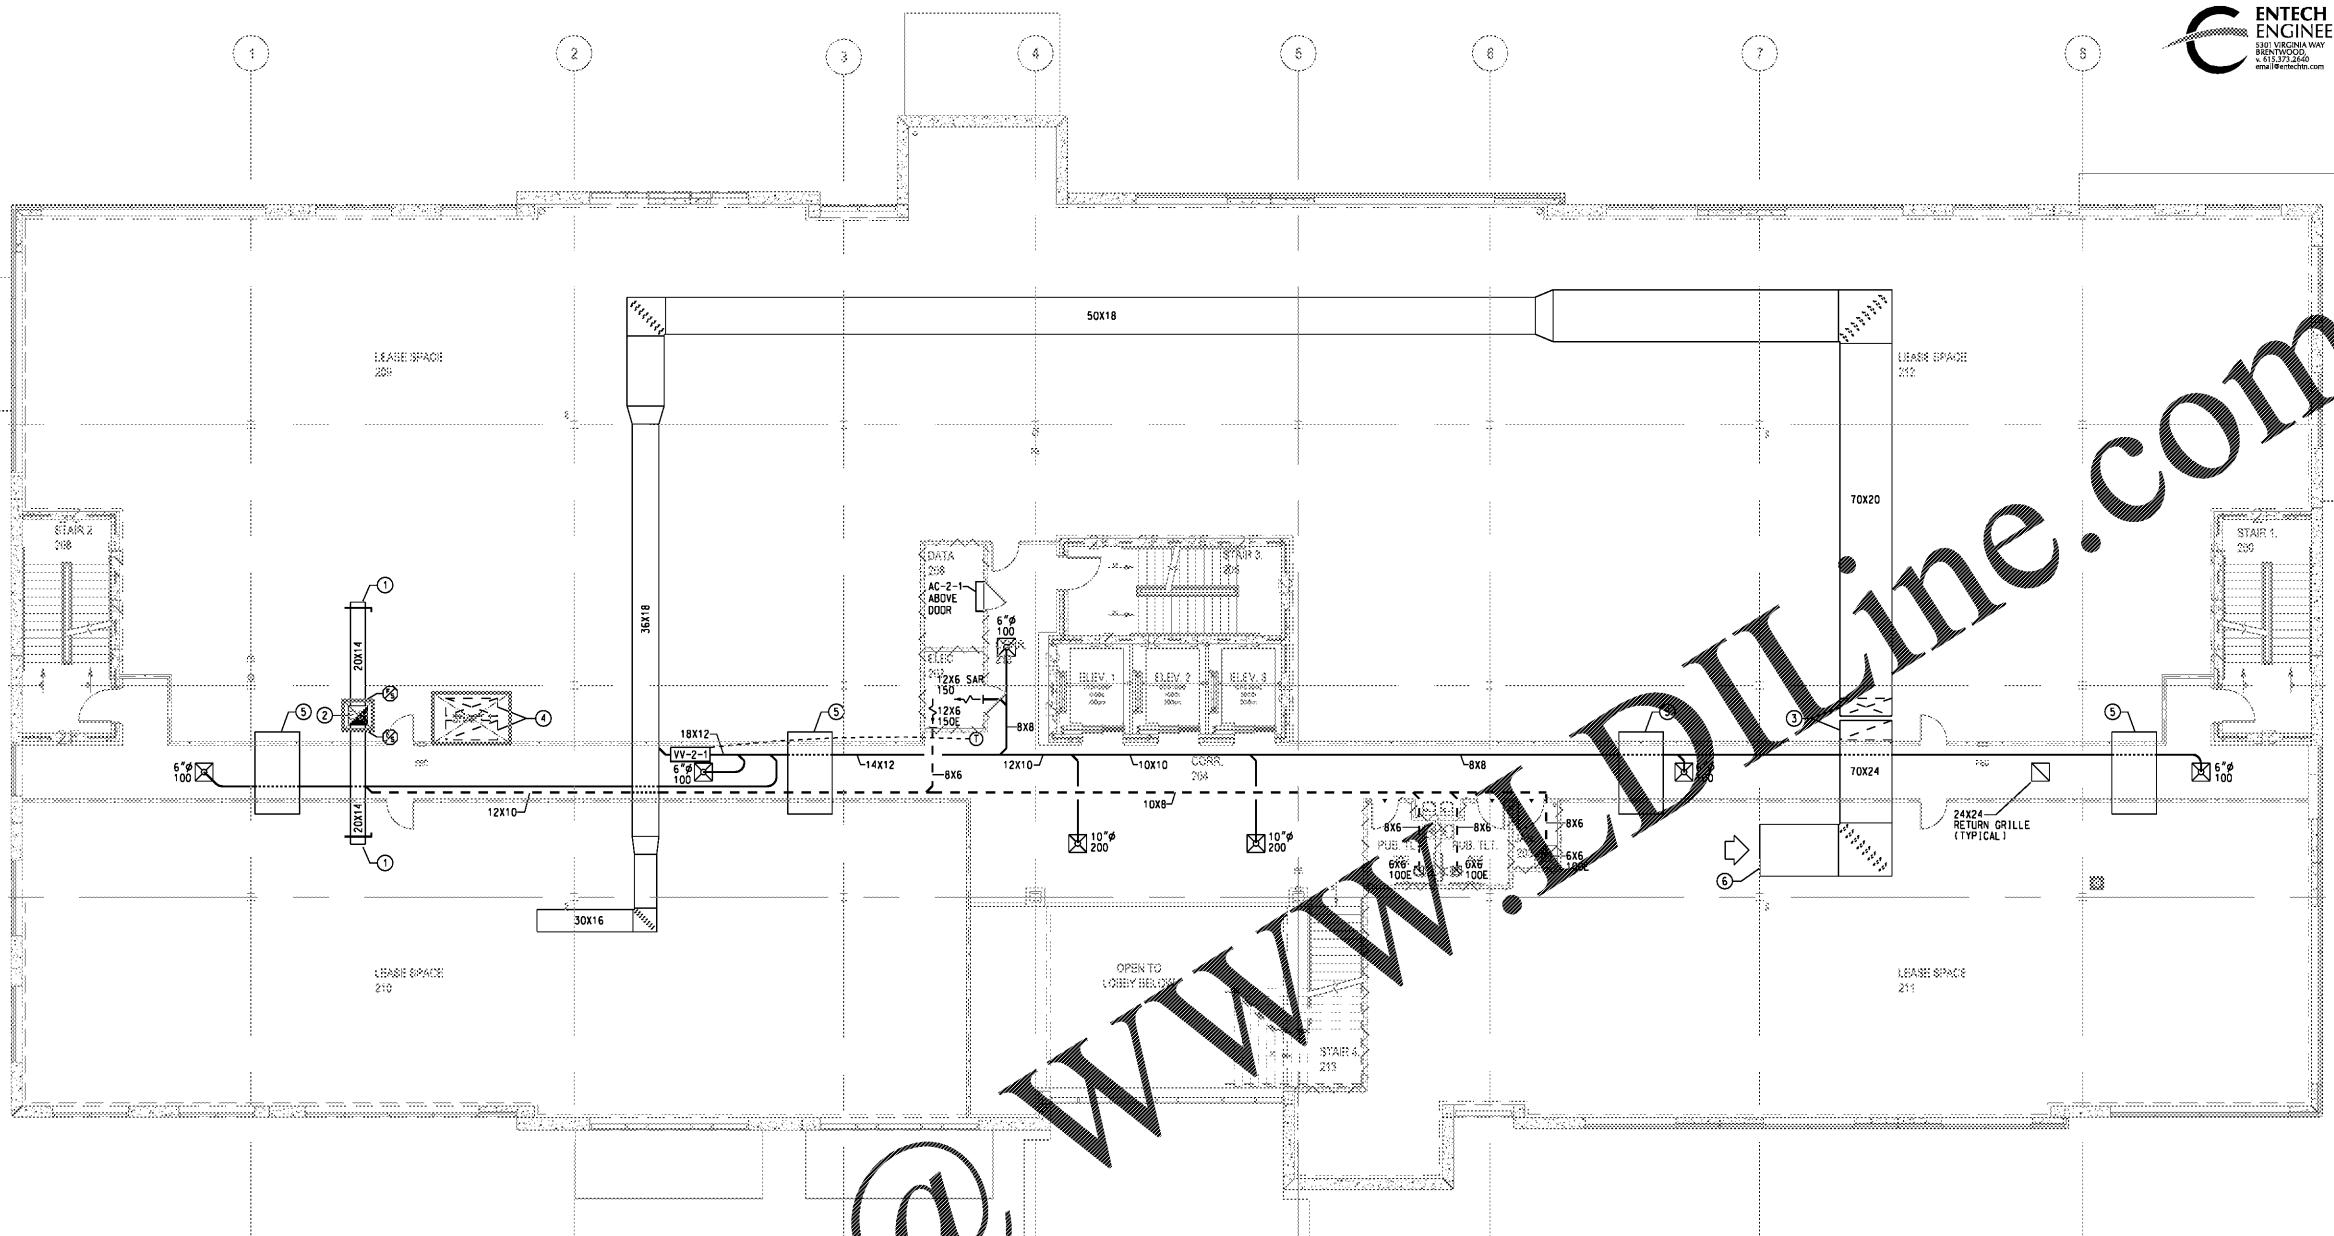

**PRH
MEDICAL OFFICE BUILDING**
NAPLES, FLORIDA

THIS DOCUMENT CONTAINS
PROFESSIONAL INFORMATION
PROPERTY OF ENTECH ENGINEERING INC.
CONTENTS MAY NOT BE
REPRODUCED OR TRANSMITTED IN ANY
FORM, WITHOUT THE PRIOR
WRITTEN PERMISSION OF
ENTECH ENGINEERING INC.
COPYRIGHT 2019. ALL RIGHTS
RESERVED.

7121 CROSSROADS BVD
888-HYWOOD, IN 47027
TEL: (615) 776-0310
MAIL: dscinfo@dscarch.com
WWW: www.dscarch.com

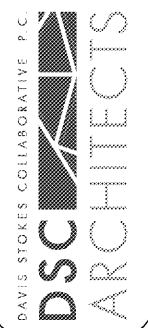

Order Plans @ www.WallDLine.com

GENERAL NOTES:

- A. SPACE ABOVE LAY-IN CEILING IS USED AS A RETURN AIR PLENUM. ALL ITEMS INSTALLED IN PLENUM SPACE MUST BE RATED FOR USE IN PLENUM AND MEET ALL SPREAD/SMOKE DEVELOPED RATINGS.

PLAN NOTES:

- 1. 20X14 EXHAUST DUCT STUBBED OUT FOR FUTURE USE.
- 2. 26X26 UP TO 3RD FLOOR. 20X20 DOWN TO 1ST FLOOR.
- 3. PROVIDE FIRE/SMOKE DAMPERS WHERE DUCT EXITS CHASE.
- 4. 70X20 SUPPLY & 70X24 RETURN IN CHASE.
- 5. 60X12 TRANSFER DUCT ABOVE CEILING.
- 6. OPEN END RETURN DUCT. COVER OPENING WITH HARDWARE CLOTH.

WALL LEGEND	
WALL CONSTRUCTION TYP.	
.....	UNRATED PARTITION TO ABOVE CLG.
-----	LEASE SPACE PARTITION
.....	UNRATED PARTITION TO DECK
.....	SMOKE PARTITION
.....	SMOKE BARRIER
.....	1 HOUR FIRE BARRIER
.....	1 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR FIRE BARRIER
.....	2 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR SHAFT BARRIER

NOTE: 1.) FOR SOUND WALLS SEE DIMENSIONED PLAN.
2.) ALL WALL TYPES MAY NOT BE USED.

HVAC
SECOND FLOOR PLAN



REVISIONS	
NO.	DATE

M1.02
ISSUE DATE: 11.12.19
JOB NUMBER: 19020