





**PRH  
 MEDICAL OFFICE BUILDING**

FLORIDA  
 NAPLES

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION TO DAVIS STORES ARCHITECTS AND ITS AFFILIATES. IT IS THE PROPERTY OF DAVIS STORES ARCHITECTS AND ITS AFFILIATES. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE PRIOR WRITTEN PERMISSION OF DAVIS STORES ARCHITECTS AND ITS AFFILIATES. COPYRIGHT 2019. ALL RIGHTS RESERVED.

7121 CROSSROADS BVD  
 888-HYWOOD, IN 47027  
 TEL: (615) 776-0310  
 FAX: (615) 776-0310  
 www.dscarch.com

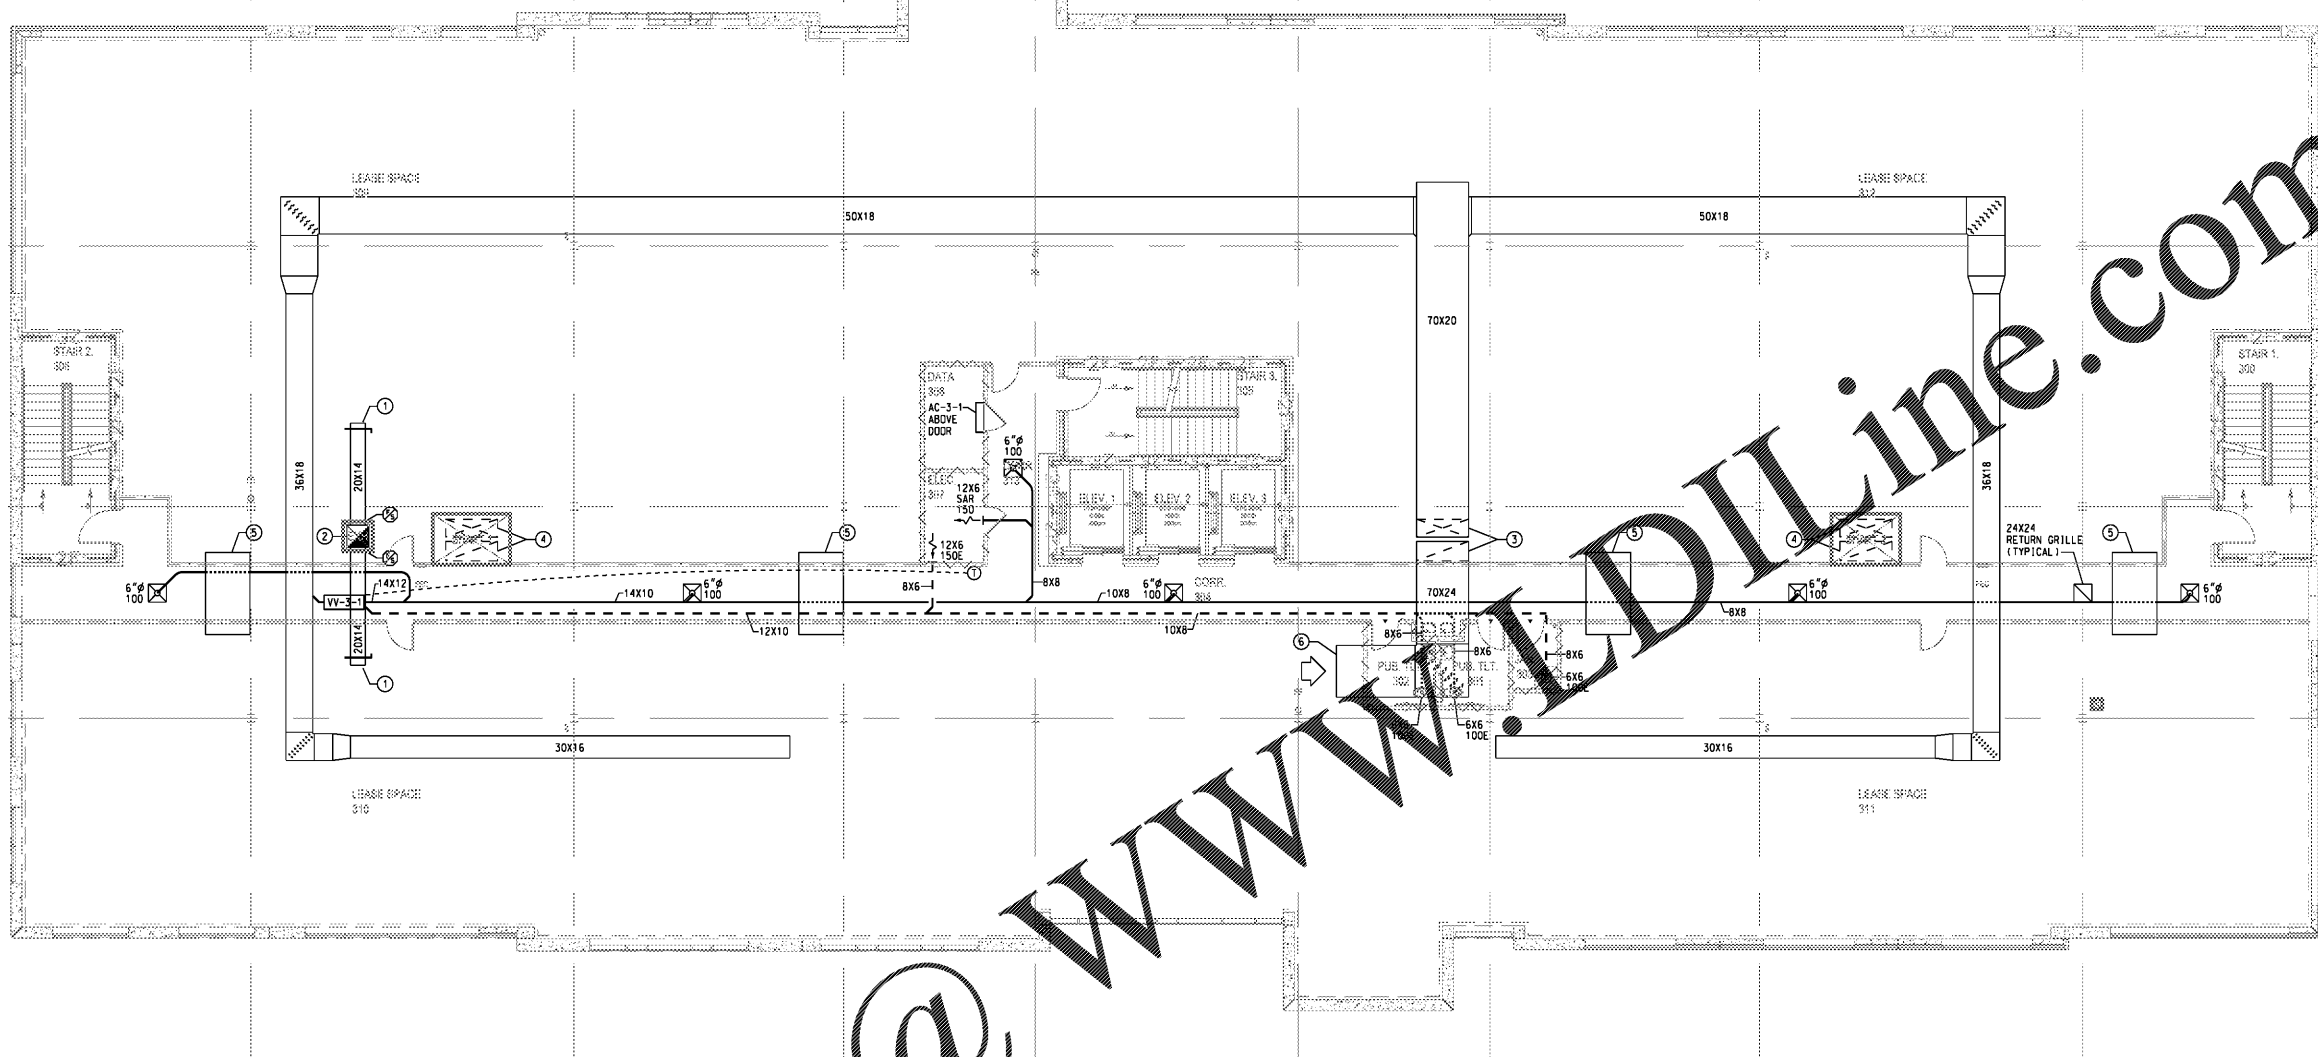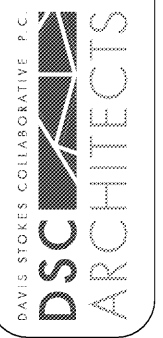

Order Plans @ [www.LDILine.com](http://www.LDILine.com)

**GENERAL NOTES:**

- A. SPACE ABOVE LAY-IN CEILING IS USED AS A RETURN AIR PLENUM. ALL ITEMS INSTALLED IN PLENUM SPACE MUST BE RATED FOR USE IN PLENUM AND MEET ALL SPREAD/SMOKE DEVELOPED RATINGS.

**PLAN NOTES:**

- 1. 20X14 EXHAUST DUCT STUBBED OUT FOR FUTURE USE.
- 2. 30X30 UP TO 4TH FLOOR. 26X26 DOWN TO 2ND FLOOR.
- 3. PROVIDE FIRE/SMOKE DAMPERS WHERE DUCT EXITS CHASE.
- 4. 70X20 SUPPLY & 70X24 RETURN IN CHASE.
- 5. 60X12 TRANSFER DUCT ABOVE CEILING.
- 6. OPEN END RETURN DUCT. COVER OPENING WITH HARDWARE CLOTH.

**WALL LEGEND**

WALL CONSTRUCTION TYP.

.....	UNRATED PARTITION TO ABOVE CLG.
-----	LEASE SPACE PARTITION
.....	UNRATED PARTITION TO DECK
.....	SMOKE PARTITION
.....	SMOKE BARRIER
.....	1 HOUR FIRE BARRIER
.....	1 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR FIRE BARRIER
.....	2 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR SHAFT BARRIER

NOTE: 1.) FOR SOUND WALLS SEE DIMENSIONED PLAN.  
 2.) ALL WALL TYPES MAY NOT BE USED.

**HVAC  
 THIRD FLOOR PLAN**



**REVISIONS**

NO.	DATE	DESCRIPTION