



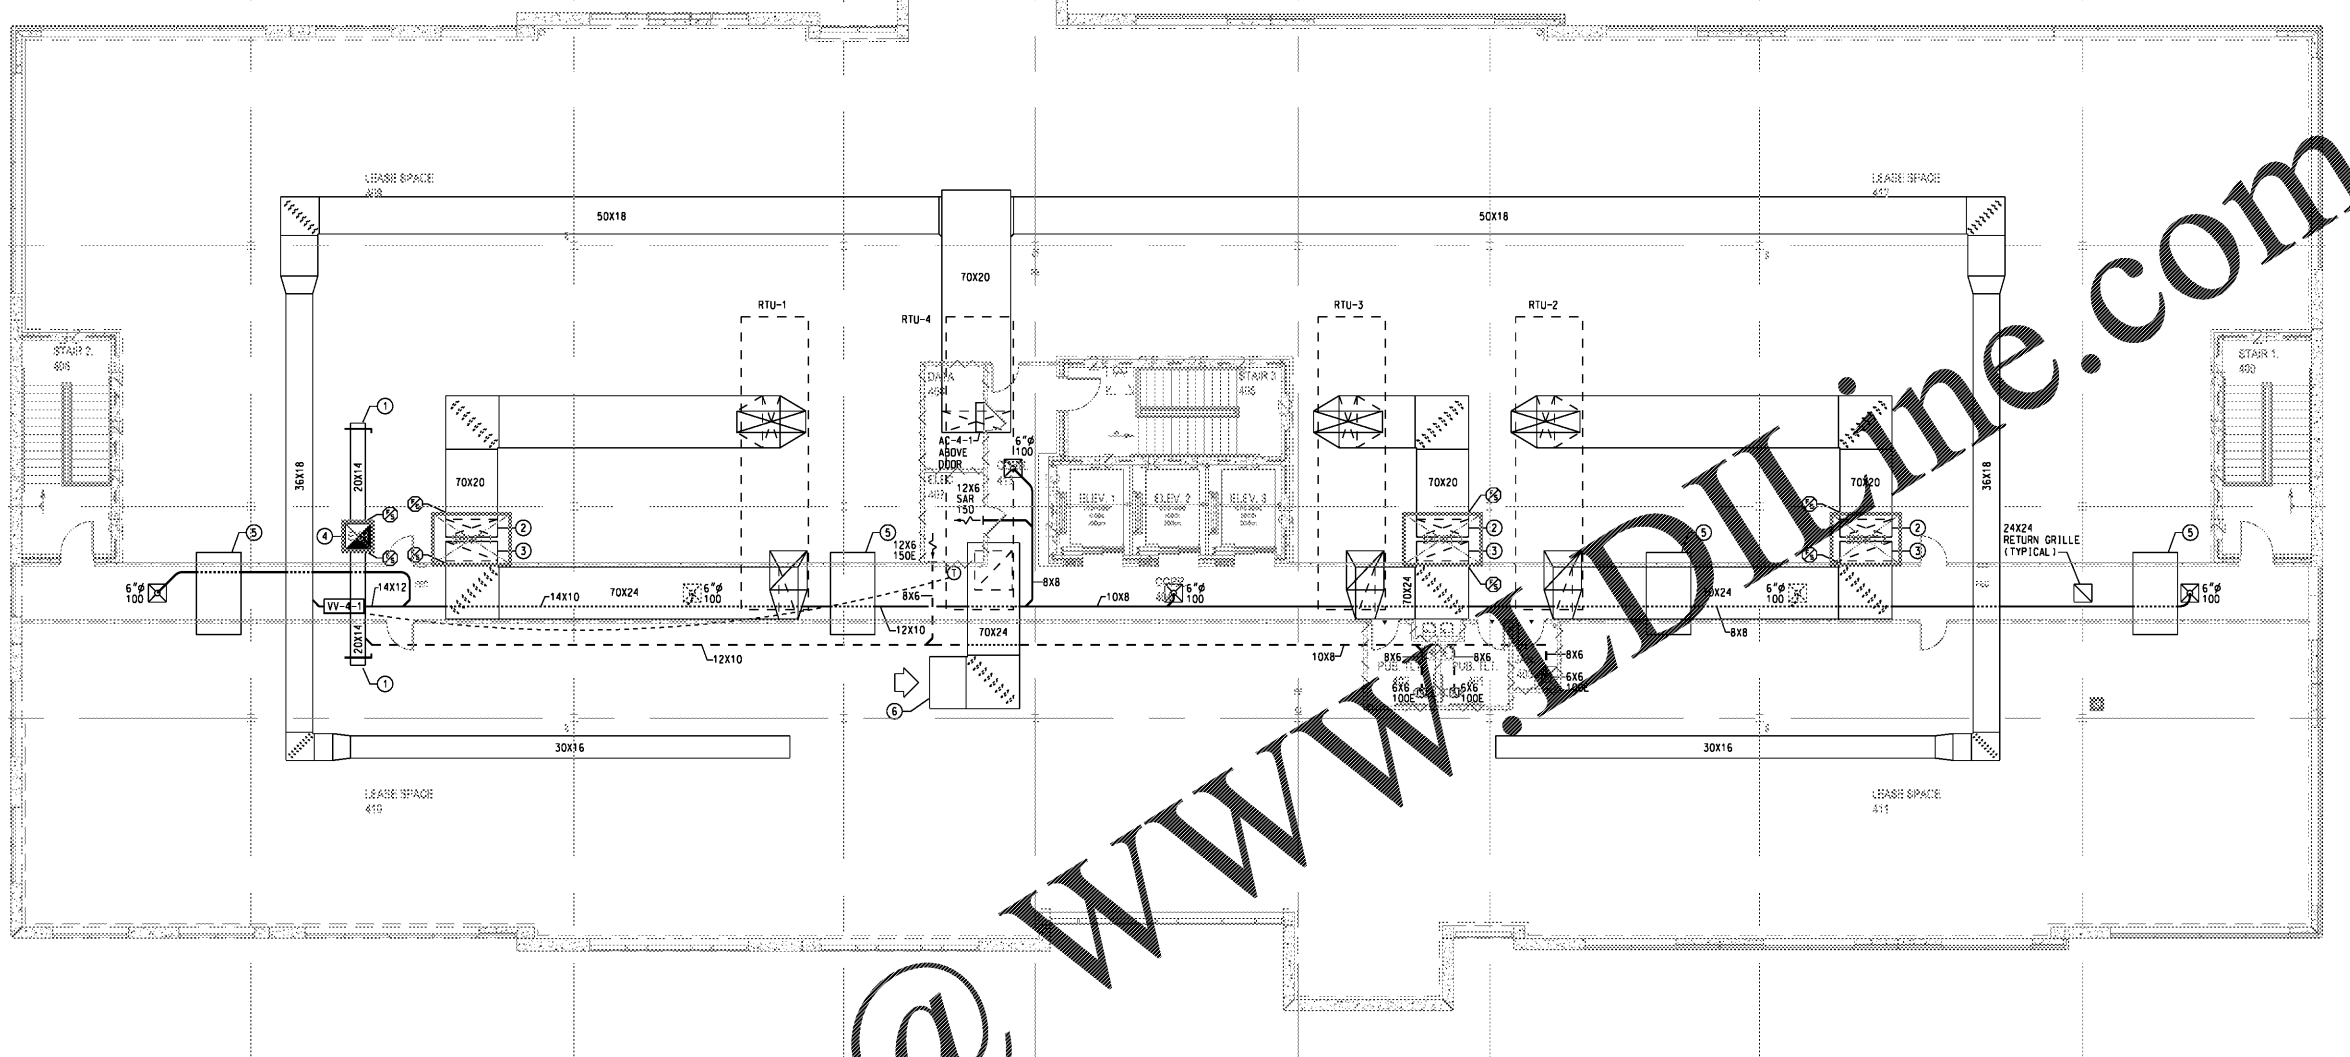

**PRH
MEDICAL OFFICE BUILDING**
NAPLES, FLORIDA

THIS DOCUMENT CONTAINS PROPRIETARY TO DAVIS STORES INFORMATION AND/OR ITS CONTENTS MAY NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE PRIOR WRITTEN PERMISSION OF DAVIS STORES COLLABORATIVE, P.C. COPYRIGHT 2019. ALL RIGHTS RESERVED.

7121 CROSSROADS BVD
888-HYWOOD, IN 47027
TEL: (615) 776-6310
FAX: (615) 776-6310
WWW.DSCARCHITECTS.COM

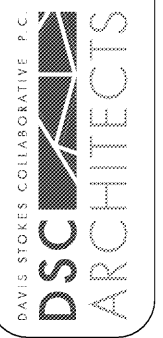

Order Plans @ www.tdline.com

- GENERAL NOTES:**
- A. SPACE ABOVE LAY IN CEILING IS USED AS A RETURN AIR PLENUM. ALL ITEMS INSTALLED IN PLENUM SPACE MUST BE RATED FOR USE IN PLENUM AND MEET ALL SPREAD/SMOKE DEVELOPED RATINGS.

- PLAN NOTES:**
1. 20X14 EXHAUST DUCT STUBBED OUT FOR FUTURE USE.
 2. 70X20 SUPPLY DUCT DOWN IN CHASE. PROVIDE FIRE/SMOKE DAMPER WHERE DUCT ENTERS CHASE.
 3. 70X24 RETURN DUCT DOWN IN CHASE. PROVIDE FIRE/SMOKE DAMPER WHERE DUCT ENTERS CHASE.
 4. 34X34 UP TO EF-1 ON ROOF. 30X30 DOWN IN CHASE TO 3RD FLOOR.
 5. 60X12 TRANSFER DUCT ABOVE CEILING.
 6. OPEN END RETURN DUCT. COVER OPENING WITH HARDWARE CLOTH.

WALL LEGEND

WALL CONSTRUCTION TYP.

.....	UNRATED PARTITION TO ABOVE CLG.
-----	LEASE SPACE PARTITION
.....	UNRATED PARTITION TO DECK
.....	SMOKE PARTITION
.....	SMOKE BARRIER
.....	1 HOUR FIRE BARRIER
.....	1 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR FIRE BARRIER
.....	2 HOUR FIRE - SMOKE BARRIER
.....	2 HOUR SHAFT BARRIER

NOTE: 1.) FOR SOUND WALLS SEE DIMENSIONED PLAN.
2.) ALL WALL TYPES MAY NOT BE USED.

HVAC
FOURTH FLOOR PLAN



REVISIONS

NO.	DATE	DESCRIPTION