



01 20,000 GAL. TANK ELEVATION – 20,000 REGULAR
 CFG14.3 SCALE: 3/8" = 1'-0"

- NOTE #1** - ALL GALVANIZED IRON PIPE RISERS IN CONTACT WITH BACKFILL SHALL BE COATED WITH 1/8" MIN. EPOXY RESIN COATING (TYP.)
- NOTE #2** - MORE THAN 5'-0" TANK BURIAL REQUIRES APPROVAL OF CUMBERLAND FARMS CONSTRUCTION MANAGER.
- NOTE #3** - EXTERIOR SEAMS OF TANK SUMP ARE TO BE WRAPPED IN FIBERGLASS & COATED IN ADDITION TO MANUFACTURER'S REQUIREMENTS.

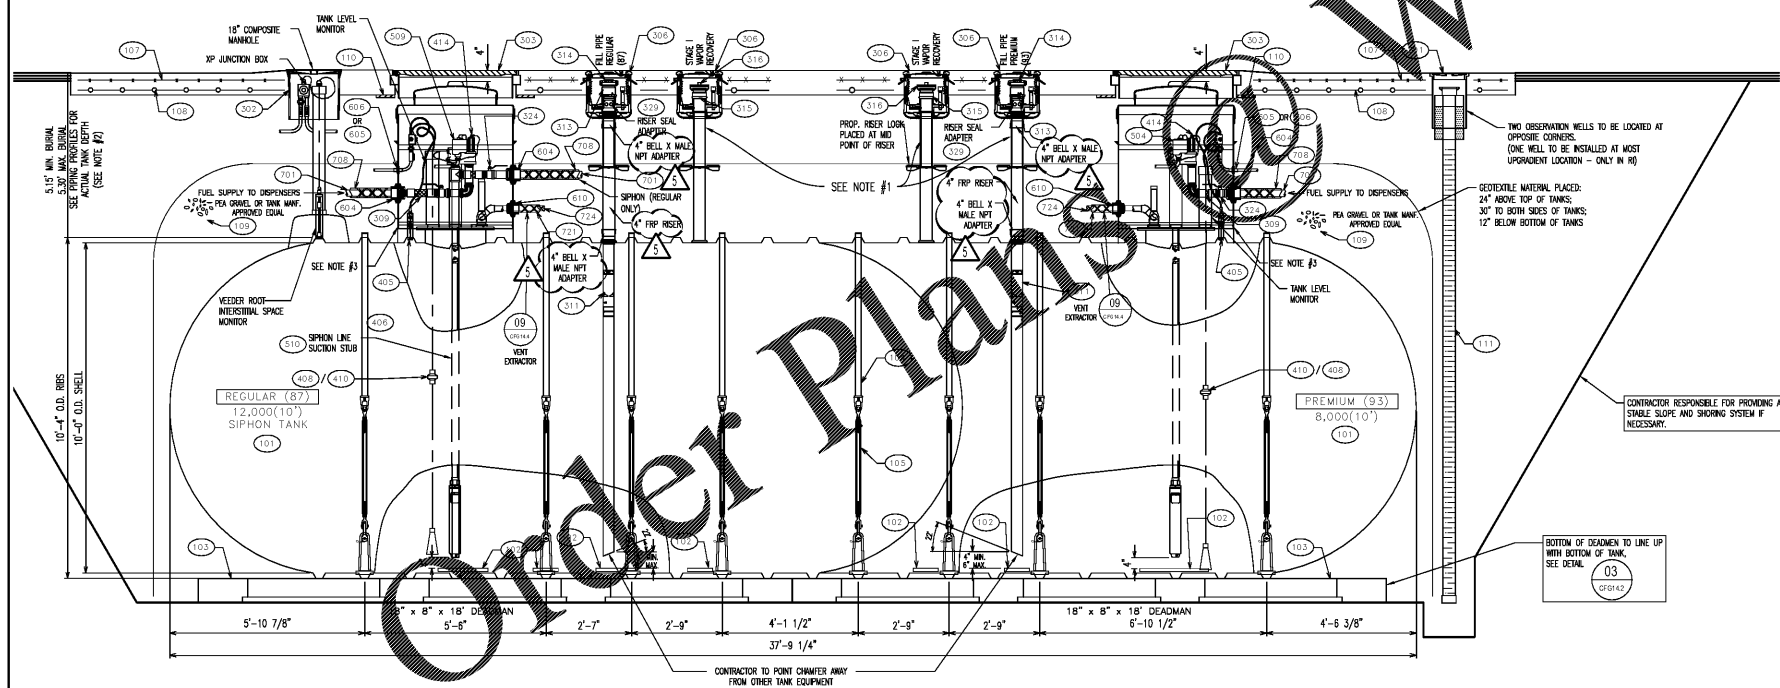

02 20,000 GAL. TANK ELEVATION – 12,000 REGULAR / 8,000 PREMIUM
 CFG14.3 SCALE: 3/8" = 1'-0"

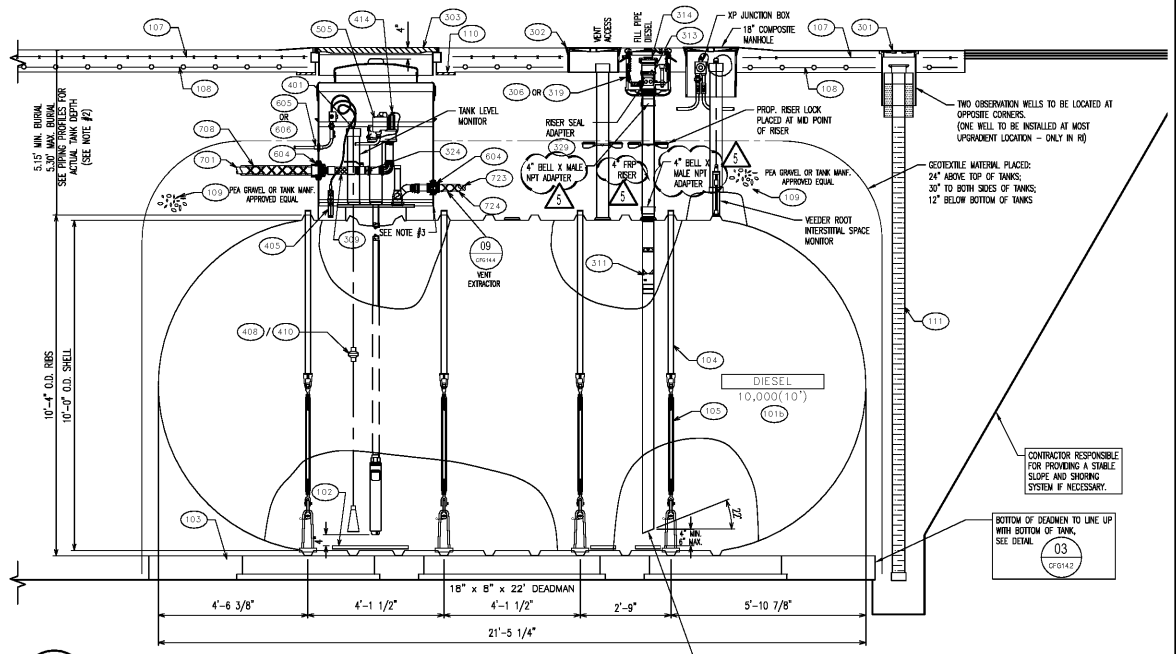

03 10,000 GAL. TANK ELEVATION – 10,000 DIESEL
 CFG14.3 SCALE: 3/8" = 1'-0"

THOMAS ENGINEERING
 MICHAEL A. TROXELL
 PROFESSIONAL ENGINEER
 October 2, 2019
 FLORIDA LICENSE NO. 50572
 FLORIDA BUSINESS CERT. OF AUTH. NO. 27579

811 KNOW WHAT'S BELOW
 ALWAYS CALL 811
 BEFORE YOU DIG
 www.callsunshine.com

| REVISIONS | | | |
|-----------|---------|---------|------------------------|
| NO. | DATE | REV. BY | DESCRIPTION |
| 1 | 5/15/19 | MTK | 90% PLAN SUBMITTAL |
| 2 | 6/25/19 | MTK | 100% PLAN SUBMITTAL |
| 5 | 10/1/19 | MTK | FILL RISER PIPE UPDATE |

V# n/a
 Store# n/a
 Gas Station# n/a
 Sunrise Blvd. &
 NE 4th Avenue
 Fort Lauderdale, FL

CUMBERLAND FARMS, INC.
 100 Crossing Boulevard
 Frammingham, MA 01702

SCALE: AS NOTED
 DATE: January 7, 2015
 FILE: 20150107-01 (2015.01.07)
 DRAWN BY: T.M.R.

TANK INSTALLATION DETAILS CFG14.3