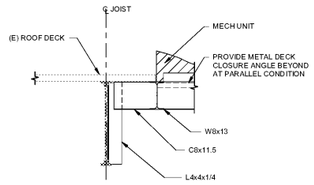

12 S501 TYPICAL ROOF DECK AT METAL MECHANICAL UNIT SUPPORT
3/4" = 1'-0"

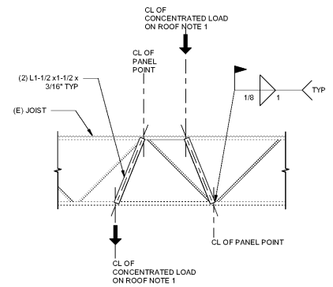

NOTE:
1. CONCENTRATED LOAD GREATER THAN 100 LBS BUT NOT TO EXCEED 300 LBS. MAX OF 2 LOADS TOTAL PER JOIST.

8 S501 TYPICAL JOIST REINFORCEMENT (CONCENTRATED LOAD)
3/4" = 1'-0"

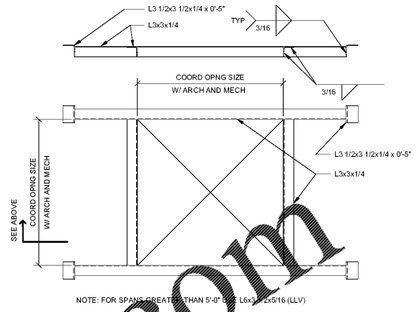

NOTE: FOR SPANS GREATER THAN 5'-0" USE L6x3 1/2x5/16 (LLV)

4 S501 TYPICAL FRAMING AT ROOF DECK OPENING
3/4" = 1'-0"

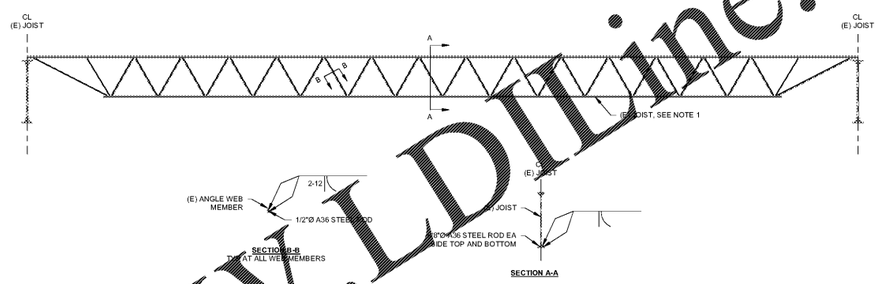

NOTES:
1. BRACE EXISTING JOIST PRIOR TO AUGMENTATION. LOCATION SHORES AT JOIST PANEL POINT.

11 S501 JOIST AUGMENTATION DETAIL
3/8" = 1'-0"

Order Plans @ www.LDIline.com

ISSUED FOR CONSTRUCTION

No.	DESCRIPTION	DATE

CITY OF MONROE
PUBLIC SAFETY & MUNICIPAL COURT COMPLEX RENOVATION
140 BLAINE ST. MONROE, GA 30655

SHEAR STRUCTURAL
501 SAUNDERS FORD
ATLANTA, GA 30350
(678) 513-4264
SHEARSTRUCTURAL.COM

Structgroup
ATLANTA OFFICE
UNIT 3A
ALPHARETTA, GEORGIA 30013
T 404 855 0950
F 404 855 0950
info@structgroup.com
© 2019 STRUCTGROUP

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT. NO PART OF THIS DOCUMENT SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM, ELECTRONICALLY OR MECHANICALLY, FOR ANY PURPOSE, WITHOUT THE EXPRESS WRITTEN PERMISSION OF THE ARCHITECT.

FRAMING DETAILS

PROJECT # 19160MONRpo
DATE: 09/04/19
DRAWN BY: DFM
CHECKED BY: HJ

S501

SCALE As indicated