

NOTES:

- VERIFY WITH CEC WHICH DISCHARGES FROM DEWATERING ACTIVITIES ARE ALLOWED OR ARE NOT ALLOWED NON-STORMWATER DISCHARGES UNDER THE GENERAL PERMIT AND OTHER REGULATIONS. OBTAIN ALL DEWATERING PERMITS AND AUTHORIZATIONS REQUIRED BY STATE AND LOCAL REGULATIONS. SEE THE REQUIRED DEWATERING PERMITS AND AUTHORIZATIONS TABLE BELOW. GC MUST COMPLETE COLUMNS 3 AND 4.
- GC MUST WAIT TO HAVE WRITTEN COPY OF ALL REQUIRED DEWATERING PERMITS AND AUTHORIZATIONS BEFORE PERFORMING DEWATERING ACTIVITIES.
- DISCHARGES FROM DEWATERING OPERATIONS MUST BE DIRECTED THROUGH AN APPROPRIATE POLLUTION PREVENTION/TREATMENT SYSTEM OF CONTROL MEASURES, SUCH AS A SEDIMENT/FILTER BAG, SEDIMENT TRAP OR SEDIMENT BASIN, AND OTHERS, AS NEEDED, PRIOR TO BEING DISCHARGED FROM THE SITE OR INTO A WATER BODY OF THE STATE. UNDER NO CIRCUMSTANCES ARE DISCHARGES FROM DEWATERING OPERATIONS TO BE DISCHARGED DIRECTLY INTO SANITARY SEWER SYSTEMS, STREAMS, RIVERS, LAKES OR OTHER AREAS BEYOND THE PERMITTED PROJECT AREA. LIKEWISE, DISCHARGES INTO STORM SEWER SYSTEMS THAT DO NOT DRAIN TO A SUITABLE ON-SITE TREATMENT FACILITY, SUCH AS A BASIN, ARE ALSO PROHIBITED. DISCHARGES FROM DEWATERING OPERATIONS MUST ALSO BE CONDUCTED IN A MANNER SUFFICIENT TO PREVENT EROSION FROM THE DISCHARGE RUNOFF.
- IN SEDIMENT TRAP OR BASIN OR POND DEWATERING OPERATIONS, WATER MUST ONLY BE REMOVED FROM THE SURFACE OF THE CONTAINED WATER. A SKIMMER OR SIMILAR FLOATING DEVICE MUST BE USED, TO ONLY REMOVE THE WATER AT THE SURFACE.
- DO NOT DISCHARGE ON A SLOPE GREATER THAN THREE PERCENT NOR WITHIN 20 FEET OF A SURFACE WATER BODY.
- DEWATERING SHALL NOT OCCUR DURING OR IMMEDIATELY AFTER PRECIPITATION EVENTS, BUT EXCEPTIONS SHALL BE EVALUATED ON CASE BY CASE BASIS. CONTACT THE CEC AND RECEIVE WRITTEN APPROVAL.

REQUIRED DEWATERING PERMITS AND AUTHORIZATIONS			
1	2	3	4
GOVERNING AGENCY	PERMIT NAME/TYPE	PERMIT NO. (GC TO COMPLETE)	DATE PERMIT WAS ISSUED BY AGENCY (GC TO COMPLETE)
N/A	N/A	N/A	N/A

DW DEWATERING

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2012

NOTES:

- SUBSTANCES THAT HAVE THE POTENTIAL FOR POLLUTING SURFACE AND/OR GROUNDWATER MUST BE CONTROLLED BY ANY MEANS NECESSARY TO ENSURE THAT THOSE DO NOT DISCHARGE FROM THE SITE. IN THIS REGARD, POTENTIALLY POLLUTING SUBSTANCES SHALL BE STORED AND HANDLED IN A MANNER CONSISTENT WITH THE RISK OF IMPACT THOSE REPRESENT, AND ACCORDING WITH THE REGULATIONS.
- NO SOLID MATERIALS, INCLUDING BUILDING MATERIALS, ARE ALLOWED TO BE DISCHARGED FROM THE SITE WITH STORMWATER. ALL SOLID WASTE, INCLUDING DISPOSABLE MATERIALS INCIDENTAL TO THE CONSTRUCTION ACTIVITIES, MUST BE COLLECTED AND PLACED IN CONTAINERS. RUBBISH, TRASH, GARBAGE, LITTER, OR OTHER SUCH MATERIALS SHALL BE DEPOSITED INTO SEALED CONTAINERS. MATERIALS SHALL BE PREVENTED FROM LEAVING THE PREMISES THROUGH THE ACTION OF WIND OR STORMWATER DISCHARGE INTO DRAINAGE DITCHES OR WATERS OF THE STATE. THE CONTAINERS SHALL BE Hauled AWAY FROM THE SITE AND EMPTIED WHEN THESE BECOME SPILL RISK OR CERTIFIED TRASH DISPOSAL SERVICE LIDS OR COVERS FOR THE CONTAINERS SHALL BE PROVIDED FOR USE DURING RAIN EVENTS TO PREVENT WASTE CONTACT WITH STORMWATER. WASTES THAT CANNOT BE STORED IN A CONTAINER MUST BE STORED UNDER COVER OR IN DOORS. THE LOCATION OF SOLID WASTE RECEPTILES SHALL BE SHOWN ON THE SITE MAPS.

SWD SOLID WASTE DISPOSAL

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- CONTRACTOR SHALL PROVIDE DESIGNATED LOCATION FOR SORTING AND SEPARATING HAZARDOUS WASTES.
- HAZARDOUS WASTE STORAGE MUST BE PROTECTED FROM WEATHER ELEMENTS AND HAVE RESTRICTED ACCESS.
- HAZARDOUS WASTE STORAGE MUST COMPLY WITH LOCAL, STATE, AND FEDERAL REGULATIONS.
- HAZARDOUS WASTE STORAGE MUST COMPLY WITH CONTRACT DOCUMENTS.

HWD HAZARDOUS WASTE DISPOSAL

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- ALL PERSONNEL INVOLVED WITH CONSTRUCTION ACTIVITIES MUST COMPLY WITH STATE AND LOCAL SANITARY OR SEPTIC SYSTEM REGULATIONS. PORTABLE TOILETS MUST BE LOCATED AT LEAST 30 FEET FROM INLETS, CHANNELS, SWALES, OR PERMITTED LIMITS OF DISTURBANCE, AND MUST BE LOCATED AT LEAST 50 FEET FROM WATERS OF THE STATE OR WATERS OF THE SEA. PORTABLE TOILETS MUST BE SECURELY ANCHORED AND/OR TIED DOWN. SECONDARY CONTAINMENT SHALL BE PROVIDED AND CAPACITY SHALL BE RESTORED IMMEDIATELY UPON DISCOVERY OF ITS DIMINISHMENT. THE LOCATION OF SANITARY FACILITIES SHALL BE SHOWN ON THE SITE MAPS.

SAF SANITARY FACILITIES

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THE TEMPORARY PARKING AND STORAGE AREA SHALL BE KEPT IN GOOD CONDITION (SUITABLE FOR PARKING AND STORAGE). THIS MAY REQUIRE PERIODIC TOP DRESSING OR SWEEPING (IF LOCATED ON PAVEMENT) OF THE TEMPORARY PARKING AREA AS CONDITIONS DEMAND IN ORDER TO PREVENT TRACK OUT OF SEDIMENT.

TP TEMPORARY PARKING

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- ALL ON-SITE TOPSOIL MUST BE PRESERVED FOR REUSE ON THE SITE DURING REVEGETATION, UNLESS IT IS INFEASIBLE OR UNDESIRABLE TO DO SO. INSTEAD, TOPSOIL STOCKPILING ON-SITE MAY BE NECESSARY IF SPACE IS NOT AVAILABLE ON-SITE FOR TOPSOIL STOCKPILING OR IF LITTLE TO NO VEGETATION IS TO REMAIN UNDER POST-CONSTRUCTION CONDITIONS. STOCKPILING OF TOPSOIL AT AN OFF-SITE LOCATION OR TRANSFER OF TOPSOIL TO OTHER LOCATIONS MAY ALSO BE ACCEPTABLE BUT MUST BE AUTHORIZED BY THE CEC.
- ALL SOIL STOCKPILES MUST BE STABILIZED TO PREVENT EROSION AND FUGITIVE DUST. THE SURFACE OF THE STOCKPILE MUST BE PROPERLY PROTECTED TO ELIMINATE THE RISK OF EROSION. SET TEMPORARY SEEDING OR STABILIZATION DETAIL, SUITABLE ALTERNATIVE MEANS OF STABILIZATION CAN BE USED, SUCH AS PROPERLY ANCHORED PLASTIC TARPS.
- PERIMETER SEDIMENT CONTROLS ALSO MUST BE INSTALLED AT STOCKPILE LOCATIONS TO PREVENT CONTACT WITH STORMWATER, INCLUDING RUN-ON.
- STOCKPILES MUST BE LOCATED OUTSIDE OF ANY VEGETATED BUFFER AREAS AND SHOULD BE LOCATED AS FAR AS PRACTICABLE FROM STORMWATER CONVEYANCES AND IMPOUNDMENTS AND WATER BODIES.
- STOCKPILE LOCATIONS SHALL BE NOTED ON THE SITE MAPS.

SP STOCKPILES

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2012

NOTES:

- LARGE AREAS OF SOIL THAT ARE DENIVED OF VEGETATION AND HAVE NO PROTECTION FROM PARTICLES BEING PICKED UP AND CARRIED BY WIND SHOULD BE PROTECTED WITH A TEMPORARY COVER OR KEPT UNDER CONTROL WITH WATER OR OTHER SOIL ADHERING PRODUCTS TO PREVENT SOIL PARTICLES FROM BECOMING AIRBORNE, AND FROM EXITING THE SITE PERIMETER.
- WATER TRUCKS OR OTHER DUST CONTROL AGENTS SHALL BE USED AS NEEDED DURING CONSTRUCTION TO MINIMIZE DUST GENERATED ON THE SITE. TACKIFIERS MAY BE USED TO HOLD SOIL IN PLACE AND PREVENT DUST. MANUFACTURER RECOMMENDATIONS FOR APPLICATION LOCATIONS AND RATES MUST BE USED FOR DUST CONTROL APPLICATIONS. ONLY SWEEP-OPERATED TACKIFIERS MAY BE USED ON THE PROJECT SITE. ANY CHEMICAL APPLICATION NOT INCLUDED IN THE SWPPP MUST BE APPROVED, IN WRITING, BY THE CEC.
- DUST CONTROL MUST BE PROVIDED BY THE GC TO A DEGREE THAT IS IN COMPLIANCE WITH APPLICABLE FEDERAL, LOCAL AND STATE DUST CONTROL REGULATIONS.
- THE USE OF MOTOR OILS AND OTHER PETROLEUM BASED OR TOXIC LIQUIDS FOR DUST SUPPRESSION OPERATIONS IS PROHIBITED.
- IN ADDITION TO SWPPS, GC SHALL PERFORM PER PRACTICES AND PROCEDURES WHICH MINIMIZE AND PREVENT AIRBORNE DUST OR OTHER PARTICLES FROM OCCURRING.

DC DUST CONTROL

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2012

NOTES:

- MATERIAL STORAGE AREAS SHOULD BE LOCATED, WHEN POSSIBLE, TO MINIMIZE EXPOSURE TO WEATHER. INSPECTIONS SHALL EVALUATE DISTURBED AREAS AND AREAS USED FOR STORING MATERIALS THAT ARE EXPOSED TO RAINFALL FOR EVIDENCE OF, OR THE POTENTIAL FOR, POLLUTANTS ENTERING THE DRAINAGE SYSTEM OR DISCHARGING FROM THE SITE. IF NECESSARY, THE MATERIALS MUST BE COVERED OR ORIGINAL COVERS MUST BE REPAIRED OR SUPPLEMENTED. ALSO, PROTECTIVE BERMS MUST BE CONSTRUCTED, IF NEEDED, TO CONTAIN RUNOFF FROM MATERIAL STORAGE AREAS. GC SHALL ADHERE TO ALL STATE AND LOCAL REGULATIONS PERTAINING TO MATERIAL STORAGE AREAS.
- CHEMICALS, PAINTS, SOLVENTS, FERTILIZERS, AND OTHER TOXIC MATERIALS MUST BE STORED IN WATERPROOF CONTAINERS. EXCEPT DURING APPLICATION, THE CONTAINERS AND THE CONTENTS MUST BE KEPT IN TRUCKS OR INSIDE OF STORAGE FACILITIES. RUNOFF CONTAINING SUCH MATERIAL MUST BE COLLECTED, REMOVED FROM THE SITE, TREATED, AND DISPOSED OF AT AN APPROVED SOLID WASTE AND CHEMICAL DISPOSAL FACILITY.

MLS MATERIAL LAYDOWN AND STORAGE AREA

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- CONCRETE WASTE MANAGEMENT PERTAINS TO WASTE FROM CONCRETE READY-MIX TRUCKS, MASONRY OPERATIONS, AND SIMILAR WASTE.
- NO LOCAL AND/OR STATE REQUIREMENTS PROHIBIT THE USE OF CONCRETE WASHOUT-OUT TANKS.
- DISCHARGE OF EXCESS OR WASTE CONCRETE AND/OR WASH WATER FROM CONCRETE TRUCKS IS ALLOWED AT THE CONSTRUCTION SITE. ONLY COMMERCIALLY AVAILABLE ABOVE GROUND PORTABLE CONCRETE WASHOUT CONTAINERS ARE ALLOWED AND MUST BE PROTECTED FROM VEHICLE TRAFFIC AND CLEARLY IDENTIFIED BY SIGNAGE. CONTAINERS AND MUST BE LOCATED OUTSIDE OF VEGETATED BUFFERS AND AS FAR AS PRACTICABLE FROM STORMWATER CONVEYANCES AND IMPOUNDMENTS AND WATER BODIES. PORTABLE CONCRETE WASHOUT CONTAINERS SHALL COMPLY AND ACTIVELY MANAGE BOTH SOLID AND FLUID COMPONENTS OF THE MIX. CONCRETE WASHOUT CONTAINERS MUST BE CLEANED OR EXCHANGED WHEN THE REMAINING VOLUME IS REDUCED BY 65% TO PREVENT SPILLAGE DURING A STORM EVENT.
- ALTERNATIVELY, WASTE CONCRETE CAN BE PLACED INTO PILES TO MAKE RIP TILES AND OTHER USES. CONCRETE PRODUCTS, PORTABLE CONCRETE WASHOUT CONTAINERS SHALL BE DISPOSED IN ACCORDANCE WITH APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS. THE GC IS RESPONSIBLE FOR ASSURING THAT THESE REGULATIONS, APPLICABLE LAWS, AND ENVIRONMENTAL REGULATIONS ARE FOLLOWED. THE LOCATION OF CONCRETE WASHOUT CONTAINERS SHALL BE SHOWN ON THE SITE MAPS.

CW CONCRETE AND CONCRETE WASHOUT

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- PROVIDE WASH STATION IN A LOCATION PROTECTED FROM WEATHER ELEMENTS.
- COLLECT ALL USED WASH WATER AND DISPOSE OF IT PROPERLY.
- PROVIDE ADEQUATE SUPPLY OF WATER AND ANY OTHER SUPPLIES TO ENSURE PROPER OPERATION OF WASH STATION WHEN NEEDED.

PSW PAINT AND STUCCO WASHOUT

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THIS SECTION INCLUDES THE CONTROLS OF POLLUTANTS OTHER THAN SEDIMENT AND ADDITIONAL REQUIREMENTS OF THE GENERAL PERMIT.
- NO ADDITIONAL POLLUTANT CONTROLS ARE ANTICIPATED FOR THIS PROJECT.

OPC OTHER POLLUTANT CONTROLS

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- USING WATER FROM BASINS, TRAPS, TANKS, OR OTHER WATER CONTAINMENT AREAS FOR IRRIGATION MINIMIZES DISCHARGES FROM THE SITE, AND IT MAY SATISFY OTHER NEEDS OF THE CONSTRUCTION PROJECT, SUCH AS DUST CONTROL, VEGETATIVE ESTABLISHMENT, ETC.
- CARE SHOULD BE TAKEN THAT WATER UTILIZED FROM CONTAINMENT AREAS ON-SITE FOR CONSTRUCTION PURPOSES DOES NOT DISCHARGE OFF-SITE. IF DISCHARGE IS ANTICIPATED OR OBSERVED, DEWATERING PROCEDURES STATED IN THE DEWATERING DETAIL MUST BE FOLLOWED.
- GC SHALL IMPLEMENT IRRIGATION OR DISPERSION AS PRACTICABLE TO REDUCE WATER VOLUME IN IMPOUNDMENTS AND TO FOSTER VEGETATION GROWTH.

ID IRRIGATION OR DISPERSION

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2012

NOTES:

- STORM DRAIN INLET PROTECTION MEASURES SHALL PREVENT SOIL AND DEBRIS FROM ENTERING STORM DRAIN INLETS.
- TEMPORARY CONTROLS SHALL BE CONSTRUCTED BEFORE THE SURROUNDING AREA IS DISTURBED.
- TO PREVENT CLOGGING, STORM DRAIN CONTROL STRUCTURES MUST BE MAINTAINED FREQUENTLY.
- CHECK ALL TEMPORARY CONTROL MEASURES DAILY, AND AFTER EACH STORM EVENT.
- CONTROL MEASURES MUST BE BUILT PER DETAIL AND PLANS, AND MUST BE IN GOOD WORKING CONDITION AT ALL TIMES.

IP INLET PROTECTION

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THE GC SHALL IDENTIFY MASONRY AREA WITH LEGIBLE SIGNAGE ON THE SITE. TO THE EXTENT PRACTICAL, ALL MASONRY PRODUCTS, MATERIAL, INCLUDING SACK AND BAGGED CEMENT AND/OR MORTAR MATERIALS, MIX AND BAGGED CEMENT SHALL BE STORED WITHIN THE AREA IDENTIFIED. MATERIALS VULNERABLE TO WEATHER ELEMENTS SHALL BE STORED IN CONTAINERS AT THE END OF EACH WORK DAY, SUCH MATERIALS SHALL REMAIN STORED IN CONTAINERS WHEN NOT IN USE.
- RUNOFF CONTROL, SUCH AS DIVERSION BERMS, SILT FENCE, SILT DUNE, OR OTHER MEANS OF CONTAINMENT, SHALL BE PROVIDED TO PREVENT THE MIGRATION OF STORMWATER POLLUTANTS FROM THE MASONRY AREA. COVERED RECEPTILES FOR DEBRIS AND TRASH DISPOSAL SHALL ALSO BE PROVIDED.
- THE MASONRY AREA SHALL MEET OSHA AND OTHER REGULATORY REQUIREMENTS FOR PERSONAL PROTECTIVE EQUIPMENT (PPE), FIRE EXTINGUISHERS, ETC. GC SHALL PROVIDE TRAINING OR OTHER TECHNOLOGIES TO MASONRY AREA TO PREVENT AIRBORNE TRANSPORT OF CEMENT DUST AND OTHER PARTICULATES DUE TO HIGH SPEED WIND UNDER WINDY CONDITIONS. THE LOCATION OF THE MASONRY AREA SHALL BE SHOWN ON THE SITE MAPS.

MA MASONRY AREA

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THE GC SHALL IDENTIFY FUELING AREAS WITH LEGIBLE SIGNAGE ON THE SITE. TEMPORARY ON-SITE FUEL TANKS FOR CONSTRUCTION VEHICLES SHALL MEET ALL LOCAL, STATE AND FEDERAL REGULATIONS. ALL TANKS, SINGLE AND DOUBLE WALLED, SHALL BE PROVIDED WITH SECONDARY CONTAINMENT (THAT IS CONTAINMENT EXTERNAL TO AND SEPARATE FROM PRIMARY CONTAINMENT). TANKS SHALL HAVE APPROVED SPILL CONTAINMENT WITH THE CAPACITY REQUIRED BY THE APPLICABLE REGULATIONS. SECONDARY CONTAINMENT SHALL BE CONSTRUCTED OF MATERIALS OF SUFFICIENT THICKNESS, DENSITY, AND COMPOSITION SO AS NOT TO BE STRUCTURALLY WEAKENED AS A RESULT OF CONTACT WITH THE FUEL STORED AND CAPABLE OF CONTAINING DISCHARGED FUEL FOR A PERIOD OF TIME EQUAL TO OR LONGER THAN THE MAXIMUM ANTICIPATED TIME SUFFICIENT TO ALLOW RECOVERY OF DISCHARGED FUEL. IT SHALL BE CAPABLE OF CONTAINING 110% OF THE VOLUME OF THE PRIMARY TANK IF A SINGLE TANK IS USED, OR IN THE CASE OF MULTIPLE TANKS, 150% OF THE LARGEST TANK OR 110% OF THE AGGREGATE, WHICHEVER IS LARGER.
- THE TANKS SHALL BE IN SOUND CONDITION, FREE OF RUST OR OTHER DAMAGE WHICH MIGHT COMPROMISE CONTAINMENT. FUEL STORAGE AREAS SHALL MEET ALL EPA, OSHA AND OTHER REGULATORY REQUIREMENTS FOR SIGNAGE, FIRE EXTINGUISHERS, ETC. HOSES, VALVES, FITTINGS, CAPS, FILLER NOZZLES, AND ASSOCIATED HARDWARE SHALL BE MAINTAINED IN PROPER WORKING CONDITION AT ALL TIMES. TANKS SHALL BE LOCATED TO MINIMIZE EXPOSURE TO WEATHER AND SURFACE WATER DRAINAGE FEATURES. THE LOCATION OF FUEL TANKS SHALL BE SHOWN ON THE SITE MAPS.
- A SPILL PREVENTION, CONTROL, AND COUNTERMEASURE (SPCC) PLAN MUST BE DEVELOPED IF ABOVEGROUND OIL STORAGE CAPACITY AT THE CONSTRUCTION SITE EXCEEDS 1,320 GALLONS OR AS SPECIFIED BY STATE.
- CONTAINERS WITH A STORAGE CAPACITY OF 55-GALLONS OR LESS ARE NOT INCLUDED WHEN CALCULATING SITE STORAGE CAPACITY. THE GC SHALL WORK WITH THE CEC TO DEVELOP AND IMPLEMENT A SPCC PLAN IN ACCORDANCE WITH THE OIL POLLUTION PREVENTION REGULATION AT TITLE 40 OF THE CODE OF FEDERAL REGULATIONS, PART 112, (40 CFR 112).

FPSU FUEL AND PETROLEUM STORAGE AND USE

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THIS SECTION INCLUDES THE CONTROLS OF POLLUTANTS OTHER THAN SEDIMENT AND ADDITIONAL REQUIREMENTS OF THE GENERAL PERMIT.
- NO ADDITIONAL POLLUTANT CONTROLS ARE ANTICIPATED FOR THIS PROJECT.

OPC OTHER POLLUTANT CONTROLS

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

NOTES:

- THIS SECTION INCLUDES THE CONTROLS OF POLLUTANTS OTHER THAN SEDIMENT AND ADDITIONAL REQUIREMENTS OF THE GENERAL PERMIT.
- NO ADDITIONAL POLLUTANT CONTROLS ARE ANTICIPATED FOR THIS PROJECT.

OPC OTHER POLLUTANT CONTROLS

LAST REVISED: WALMART STANDARD DETAIL
JUNE 2013

DEVELOPER/OWNER:
WALMART INC.
702 SW 8TH STREET, MAIL STOP 0505
BENTONVILLE, AR 72716-0505
479-204-3314

SITE OPERATOR/GENERAL CONTRACTOR:

SUPERINTENDENT:

IMPORTANT: GC MUST SIGN ALL PLAN SHEETS AND ANY NEW PLAN SHEETS ISSUED BY THE CEC.

SWPPP DETAIL SHEET 3

REVISIONS	
NO.	DESCRIPTION


CEI Engineering Associates, Inc.
ENGINEERS • PLANNERS • SURVEYORS
LANDSCAPE ARCHITECTS • ENVIRONMENTAL SCIENTISTS

7445 N. Ingram Ave., Suite 107
Fresno, CA 93711
(559)442-3119
FAX: (559)442-3129

SAMS CLUB FUEL STATION #6663-502

SWPPP DETAIL SHEET 3

3812 LIBERTY HWY #6
ANDERSON SOUTH CAROLINA

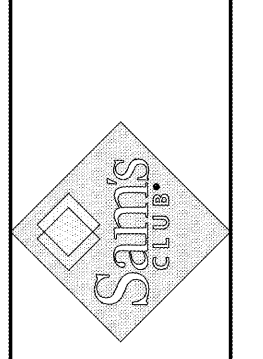

INITIAL DESIGN	11/7/19
DATE	
JOG	JPD
JAP	DV
DPOR	DES
PM	DRW

JOB NO.: 31076	SHEET NO.
DWG NAME: 31076-SWPPP	SW9
DATE: 11/7/19	
REV-0	
12:19 PM	

JOB # 31076 DRAWING: 31076-SWPPP.dwg LAST SAVED BY: DYCING