KEYNOTES

11.107	PROVIDE GEOTEXTILE FABRIC LINER AT LINE OF EXCAVATION. GEOTEXTILE FABRIC TO BE NON-WOVEN FABRIC WITH MINIMUM GF 180-LB GRAB TENSILE STRENGTH (GTS). WRAP FABRIC AT TOP OF EXCAVATION - EXTEND 3'-0"MIN BENEATH TANK SLAB AROUND ENTIRE PERIMETER. OVER EXCAVATION MAY BE REQUIRED DUE TO SOIL CONDITIONS OR LOCAL REQUIREMENTS. VERIFY DISTANCE PER TANK MANUFACTURER'S INSTALLATION SPECIFICATIONS
11.120	DETERMINE EXACT BURIAL DEPTH OF TANKS AS REQUIRED TO MAINTAIN 1.0" PER FOOT SLOPE OF PIPING FROM DISPENSERS NEAREST TO TANKS AND FROM VENT TERMINAL TO TANKS. BURIAL GREATER THAN THE MAXIMUM DEPTH INDICATED ON DETAIL REQUIRES APPROVAL OF OWNER'S CONSTRUCTION MANAGER. COORDINATE WITH VENDOR FOR SUMP EXTENSION RINGS AS REQUIRED.

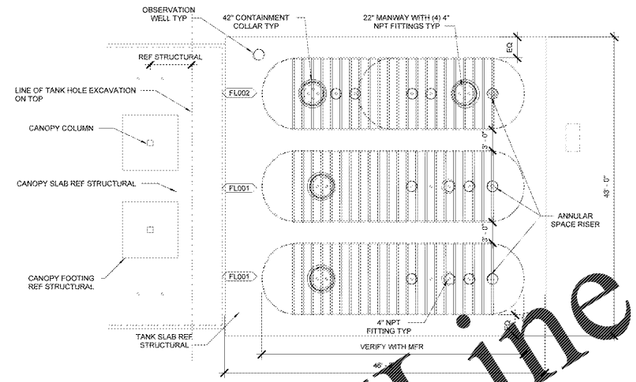

4 STORAGE TANK PLAN
1/8"

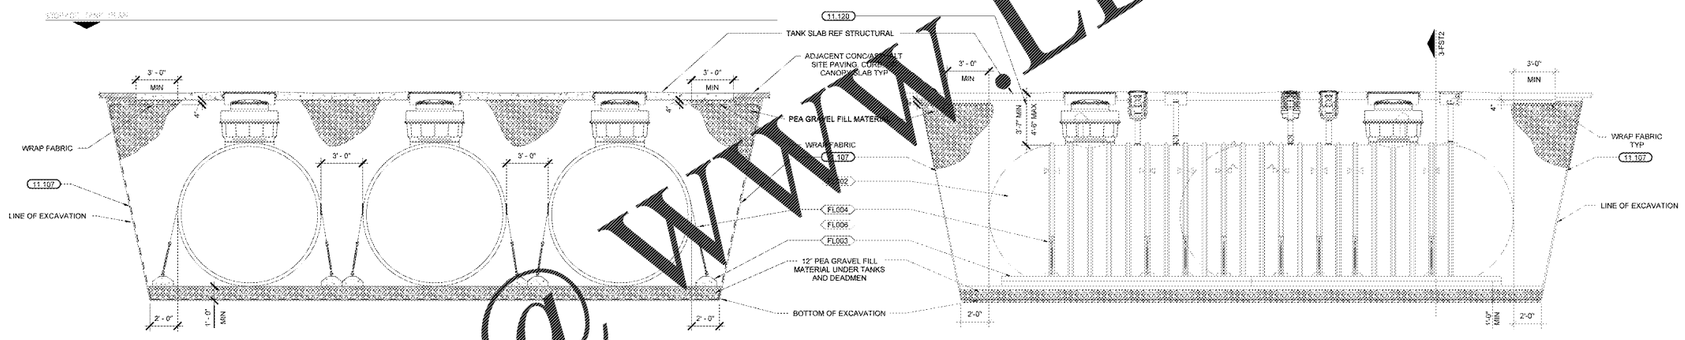

3 UNDERGROUND STORAGE TANK SECTION
NTS

2 TWO COMPARTMENT UNDERGROUND STORAGE TANK
NTS

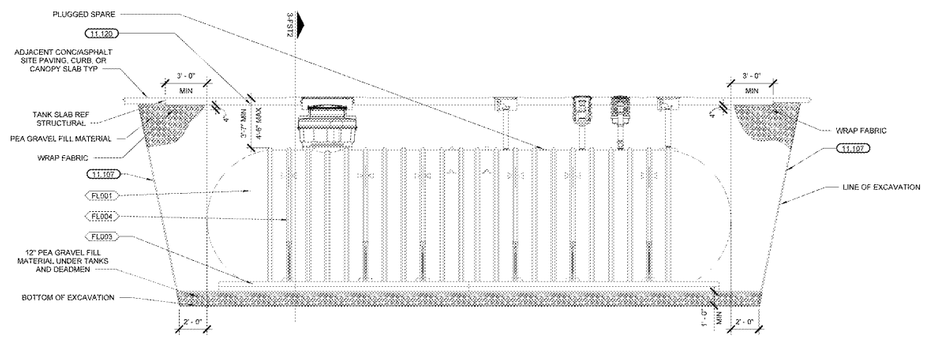

1 UNDERGROUND STORAGE TANK DETAIL
NTS

Order Plans @ WWW.LDHLine.com

STIPULATION FOR REUSE

THE DESIGNS AND DETAILS ON THESE PLANS ARE AND SHALL REMAIN THE PROPERTY OF SIMS STUDIO AND SHALL NOT BE USED IN WHOLE OR IN PART FOR ANY PROJECT OTHER THAN THE ONE FOR WHICH THEY ARE PREPARED. ANY REUSE, DISCLOSURE, REPRODUCTION OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF SIMS STUDIO IS PROHIBITED AND ANY USE OF THE PROJECT NOT AUTHORIZED HEREIN MAY BE CONSTRUED AS UNLAWFUL.

CONSULTANTS
David P. Kimball P.E.
#74-435-0864
SUITE 5338
3 BARKER AVE 9
WHITE PLAINS, NY 10601
ROGERS, AR 72756 DESIGNED BY: DAD

SIMS STUDIO

ANDERSON, SC

CLUB#: 6463

JOB NUMBER: 24077 | PROTO: SAMB-102

ISSUE BLOCK

CHECKED BY:	JMS
DRAWN BY:	DAD
FILE NAME:	FST2
PROTO CYCLE:	102616
DOCUMENT DATE:	08/09/16

NOT FOR CONSTRUCTION

TANK DETAILS

SHEET
FST2

Author